

Mitsubishi Programmable Controller

MELSEC iQ-R
series

MELSEC iQ-R Ethernet/CC-Link IE User's Manual (Startup)

- RJ71EN71
- RJ71GP21-SX
- RJ71GF11-T2
- R04CPU
- R04ENCPU
- R08CPU
- R08ENCPU
- R08PCPU
- R08SFCPU
- R16CPU
- R16ENCPU
- R16PCPU
- R16SFCPU
- R32CPU
- R32ENCPU
- R32PCPU
- R32SFCPU
- R120CPU
- R120ENCPU
- R120PCPU
- R120SFCPU

SAFETY PRECAUTIONS

(Read these precautions before using this product.)

Before using this product, please read this manual and the relevant manuals carefully and pay full attention to safety to handle the product correctly.

The precautions given in this manual are concerned with this product only. For the safety precautions of the programmable controller system, refer to the MELSEC iQ-R Module Configuration Manual.

In this manual, the safety precautions are classified into two levels: "⚠ WARNING" and "⚠ CAUTION".

 WARNING	Indicates that incorrect handling may cause hazardous conditions, resulting in death or severe injury.
 CAUTION	Indicates that incorrect handling may cause hazardous conditions, resulting in minor or moderate injury or property damage.

Under some circumstances, failure to observe the precautions given under "⚠ CAUTION" may lead to serious consequences.

Observe the precautions of both levels because they are important for personal and system safety.

Make sure that the end users read this manual and then keep the manual in a safe place for future reference.

[Design Precautions]

WARNING

- Configure safety circuits external to the programmable controller to ensure that the entire system operates safely even when a fault occurs in the external power supply or the programmable controller. Failure to do so may result in an accident due to an incorrect output or malfunction.
 - (1) Emergency stop circuits, protection circuits, and protective interlock circuits for conflicting operations (such as forward/reverse rotations or upper/lower limit positioning) must be configured external to the programmable controller.
 - (2) When the programmable controller detects an abnormal condition, it stops the operation and all outputs are:
 - Turned off if the overcurrent or overvoltage protection of the power supply module is activated.
 - Held or turned off according to the parameter setting if the self-diagnostic function of the CPU module detects an error such as a watchdog timer error.
 - (3) All outputs may be turned on if an error occurs in a part, such as an I/O control part, where the CPU module cannot detect any error. To ensure safety operation in such a case, provide a safety mechanism or a fail-safe circuit external to the programmable controller. For a fail-safe circuit example, refer to "General Safety Requirements" in the MELSEC iQ-R Module Configuration Manual.
 - (4) Outputs may remain on or off due to a failure of a component such as a relay and transistor in an output circuit. Configure an external circuit for monitoring output signals that could cause a serious accident.
- In an output circuit, when a load current exceeding the rated current or an overcurrent caused by a load short-circuit flows for a long time, it may cause smoke and fire. To prevent this, configure an external safety circuit, such as a fuse.
- Configure a circuit so that the programmable controller is turned on first and then the external power supply. If the external power supply is turned on first, an accident may occur due to an incorrect output or malfunction.
- For the operating status of each station after a communication failure, refer to manuals relevant to the network. Incorrect output or malfunction due to a communication failure may result in an accident.

[Design Precautions]

WARNING

- When connecting an external device with a CPU module or intelligent function module to modify data of a running programmable controller, configure an interlock circuit in the program to ensure that the entire system will always operate safely. For other forms of control (such as program modification, parameter change, forced output, or operating status change) of a running programmable controller, read the relevant manuals carefully and ensure that the operation is safe before proceeding. Improper operation may damage machines or cause accidents.
- Especially, when a remote programmable controller is controlled by an external device, immediate action cannot be taken if a problem occurs in the programmable controller due to a communication failure. To prevent this, configure an interlock circuit in the program, and determine corrective actions to be taken between the external device and CPU module in case of a communication failure.
- Do not write any data to the "system area" and "write-protect area" of the buffer memory in the module. Also, do not use any "use prohibited" signals as an output signal from the CPU module to each module. Doing so may cause malfunction of the programmable controller system. For the "system area", "write-protect area", and the "use prohibited" signals, refer to the user's manual for the module used.
- If a communication cable is disconnected, the network may be unstable, resulting in a communication failure of multiple stations. Configure an interlock circuit in the program to ensure that the entire system will always operate safely even if communications fail. Failure to do so may result in an accident due to an incorrect output or malfunction.
- To maintain the safety of the programmable controller system against unauthorized access from external devices via the network, take appropriate measures. To maintain the safety against unauthorized access via the Internet, take measures such as installing a firewall.

[Precautions for using CC-Link IE Controller Network (when optical fiber cables are used)]

- The optical transmitter and receiver of the CC-Link IE Controller Network module use laser diodes (class 1 in accordance with IEC 60825-1). Do not look directly at a laser beam. Doing so may harm your eyes.
-

[Design Precautions]

CAUTION

- Do not install the control lines or communication cables together with the main circuit lines or power cables. Keep a distance of 100mm or more between them. Failure to do so may result in malfunction due to noise.
 - During control of an inductive load such as a lamp, heater, or solenoid valve, a large current (approximately ten times greater than normal) may flow when the output is turned from off to on. Therefore, use a module that has a sufficient current rating.
 - After the CPU module is powered on or is reset, the time taken to enter the RUN status varies depending on the system configuration, parameter settings, and/or program size. Design circuits so that the entire system will always operate safely, regardless of the time.
 - Do not power off the programmable controller or reset the CPU module while the settings are being written. Doing so will make the data in the flash ROM undefined. The values need to be set in the buffer memory and written to the flash ROM again. Doing so also may cause malfunction or failure of the module.
 - When changing the operating status of the CPU module from external devices (such as the remote RUN/STOP functions), select "Do Not OPEN in Program" for "Open Method Setting" in the module parameters. If "OPEN in Program" is selected, an execution of the remote STOP function causes the communication line to close. Consequently, the CPU module cannot reopen the line, and external devices cannot execute the remote RUN function.
-

[Installation Precautions]

WARNING

- Shut off the external power supply (all phases) used in the system before mounting or removing the module. Failure to do so may result in electric shock or cause the module to fail or malfunction.
-

[Installation Precautions]

CAUTION

- Use the programmable controller in an environment that meets the general specifications in the Safety Guidelines included with the base unit. Failure to do so may result in electric shock, fire, malfunction, or damage to or deterioration of the product.
 - To mount a module, place the concave part(s) located at the bottom onto the guide(s) of the base unit, and push in the module until the hook(s) located at the top snaps into place. Incorrect interconnection may cause malfunction, failure, or drop of the module.
 - When using the programmable controller in an environment of frequent vibrations, fix the module with a screw.
 - Tighten the screws within the specified torque range. Undertightening can cause drop of the screw, short circuit, or malfunction. Overtightening can damage the screw and/or module, resulting in drop, short circuit, or malfunction.
 - When using an extension cable, connect it to the extension cable connector of the base unit securely. Check the connection for looseness. Poor contact may cause malfunction.
 - When using an SD memory card, fully insert it into the SD memory card slot. Check that it is inserted completely. Poor contact may cause malfunction.
 - Securely insert an extended SRAM cassette into the cassette connector of the CPU module. After insertion, close the cassette cover and check that the cassette is inserted completely. Poor contact may cause malfunction.
 - Do not directly touch any conductive parts and electronic components of the module, SD memory card, extended SRAM cassette, or connector. Doing so can cause malfunction or failure of the module.
-

[Wiring Precautions]

WARNING

- Shut off the external power supply (all phases) used in the system before installation and wiring. Failure to do so may result in electric shock or cause the module to fail or malfunction.
 - After installation and wiring, attach the included terminal cover to the module before turning it on for operation. Failure to do so may result in electric shock.
-

[Wiring Precautions]

CAUTION

- Individually ground the FG and LG terminals of the programmable controller with a ground resistance of 100 ohms or less. Failure to do so may result in electric shock or malfunction.
- Use applicable solderless terminals and tighten them within the specified torque range. If any spade solderless terminal is used, it may be disconnected when the terminal screw comes loose, resulting in failure.
- Check the rated voltage and signal layout before wiring to the module, and connect the cables correctly. Connecting a power supply with a different voltage rating or incorrect wiring may cause fire or failure.
- Connectors for external devices must be crimped or pressed with the tool specified by the manufacturer, or must be correctly soldered. Incomplete connections may cause short circuit, fire, or malfunction.
- Securely connect the connector to the module. Poor contact may cause malfunction.
- Do not install the control lines or communication cables together with the main circuit lines or power cables. Keep a distance of 100mm or more between them. Failure to do so may result in malfunction due to noise.
- Place the cables in a duct or clamp them. If not, dangling cable may swing or inadvertently be pulled, resulting in damage to the module or cables or malfunction due to poor contact. Do not clamp the extension cables with the jacket stripped.
- Check the interface type and correctly connect the cable. Incorrect wiring (connecting the cable to an incorrect interface) may cause failure of the module and external device.
- Tighten the terminal screws or connector screws within the specified torque range. Undertightening can cause drop of the screw, short circuit, fire, or malfunction. Overtightening can damage the screw and/or module, resulting in drop, short circuit, fire, or malfunction.
- When disconnecting the cable from the module, do not pull the cable by the cable part. For the cable with connector, hold the connector part of the cable. For the cable connected to the terminal block, loosen the terminal screw. Pulling the cable connected to the module may result in malfunction or damage to the module or cable.
- Prevent foreign matter such as dust or wire chips from entering the module. Such foreign matter can cause a fire, failure, or malfunction.
- A protective film is attached to the top of the module to prevent foreign matter, such as wire chips, from entering the module during wiring. Do not remove the film during wiring. Remove it for heat dissipation before system operation.
- Programmable controllers must be installed in control panels. Connect the main power supply to the power supply module in the control panel through a relay terminal block. Wiring and replacement of a power supply module must be performed by qualified maintenance personnel with knowledge of protection against electric shock. For wiring, refer to the MELSEC iQ-R Module Configuration Manual.
- For Ethernet cables to be used in the system, select the ones that meet the specifications in the user's manual for the module used. If not, normal data transmission is not guaranteed.

[Precautions for using CC-Link IE Controller Network (when optical fiber cables are used)]

- For optical fiber cables to be used in the system, select the ones that meet the specifications in this manual. If not, normal data transmission is not guaranteed.
-

[Startup and Maintenance Precautions]

WARNING

- Do not touch any terminal while power is on. Doing so will cause electric shock or malfunction.
 - Correctly connect the battery connector. Do not charge, disassemble, heat, short-circuit, solder, or throw the battery into the fire. Also, do not expose it to liquid or strong shock. Doing so will cause the battery to produce heat, explode, ignite, or leak, resulting in injury and fire.
 - Shut off the external power supply (all phases) used in the system before cleaning the module or retightening the terminal screws, connector screws, or module fixing screws. Failure to do so may result in electric shock.
-

[Startup and Maintenance Precautions]

CAUTION

- When connecting an external device with a CPU module or intelligent function module to modify data of a running programmable controller, configure an interlock circuit in the program to ensure that the entire system will always operate safely. For other forms of control (such as program modification, parameter change, forced output, or operating status change) of a running programmable controller, read the relevant manuals carefully and ensure that the operation is safe before proceeding. Improper operation may damage machines or cause accidents.
 - Especially, when a remote programmable controller is controlled by an external device, immediate action cannot be taken if a problem occurs in the programmable controller due to a communication failure. To prevent this, configure an interlock circuit in the program, and determine corrective actions to be taken between the external device and CPU module in case of a communication failure.
 - Do not disassemble or modify the modules. Doing so may cause failure, malfunction, injury, or a fire.
 - Use any radio communication device such as a cellular phone or PHS (Personal Handy-phone System) more than 25cm away in all directions from the programmable controller. Failure to do so may cause malfunction.
 - Shut off the external power supply (all phases) used in the system before mounting or removing the module. Failure to do so may cause the module to fail or malfunction.
 - Tighten the screws within the specified torque range. Undertightening can cause drop of the component or wire, short circuit, or malfunction. Overtightening can damage the screw and/or module, resulting in drop, short circuit, or malfunction.
 - After the first use of the product, do not mount/remove the module to/from the base unit, and the terminal block to/from the module, and do not insert/remove the extended SRAM cassette to/from the CPU module more than 50 times (IEC 61131-2 compliant) respectively. Exceeding the limit may cause malfunction.
 - After the first use of the product, do not insert/remove the SD memory card to/from the CPU module more than 500 times. Exceeding the limit may cause malfunction.
 - Do not touch the metal terminals on the back side of the SD memory card. Doing so may cause malfunction or failure of the module.
 - Do not touch the integrated circuits on the circuit board of an extended SRAM cassette. Doing so may cause malfunction or failure of the module.
 - Do not drop or apply shock to the battery to be installed in the module. Doing so may damage the battery, causing the battery fluid to leak inside the battery. If the battery is dropped or any shock is applied to it, dispose of it without using.
-

[Startup and Maintenance Precautions]

CAUTION

- Startup and maintenance of a control panel must be performed by qualified maintenance personnel with knowledge of protection against electric shock. Lock the control panel so that only qualified maintenance personnel can operate it.
 - Before handling the module, touch a conducting object such as a grounded metal to discharge the static electricity from the human body. Failure to do so may cause the module to fail or malfunction.
-

[Operating Precautions]

CAUTION

- When changing data and operating status, and modifying program of the running programmable controller from an external device such as a personal computer connected to an intelligent function module, read relevant manuals carefully and ensure the safety before operation. Incorrect change or modification may cause system malfunction, damage to the machines, or accidents.
 - Do not power off the programmable controller or reset the CPU module while the setting values in the buffer memory are being written to the flash ROM in the module. Doing so will make the data in the flash ROM undefined. The values need to be set in the buffer memory and written to the flash ROM again. Doing so can cause malfunction or failure of the module.
-

[Disposal Precautions]

CAUTION

- When disposing of this product, treat it as industrial waste.
 - When disposing of batteries, separate them from other wastes according to the local regulations. For details on battery regulations in EU member states, refer to the MELSEC iQ-R Module Configuration Manual.
-

[Transportation Precautions]

CAUTION

- When transporting lithium batteries, follow the transportation regulations. For details on the regulated models, refer to the MELSEC iQ-R Module Configuration Manual.
 - The halogens (such as fluorine, chlorine, bromine, and iodine), which are contained in a fumigant used for disinfection and pest control of wood packaging materials, may cause failure of the product. Prevent the entry of fumigant residues into the product or consider other methods (such as heat treatment) instead of fumigation. The disinfection and pest control measures must be applied to unprocessed raw wood.
-

CONDITIONS OF USE FOR THE PRODUCT

- (1) Mitsubishi programmable controller ("the PRODUCT") shall be used in conditions;
- i) where any problem, fault or failure occurring in the PRODUCT, if any, shall not lead to any major or serious accident; and
 - ii) where the backup and fail-safe function are systematically or automatically provided outside of the PRODUCT for the case of any problem, fault or failure occurring in the PRODUCT.
- (2) The PRODUCT has been designed and manufactured for the purpose of being used in general industries. MITSUBISHI SHALL HAVE NO RESPONSIBILITY OR LIABILITY (INCLUDING, BUT NOT LIMITED TO ANY AND ALL RESPONSIBILITY OR LIABILITY BASED ON CONTRACT, WARRANTY, TORT, PRODUCT LIABILITY) FOR ANY INJURY OR DEATH TO PERSONS OR LOSS OR DAMAGE TO PROPERTY CAUSED BY the PRODUCT THAT ARE OPERATED OR USED IN APPLICATION NOT INTENDED OR EXCLUDED BY INSTRUCTIONS, PRECAUTIONS, OR WARNING CONTAINED IN MITSUBISHI'S USER, INSTRUCTION AND/OR SAFETY MANUALS, TECHNICAL BULLETINS AND GUIDELINES FOR the PRODUCT.

("Prohibited Application")

Prohibited Applications include, but not limited to, the use of the PRODUCT in;

- Nuclear Power Plants and any other power plants operated by Power companies, and/or any other cases in which the public could be affected if any problem or fault occurs in the PRODUCT.
- Railway companies or Public service purposes, and/or any other cases in which establishment of a special quality assurance system is required by the Purchaser or End User.
- Aircraft or Aerospace, Medical applications, Train equipment, transport equipment such as Elevator and Escalator, Incineration and Fuel devices, Vehicles, Manned transportation, Equipment for Recreation and Amusement, and Safety devices, handling of Nuclear or Hazardous Materials or Chemicals, Mining and Drilling, and/or other applications where there is a significant risk of injury to the public or property.

Notwithstanding the above, restrictions Mitsubishi may in its sole discretion, authorize use of the PRODUCT in one or more of the Prohibited Applications, provided that the usage of the PRODUCT is limited only for the specific applications agreed to by Mitsubishi and provided further that no special quality assurance or fail-safe, redundant or other safety features which exceed the general specifications of the PRODUCTS are required. For details, please contact the Mitsubishi representative in your region.

INTRODUCTION

Thank you for purchasing the Mitsubishi MELSEC iQ-R series programmable controllers.

This manual describes the procedures, system configuration, and wiring of the relevant products listed below.

Before using this product, please read this manual and the relevant manuals carefully and develop familiarity with the functions and performance of the MELSEC iQ-R series programmable controller to handle the product correctly.

When applying the program examples provided in this manual to an actual system, ensure the applicability and confirm that it will not cause system control problems.

Please make sure that the end users read this manual.

Relevant products

RJ71EN71, CPU module, RJ71GP21-SX, RJ71GF11-T2

COMPLIANCE WITH EMC AND LOW VOLTAGE DIRECTIVES

Method of ensuring compliance

To ensure that Mitsubishi programmable controllers maintain EMC and Low Voltage Directives when incorporated into other machinery or equipment, certain measures may be necessary. Please refer to one of the following manuals.

- MELSEC iQ-R Module Configuration Manual
- Safety Guidelines (This manual is included with the base unit.)

The CE mark on the side of the programmable controller indicates compliance with EMC and Low Voltage Directives.

Additional measures

To ensure that this product maintains EMC and Low Voltage Directives, please refer to one of the following manuals.

- MELSEC iQ-R Module Configuration Manual
- Safety Guidelines (This manual is included with the base unit.)

CONTENTS

SAFETY PRECAUTIONS	1
CONDITIONS OF USE FOR THE PRODUCT	8
INTRODUCTION	8
COMPLIANCE WITH EMC AND LOW VOLTAGE DIRECTIVES	9
RELEVANT MANUALS	12
TERMS	13
CHAPTER 1 PART NAMES	16
1.1 RJ71EN71	16
Available combination of network	17
Network used and LED indication	18
1.2 CPU Module	22
Available combination of network	23
Network used and LED indication	24
1.3 RJ71GP21-SX	25
1.4 RJ71GF11-T2	26
CHAPTER 2 SPECIFICATIONS	28
2.1 Performance Specifications of Ethernet	28
2.2 Performance Specifications of CC-Link IE Controller Network	29
2.3 Performance Specifications of CC-Link IE Field Network	30
2.4 Hardware Specifications	31
CHAPTER 3 FUNCTION LIST	32
3.1 Function List of Ethernet	32
3.2 Function List of CC-Link IE Controller Network	33
3.3 Function List of CC-Link IE Field Network	35
CHAPTER 4 PROCEDURES BEFORE OPERATION	38
CHAPTER 5 SYSTEM CONFIGURATION	40
5.1 Ethernet Configuration	41
5.2 CC-Link IE Controller Network Configuration	42
When optical fiber cables are used	42
When Ethernet cables are used	43
Precautions when Ethernet cables are used	45
5.3 CC-Link IE Field Network Configuration	47
Precautions	50
5.4 Precautions for System Configuration	53
CHAPTER 6 WIRING	54
6.1 Ethernet Wiring	54
6.2 Wiring of CC-Link IE Controller Network	56
For the RJ71GP21-SX	56
For the RJ71EN71 or the RnENCPU (network part)	57
6.3 Wiring of CC-Link IE Field Network	59

CHAPTER 7	COMMUNICATION EXAMPLES	61
7.1	Communication Examples of Ethernet	61
	System configuration example	61
	Sending side	61
	Receiving side	63
	Program example	65
7.2	Communication Examples of CC-Link IE Controller Network	71
	System configuration example	71
	Setting in the control station	72
	Setting in the normal stations	74
	Checking the network status	75
	Program example	76
7.3	Communication Examples of CC-Link IE Field Network	80
	System configuration example	80
	Setting in the master station	81
	Setting in the local station	84
	Checking the network status	86
	Program example	87
APPENDIX		88
Appendix 1	External Dimensions	88
INDEX		90
REVISIONS		92
WARRANTY		93
TRADEMARKS		94

RELEVANT MANUALS

Manual name [manual number]	Description	Available form
MELSEC iQ-R Ethernet/CC-Link IE User's Manual (Startup) [SH-081256ENG] (this manual)	Specifications, procedures before operation, system configuration, wiring, and communication examples of Ethernet, CC-Link IE Controller Network, and CC-Link IE Field Network	Print book e-Manual EPUB PDF
MELSEC iQ-R Ethernet User's Manual (Application) [SH-081257ENG]	Functions, parameter settings, programming, troubleshooting, I/O signals, and buffer memory of Ethernet	Print book e-Manual EPUB PDF
MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application) [SH-081258ENG]	Functions, parameter settings, troubleshooting, and buffer memory of CC-Link IE Controller Network	Print book e-Manual EPUB PDF
MELSEC iQ-R CC-Link IE Field Network User's Manual (Application) [SH-081259ENG]	Functions, parameter settings, programming, troubleshooting, I/O signals, and buffer memory of CC-Link IE Field Network	Print book e-Manual EPUB PDF
MELSEC iQ-R CPU Module User's Manual (Startup) [SH-081263ENG]	Performance specifications, procedures before operation, and troubleshooting of the CPU module	Print book e-Manual EPUB PDF
MELSEC iQ-R Programming Manual (Instructions, Standard Functions/Function Blocks) [SH-081266ENG]	Instructions for the CPU module, link dedicated instructions, socket communications/fixed buffer communications instructions	e-Manual EPUB PDF
SLMP Reference Manual [SH-080956ENG]	The protocol (SLMP) used for data reading or writing from an external device to the Ethernet-equipped module.	Print book e-Manual EPUB PDF
iQ Sensor Solution Reference Manual [SH-081133ENG]	Operating methods of iQ Sensor Solution, such as programming and monitoring	Print book e-Manual EPUB PDF

This manual does not include detailed information on the following:

- General specifications
- Applicable CPU modules and the number of mountable modules
- Installation

For details, refer to the following.

 MELSEC iQ-R Module Configuration Manual

This manual does not include information on the module function blocks.

For details, refer to the Function Block Reference for the module used.

Point

e-Manual refers to the Mitsubishi FA electronic book manuals that can be browsed using a dedicated tool.

e-Manual has the following features:

- Required information can be cross-searched in multiple manuals.
- Other manuals can be accessed from the links in the manual.
- The hardware specifications of each part can be found from the product figures.
- Pages that users often browse can be bookmarked.

TERMS

Unless otherwise specified, this manual uses the following terms.

Term	Description
Baton pass	A token to send data over a network of CC-Link IE
Buffer memory	A memory in an intelligent function module, where data (such as setting values and monitoring values) are stored. When using the CPU module, the memory is indicated for storing data (such as setting values and monitored values) of the Ethernet function and data used for data communication of the multiple CPU function.
CC-Link IE	A generic term for CC-Link IE Controller Network and CC-Link IE Field Network
CC-Link IE Controller Network-equipped module	A generic term for the following modules when the CC-Link IE Controller Network function is used: • RJ71GP21-SX • RJ71EN71 • RnENCPU
CC-Link IE Field Network-equipped master/local module	A generic term for the following modules when the CC-Link IE Field Network function is used: • RJ71GF11-T2 • RJ71EN71 • RnENCPU
CC-Link IE module	A generic term for the CC-Link IE Controller Network-equipped module and CC-Link IE Field Network-equipped master/local module
Control CPU	A CPU module that controls connected I/O modules and intelligent function modules. In a multiple CPU system, there are multiple CPU modules and each connected module can be controlled by a different CPU module.
Control station	A station that controls the entire network on CC-Link IE Controller Network. This station can perform cyclic transmission and transient transmission with all stations. Only one master station can be used in a network.
CPU module	A generic term for the MELSEC iQ-R series CPU module
CPU module (built-in Ethernet port part)	A built-in Ethernet port part of the CPU module (CPU part for the RnENCPU) ( Page 22 CPU Module)
Cyclic transmission	A function by which data are periodically exchanged among stations on the same network using link devices on CC-Link IE
Data link	A generic term for cyclic transmission and transient transmission
Dedicated instruction	An instruction for using functions of the module
Device	A device (X, Y, M, D, or others) in a CPU module
Device supporting iQSS	A generic term for a device which supports iQ Sensor Solution For details on iQ Sensor Solution, refer to the following.  iQ Sensor Solution Reference Manual
Disconnection	A process of stopping data link if a data link error occurs
Engineering tool	Another term for the software package for the MELSEC programmable controllers
Ethernet adapter module	The abbreviation for the NZ2GF-ETB CC-Link IE Field Network Ethernet adapter module
Ethernet device	A generic term for the devices supporting IP communication (such as personal computers)
Ethernet-equipped module	A generic term for the following modules when the Ethernet function is used • RJ71EN71 • CPU module
External device	A generic term for personal computers connected with Ethernet for data communication and other Ethernet-equipped modules
FTP	The abbreviation for File Transfer Protocol. This protocol is used to transfer data files over a network.
Global label	A label that is enabled for all program data when creating multiple program data in the project. There are two types of global labels: module label that is automatically generated by GX Works3 and label that can be created for the any of the specified devices.
Head module	The abbreviation for the LJ72GF15-T2 CC-Link IE Field Network head module
I/O master station	A station that controls the communications using link devices on CC-Link IE Controller Network. Up to two I/O master stations can be set for one network (block 1 and block 2), regardless of the status of control or normal station.
Intelligent device station	A station that exchanges I/O signals (bit data) and I/O data (word data) with CC-Link IE Field Network by cyclic transmission. This station responds to a transient transmission request from another station and also issues a transient transmission request to another station.
Intelligent function module	A module that has functions other than input and output, such as an A/D converter module and D/A converter module
Label	A label that represents a device in a given character string


Term	Description
Link device	A device in a module on CC-Link IE
Link refresh	Automatic data transfer between a link device in a module on CC-Link IE and a device in a CPU module. Link refresh is performed in the END processing of the CPU module's sequence scan.
Link register (LW)	Word data send from each station on CC-Link IE Controller Network
Link relay (LB)	Bit data send from each station on CC-Link IE Controller Network
Link scan (link scan time)	Time required for all the stations on the network of CC-Link IE to transmit data. The link scan time depends on data volume and the number of transient transmission requests.
Link special register (SW)	Word data that indicates the operating status and data link status of a module on CC-Link IE
Link special relay (SB)	Bit data that indicates the operating status and data link status of a module on CC-Link IE
Local station	A station that performs cyclic transmission and transient transmission with the master station and other local stations on CC-Link IE Field Network.
Master operating station	A station that controls the entire network when the submaster function of CC-Link IE Field Network is used. Only one master station can be used in a network.
Master station	A station that controls the entire network on CC-Link IE Field Network. This station can perform cyclic transmission and transient transmission with all stations. Only one master station can be used in a network.
MELSECNET/10	The abbreviation for the MELSECNET/10 network system
MELSECNET/H	The abbreviation for the MELSECNET/H network system
Module label	A label that represents one of memory areas (I/O signals and buffer memory areas) specific to each module in a given character string. For the module used, GX Works3 automatically generates this label, which can be used as a global label.
Network module	A generic term for the following modules: • Ethernet interface module • CC-Link IE Controller Network module • Module on CC-Link IE Field Network • MELSECNET/H network module • MELSECNET/10 network module • RnENCPU (network part)
Normal station	A station that performs cyclic transmission and transient transmission with the control station and other normal stations on CC-Link IE Controller Network
Predefined protocol support function	A function of GX Works3. This function sets protocols appropriate to each external device and reads/writes protocol setting data.
RAS	The abbreviation for Reliability, Availability, and Serviceability. This term refers to usability of automated equipment.
Relay station	A station that includes two or more network modules. Transient transmission is performed through this station to stations on other networks
Remote device station	A station that exchanges I/O signals (bit data) and I/O data (word data) with CC-Link IE Field Network by cyclic transmission. This station responds to a transient transmission request from another station.
Remote I/O station	A station that exchanges I/O signals (bit data) with the master station of CC-Link IE Field Network by cyclic transmission
Remote input (RX)	Bit data input from a slave station to the master station of CC-Link IE Field Network (For some areas in a local station, data are output in the opposite direction.)
Remote output (RY)	Bit data output from the master station to a slave station of CC-Link IE Field Network (For some areas in a local station, data are output in the opposite direction.)
Remote register (RWr)	Word data input from a slave station to the master station of CC-Link IE Field Network (For some areas in a local station, data are output in the opposite direction.)
Remote register (RWw)	Word data output from the master station to a slave station of CC-Link IE Field Network (For some areas in a local station, data are output in the opposite direction.)
Reserved station	A station reserved for future use. This station is not actually connected on CC-Link IE, but counted as a connected station
Return	A process of restarting data link when a station recovers from an error
RnENCPU	A generic term for the R04ENCPU, R08ENCPU, R16ENCPU, R32ENCPU, and R120ENCPU
RnENCPU (CPU part)	The left side (CPU part) of the RnENCPU ( Page 22 CPU Module)
RnENCPU (network part)	The right side (network part) of the RnENCPU ( Page 22 CPU Module)
Routing	A process of selecting paths for communication with other networks. There are two types of routing: dynamic routing that auto-selects the communication routes, and static routing where communication routes are arbitrarily set.
Safety CPU	A generic term for the R08SFPCPU, R16SFPCPU, R32SFPCPU, and R120SFPCPU

Term	Description
Shared group number	Number that is assigned to a station to allow it to share cyclic data with any given stations on CC-Link IE Controller Network. Cyclic data can be shared only with stations of the same group.
Slave station	A generic term for a local station, remote I/O station, remote device station, and intelligent device station of CC-Link IE Field Network
Submaster operating station	A station that monitors a master operating station when the submaster function of CC-Link IE Field Network is used. Only one master station can be used in a network.
Submaster station	A station that serves as a master station to control the entire network if the master station of CC-Link IE Field Network is disconnected. Only one master station can be used in a network.
Subnet mask	A number used to logically divide one network into multiple subnetworks and manage them easily. The following Ethernet network systems can be configured: • A small-scale Ethernet network system in which multiple network devices are connected • A medium- or large-scale network system in which multiple small-scale network systems are connected via routers or other network communication devices
Transient transmission	A function of communication with another station, which is used when requested by a dedicated instruction or the engineering tool
Transient transmission group number	Number that is assigned for transient transmission to any given stations on Ethernet and CC-Link IE Controller Network. By specifying a group of stations as transient transmission target, data can be sent to the stations of the same group number.

1 PART NAMES

1.1 RJ71EN71

This section describes the names of each part of the RJ71EN71.

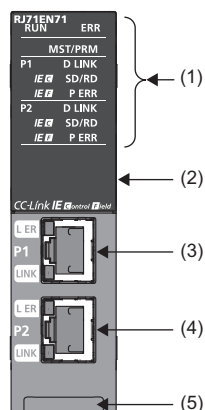

No.	Name	Description
(1)	Operation status indicator LED	Indicates the operating status of the module. (Page 18 Network used and LED indication)
(2)	Dot matrix LED	Displays the station number set in the module and the module communication test result. (Page 21 Dot matrix LED display) For display of the module communication test result, refer to the following. MELSEC iQ-R Ethernet User's Manual (Application)
(3)	Ethernet port (P1)	PORT1 connector for network. Connect an Ethernet cable. For wiring methods and wiring precautions, refer to the following. (Page 54 WIRING)
	L ER LED	Indicates the port status. (Page 18 Network used and LED indication)
	LINK LED	Indicates the link status. (Page 18 Network used and LED indication)
(4)	Ethernet port (P2)	PORT2 connector for network. Connect an Ethernet cable. For wiring methods and wiring precautions, refer to the following. (Page 54 WIRING)
	L ER LED	Same as the P1 connector
	LINK LED	
(5)	Production information marking	Shows the product information (16 digits) of the module.

Available combination of network

Ethernet port (P1 and P2) of the RJ71EN71 can be used in the following network depending on the engineering tool setting.
( GX Works3 Operating Manual)

- Ethernet
- CC-Link IE Controller Network
- CC-Link IE Field Network
- Q-compatible Ethernet

The following table lists the available combination of network and setting in GX Works3.

Network combination	Setting in GX Works3			Description	Remarks
	Model ^{*1}	Port 1 network type	Port 2 network type		
Ethernet only	RJ71EN71 (E+E)	Ethernet	Ethernet	Different network between P1 and P2 can be connected to Ethernet.	—
CC-Link IE Controller Network only	RJ71EN71 (CCIEC)	CC-Link IE Control	CC-Link IE Control	P1 and P2 can be connected to CC-Link IE Controller Network	P1 and P2 cannot be connected to different CC-Link IE Controller Network.
CC-Link IE Field Network only	RJ71EN71 (CCIEF)	CC-Link IE Field	CC-Link IE Field	P1 and P2 can be connected to CC-Link IE Field Network	P1 and P2 cannot be connected to different CC-Link IE Field Network.
Ethernet + CC-Link IE Controller Network	RJ71EN71 (E+CCIEC)	Ethernet	CC-Link IE Control	P1 can be connected to Ethernet and P2 can be connected to CC-Link IE Controller Network.	CC-Link IE Controller Network cannot be configured in ring topology.
Ethernet + CC-Link IE Field Network	RJ71EN71 (E+CCIEF)	Ethernet	CC-Link IE Field	P1 can be connected to Ethernet and P2 can be connected to CC-Link IE Field Network.	CC-Link IE Field Network cannot be configured in ring topology.
Q-compatible Ethernet	RJ71EN71 (Q)	Q-compatible Ethernet	—	A setting for replacement from the MELSEC-Q series Ethernet interface module RJ71EN71 can be connected to Ethernet without changing I/O signal and buffer memory from the MELSEC-Q series Ethernet interface module.	• Some parameters cannot be set. • P2 cannot be used.

*1 The name in parentheses is the abbreviation of the network type.

Network used and LED indication

LED indication of the RJ71EN71 differs depending on the network used.
The following table lists the LED indication when each network is used.

When Ethernet or Q-compatible Ethernet is used

LED name	Description
RUN LED	Indicates the operating status. On: Normal operation Off: Error (MELSEC iQ-R Ethernet User's Manual (Application))
ERR LED ^{*1}	Indicates the error status of the module. On, flashing: Error (MELSEC iQ-R Ethernet User's Manual (Application)) Off: Normal operation
MST/PRM LED ^{*1}	Indicates the operating status of CC-Link IE Controller Network when P2 is used in CC-Link IE Controller Network. (MST/PRM LED is always off when CC-Link IE Controller Network is not used) For the LED indication when CC-Link IE Controller Network is used, refer to the following. ☞ Page 19 When CC-Link IE Controller Network is used
	Indicates the operating status of CC-Link IE Field Network when P2 is used in CC-Link IE Field Network. (MST/PRM LED is always off when CC-Link IE Field Network is not used) For the LED indication when CC-Link IE Field Network is used, refer to the following. ☞ Page 20 When CC-Link IE Field Network is used
D LINK LED ^{*1}	Indicates the data link status of P2 when P2 is used in CC-Link IE Controller Network. (D LINK LED of P1 is always off) For the LED indication when CC-Link IE Controller Network is used, refer to the following. ☞ Page 19 When CC-Link IE Controller Network is used
	Indicates the data link status of P2 when P2 is used in CC-Link IE Field Network. (D LINK LED of P1 is always off) For the LED indication when CC-Link IE Field Network is used, refer to the following. ☞ Page 20 When CC-Link IE Field Network is used
SD/RD LED	Indicates the data sending/receiving status. On: Data being sent or received Off: Data not sent nor received
P ERR LED ^{*1}	Indicates the error status of P1 and P2. On, flashing: Error (MELSEC iQ-R Ethernet User's Manual (Application)) Off: Normal operation
IE C LED ^{*1*2}	Indicates the network type setting status when P2 is used in CC-Link IE Controller Network. (IE C LED of P1 is always off.) For the LED indication when CC-Link IE Controller Network is used, refer to the following. ☞ Page 19 When CC-Link IE Controller Network is used
IE F LED ^{*1}	Indicates the network type setting status when P2 is used in CC-Link IE Field Network. (IE F LED of P1 is always off.) For the LED indication when CC-Link IE Field Network is used, refer to the following. ☞ Page 20 When CC-Link IE Field Network is used
L ER LED	Indicates the port status when P2 is used in CC-Link IE Controller Network. (L ER LED of P1 is always off) For the LED indication when CC-Link IE Controller Network is used, refer to the following. ☞ Page 19 When CC-Link IE Controller Network is used
	Indicates the port status when P2 is used in CC-Link IE Field Network. (L ER LED of P1 is always off) For the LED indication when CC-Link IE Field Network is used, refer to the following. ☞ Page 20 When CC-Link IE Field Network is used
LINK LED	Indicates the link status. On (green): Link-up (1Gbps) On (yellow): Link-up (100Mbps) Off: Link-down, link-up (10Mbps)

*1 The LED is always off in offline mode.

*2 LED indication differs depending on the version of the RJ71EN71.

(MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application))

When CC-Link IE Controller Network is used

LED name	Description
RUN LED	Indicates the operating status. On: Normal operation Off: Error (MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application))
ERR LED ^{*1}	Indicates the error status of the module. On, flashing: Error (MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application)) Off: Normal operation
MST/PRM LED ^{*1}	Indicates the operating status. On: Operating as a control station Off: Operating as a normal station
D LINK LED ^{*1}	Indicates the data link status. On: Data link (cyclic transmission being performed) Flashing: Data link (cyclic transmission stopped) Off: Data link not performed (disconnection)
SD/RD LED	Indicates the data sending/receiving status. On: Data being sent or received (The LED turns on only at the P1 side when setting "Port 1 Network Type" to "CC-Link IE Control" and "Network Topology" under "Basic Settings" of the control station to "Ring".) Off: Data not sent nor received
P ERR LED ^{*1}	Indicates the error status of P1 and P2. On, flashing: Error (MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application)) Off: Normal operation
IE C LED ^{*2}	Indicates the network type setting status. Always on
IE F LED	Indicates the network type setting status. Always off
L ER LED	Indicates the port status. On: Abnormal data received or loopback being performed Off: Normal data received and loopback not performed
LINK LED	Indicates the link status. On: Link-up Off: Link-down

*1 The LED is always off in offline mode.

*2 LED indication differs depending on the version of the RJ71EN71.
(MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application))

When CC-Link IE Field Network is used

LED name	Description
RUN LED	Indicates the operating status. On: Normal operation Off: Error (MELSEC iQ-R CC-Link IE Field Network User's Manual (Application))
ERR LED ^{*1}	Indicates the error status of the module. On, flashing: Error (MELSEC iQ-R CC-Link IE Field Network User's Manual (Application)) Off: Normal operation
MST/PRM LED	Indicates the operating status. On: Operating as a master station Flashing: Operating as a submaster station Off: Operating as a local station
D LINK LED ^{*1}	Indicates the data link status. On: Data link (cyclic transmission being performed) Flashing: Data link (cyclic transmission stopped) Off: Data link not performed (disconnection)
SD/RD LED	Indicates the data sending/receiving status. On: Data being sent or received (The LED turns on only at the P1 side when setting "Port 1 Network Type" to "CC-Link IE Field" and "Network Topology" under "Basic Settings" of the master station to "Ring".) Off: Data not sent nor received
P ERR LED ^{*1}	Indicates the error status of P1 and P2. On: Error or at error detection on all stations (MELSEC iQ-R CC-Link IE Field Network User's Manual (Application)) Flashing (500ms interval): A data link faulty station was detected. Flashing (200ms interval): Error (MELSEC iQ-R CC-Link IE Field Network User's Manual (Application)) Off: Normal operation
IE C LED ^{*2}	Indicates the network type setting status. Always off
IE F LED	Indicates the network type setting status. Always on
L ER LED	Indicates the port status. On: Abnormal data received or loopback being performed Off: Normal data received and loopback not performed
LINK LED	Indicates the link status. On: Link-up Off: Link-down

*1 The LED is always off in offline mode.

*2 LED indication differs depending on the version of the RJ71EN71.
(MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application))

Dot matrix LED display

The following table lists the station number displayed on Dot matrix LED.


Network combination	Setting in GX Works3			Display
	Model ^{*1}	Port 1 network type	Port 2 network type	
Ethernet only	RJ71EN71 (E+E)	Ethernet	Ethernet	Always off
CC-Link IE Controller Network only	RJ71EN71 (CCIEC)	CC-Link IE Control	CC-Link IE Control	Displays the current station number of CC-Link IE Controller Network. Station number not set: "— — —" Control station, normal station: 1 to 120
CC-Link IE Field Network only	RJ71EN71 (CCIEF)	CC-Link IE Field	CC-Link IE Field	Displays the current station number of CC-Link IE Field Network. Station number not set: "— — —" Master station: 0 Submaster station, local station: 1 to 120
Ethernet + CC-Link IE Controller Network	RJ71EN71 (E+CCIEC)	Ethernet	CC-Link IE Control	Displays the current station number of CC-Link IE Controller Network. Station number not set: "— — —" Control station, normal station: 1 to 120
Ethernet + CC-Link IE Field Network	RJ71EN71 (E+CCIEF)	Ethernet	CC-Link IE Field	Displays the current station number of CC-Link IE Field Network. Station number not set: "— — —" Master station: 0 Submaster station, local station: 1 to 120
Q-compatible Ethernet	RJ71EN71 (Q)	Q-compatible Ethernet	—	Always off
In offline mode				Displays "... " in offline mode.
At major error				Undefined

*1 The name in parentheses is the abbreviation of the network type.

1.2 CPU Module

This section describes the part names of the CPU module related to the Ethernet function. For other names of each part, refer to the following.

 MELSEC iQ-R CPU Module User's Manual (Startup)

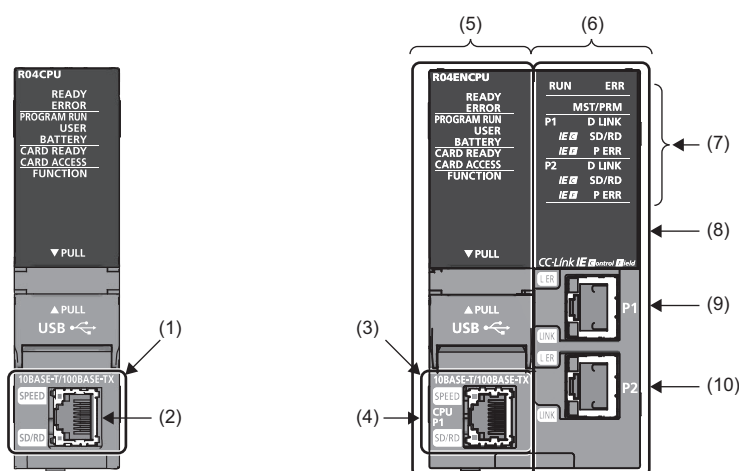

No.	Name	Description
(1)	Built-in Ethernet port part	A part to connect the CPU module to Ethernet
(2)	Ethernet port	A connector to connect the CPU module to the 10BASE-T/100BASE-TX (RJ45 connector) The CPU module determines whether to use 10BASE-T or 100BASE-TX according to the hub.
	SPEED LED	Indicates the link status. On: Link-up (100Mbps) Off: Link-down or link-up (10Mbps)
	SD/RD LED	Indicates the data sending/receiving status. On: Data being sent or received Off: Data not sent nor received
(3)	Built-in Ethernet port part	A part to connect the CPU module to Ethernet
(4)	Ethernet port (CPU P1)	A connector to connect the CPU module to the 10BASE-T/100BASE-TX (RJ45 connector) The CPU module determines whether to use 10BASE-T or 100BASE-TX according to the hub.
	SPEED LED	Indicates the link status. On: Link-up (100Mbps) Off: Link-down or link-up (10Mbps)
	SD/RD LED	Indicates the data sending/receiving status. On: Data being sent or received Off: Data not sent nor received
(5)	CPU part	A part that works as the CPU module
(6)	Network part	A part that has the functions of Ethernet, CC-Link IE Controller Network, and CC-Link IE Field Network.
(7)	Operation status indicator LED	Indicates the operating status of the module. ( Page 24 Network used and LED indication)
(8)	Dot matrix LED	Displays the station number set in the module and the module communication test result. ( Page 24 Dot matrix LED display) For display of the module communication test result, refer to the following.  MELSEC iQ-R Ethernet User's Manual (Application)
(9)	Ethernet port (P1)	PORT1 connector for network. Connect an Ethernet cable. For wiring methods and wiring precautions, refer to the following. ( Page 54 WIRING)
	L ER LED	Indicates the port status. ( Page 24 Network used and LED indication)
	LINK LED	Indicates the link status. ( Page 24 Network used and LED indication)
(10)	Ethernet port (P2)	PORT2 connector for network. Connect an Ethernet cable. For wiring methods and wiring precautions, refer to the following. ( Page 54 WIRING)
	L ER LED	Same as the P1 connector
	LINK LED	

Available combination of network

Ethernet port (P1 and P2) of the RnENCPU can be used in the following network depending on the engineering tool setting.
( GX Works3 Operating Manual)

- Ethernet
- CC-Link IE Controller Network
- CC-Link IE Field Network

The following table lists the available combination of network and setting in GX Works3.

Network combination	Setting in GX Works3			Description	Remarks
	Model ^{*1}	Port 1 network type	Port 2 network type		
CC-Link IE Controller Network only	_RJ71EN71 (CCIEC)	CC-Link IE Control	CC-Link IE Control	P1 and P2 can be connected to CC-Link IE Controller Network	P1 and P2 cannot be connected to different CC-Link IE Controller Network.
CC-Link IE Field Network only	_RJ71EN71 (CCIEF)	CC-Link IE Field	CC-Link IE Field	P1 and P2 can be connected to CC-Link IE Field Network	P1 and P2 cannot be connected to different CC-Link IE Field Network.
Ethernet + CC-Link IE Controller Network	_RJ71EN71 (E+IEC)	Ethernet	CC-Link IE Control	P1 can be connected to Ethernet and P2 can be connected to CC-Link IE Controller Network.	CC-Link IE Controller Network cannot be configured in ring topology.
Ethernet + CC-Link IE Field Network	_RJ71EN71 (E+IEF)	Ethernet	CC-Link IE Field	P1 can be connected to Ethernet and P2 can be connected to CC-Link IE Field Network.	CC-Link IE Field Network cannot be configured in ring topology.

^{*1} The name in parentheses is the abbreviation of the network type.

Precautions

The following item cannot be set for the RnENCPU.

- Ethernet only (Port 1 network type: Ethernet, Port 2 network type: Ethernet)
- Q-compatible Ethernet

Network used and LED indication

LED indication of the RnENCPU differs depending on the network used. For the LED indication when each network is used, refer to the following.

- When Ethernet is used:  Page 18 When Ethernet or Q-compatible Ethernet is used
- When CC-Link IE Controller Network is used:  Page 19 When CC-Link IE Controller Network is used
- When CC-Link IE Field Network is used:  Page 20 When CC-Link IE Field Network is used

Dot matrix LED display


The following table lists the station number displayed on dot matrix LED.

Network combination	Setting in GX Works3			Display
	Model*1	Port 1 network type	Port 2 network type	
CC-Link IE Controller Network only	_RJ71EN71 (CCIEC)	CC-Link IE Control	CC-Link IE Control	Displays the current station number of CC-Link IE Controller Network. Station number not set: "— — —" Control station, normal station: 1 to 120
CC-Link IE Field Network only	_RJ71EN71 (CCIEF)	CC-Link IE Field	CC-Link IE Field	Displays the current station number of CC-Link IE Field Network. Station number not set: "— — —" Master station: 0 Submaster station, local station: 1 to 120
Ethernet + CC-Link IE Controller Network	_RJ71EN71 (E+IEC)	Ethernet	CC-Link IE Control	Displays the current station number of CC-Link IE Controller Network. Station number not set: "— — —" Control station, normal station: 1 to 120
Ethernet + CC-Link IE Field Network	_RJ71EN71 (E+IEF)	Ethernet	CC-Link IE Field	Displays the current station number of CC-Link IE Field Network. Station number not set: "— — —" Master station: 0 Submaster station, local station: 1 to 120
In offline mode				Displays "...". in offline mode.
At major error				Undefined

*1 The name in parentheses is the abbreviation of the network type.

1.3 RJ71GP21-SX

This section describes the names of each part of the RJ71GP21-SX.

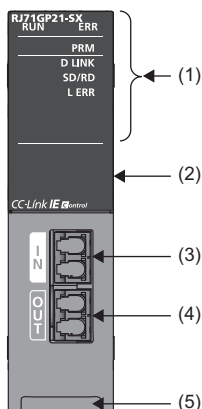

No.	Name	Description
(1)	RUN LED	Indicates the operating status. On: Normal operation Off: Error (MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application))
	ERR LED ^{*1}	Indicates the error status of the module. On, flashing: Error (MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application)) Off: Normal operation
	PRM LED ^{*1}	Indicates the operating status. On: Operating as a control station Off: Operating as a normal station
	D LINK LED ^{*1}	Indicates the data link status. On: Data link (cyclic transmission being performed) Flashing: Data link (cyclic transmission stopped) Off: Data link not performed (disconnection)
	SD/RD LED	Indicates the data sending/receiving status. On: Data being sent or received Off: Data not sent nor received
	L ERR LED ^{*1}	Indicates the line error status. On: The following errors has occurred in the line connected to the own station port. - A receive data is faulty (receive frame error).^{*2} - Loopback is performed in the own station. - Cable disconnection - Cable insertion error Off: The module or line is in the following status. - A received data is normal (receive frame normal) - Loopback is not performed in the own station.
(2)	Dot matrix LED	Displays the station number set in the module and the module communication test result. Station number not set: "— — —" Control station, normal station: 1 to 120 In offline mode.: "..." For display of the module communication test result, refer to the following. (MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application))
(3)	Optical connector (IN connector)	A connector to connect the optical fiber cable. Connect to OUT connector of another station.
(4)	Optical connector (OUT connector)	A connector to connect the optical fiber cable. Connect to IN connector of another station.
(5)	Production information marking	Shows the product information (16 digits) of the module.

^{*1} The LED is always off in offline mode.


^{*2} When once a receive frame error is detected, the L ERR LED remains off. ('IN-side error frame detection of own station (SB006E)') or 'OUT-side error frame detection of own station (SB006F)' also remains off.)

To turn off the L ERR LED, perform troubleshooting for when the L ERR LED turns on. (MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application))

After taking the action, turn on 'Clear IN-side transmission error count (SB0007)' or 'Clear OUT-side transmission error count (SB0008)'.

1.4 RJ71GF11-T2

This section describes the names of each part of the RJ71GF11-T2.

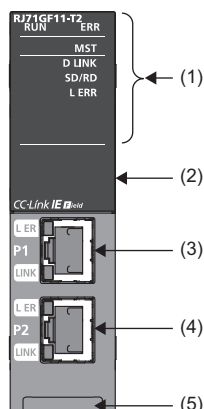

No.	Name	Description
(1)	RUN LED	Indicates the operating status. On: Normal operation Off: Error (MELSEC iQ-R CC-Link IE Field Network User's Manual (Application))
	ERR LED*1	Indicates the error status of the module. On: Error or at error detection on all stations (MELSEC iQ-R CC-Link IE Field Network User's Manual (Application)) Flashing (500ms interval): A data link faulty station was detected. Flashing (200ms interval): Error (MELSEC iQ-R CC-Link IE Field Network User's Manual (Application)) Off: Normal operation
	MST LED	Indicates the operating status. On: Operating as a master station Flashing: Operating as a submaster station Off: Operating as a local station
	D LINK LED*1	Indicates the data link status. On: Data link (cyclic transmission being performed) Flashing: Data link (cyclic transmission stopped) Off: Data link not performed (disconnection)
	SD/RD LED	Indicates the data sending/receiving status. On: Data being sent or received Off: Data not sent nor received
	L ERR LED*1	Indicates the receive data and line error status. When the L ERR. LED is on, the port in which the error was detected can be checked with the L ER LED of P1 or P2. On: Abnormal data received or loopback being performed Off: Normal data received and loopback not performed
(2)	Dot matrix LED	Displays the station number set in the module and the module communication test result. Station number not set: "— — —" Master station: 0 Submaster station, local station: 1 to 120 In offline mode.: "..." For display of the module communication test result, refer to the following. (MELSEC iQ-R CC-Link IE Field Network User's Manual (Application))
(3)	Ethernet port (P1)	PORT1 connector for CC-Link IE Field Network Connect an Ethernet cable. For wiring methods and wiring precautions, refer to the following. (Page 59 Wiring of CC-Link IE Field Network)
	L ER LED	Indicates the port status. On: Abnormal data received or loopback being performed Off: Normal data received and loopback not performed
	LINK LED	Indicates the link status. On: Link-up Off: Link-down
(4)	Ethernet port (P2)	PORT2 connector for CC-Link IE Field Network Connect an Ethernet cable. For wiring methods and wiring precautions, refer to the following. (Page 59 Wiring of CC-Link IE Field Network)
	L ER LED	Same as the P1 connector
	LINK LED	Same as the P1 connector

No.	Name	Description
(5)	Production information marking	Shows the product information (16 digits) of the module.

*1 The LED is always off in offline mode.

2 SPECIFICATIONS

This chapter describes the performance specifications and hardware specifications of each module.

2.1 Performance Specifications of Ethernet

The following table lists the performance specifications of Ethernet.

Item			RJ71EN71		CPU module		
			Ethernet	Q-compatible Ethernet	Built-in Ethernet port part	RnENCPU (CPU part)	RnENCPU (network part)
Transmission specifications	Data transmission speed		1Gbps/100Mbps/10Mbps	1Gbps ^{*1} /100Mbps/10Mbps	100Mbps/10Mbps		1Gbps/100Mbps/10Mbps
	Communication mode	1000BASE-T	Full-duplex	—			Full-duplex
		100BASE-TX	Full-duplex/half-duplex				
		10BASE-T	Full-duplex/half-duplex				
	Interface		RJ45 connector (Auto MDI/MDI-X)				
	Transmission method		Base band				
	Maximum frame size		• 1518 bytes • 9022 bytes (when jumbo frames are used)	1518 bytes		• 1518 bytes • 9022 bytes (when jumbo frames are used)	
	Jumbo frame		Available	Not available		Available	
	Maximum segment length		100m (length between hub and node) ^{*2}				
	Number of cascade connections	1000BASE-T	^{*3}		—		^{*3}
100BASE-TX		2 levels maximum ^{*4}					
10BASE-T		4 levels maximum ^{*4}					
IP version			Compatible with IPv4				
Sending/receiving data storage memory	Number of simultaneous open connections		128 connections (connections usable on a program)	16 connections (connections usable on a program)		64 connections (connections usable on a program)	
	Fixed buffer		5K words × 16	1K words × 16	—		5K words × 16
	Socket communications		• 5K words × 48 (when only P1 is used) • 5K words × 112 (when P1 and P2 are used)	—	5K words × 16		5K words × 48
	Random access buffer		6K words × 1		—		6K words × 1

^{*1} When using 1Gbps, set "Communication Speed" under "Application Settings" to "Automatic Negotiation". ("1Gbps" cannot be selected.)

^{*2} For maximum segment length (length between hubs), consult the manufacturer of the hub used.

^{*3} Consult the manufacturer of the switching hub used.

^{*4} This applies when a repeater hub is used. For the number of levels that can be constructed when using a switching hub, consult the manufacturer of the switching hub used.

Point

The operation of commercial devices used for the following applications is not guaranteed. Check the operation before using the module.

- Internet (general public line) (Internet-access service offered by an Internet service provider or a telecommunications carrier)
- Firewall device(s)
- Broadband router(s)
- Wireless LAN

2.2 Performance Specifications of CC-Link IE Controller Network

The following table lists the performance specifications of CC-Link IE Controller Network.

Item		RJ71GP21-SX	RJ71EN71, RnENCPU (network part)
Maximum number of link points per network	LB	32K points (32768 points, 4K bytes)	
	LW	128K points (131072 points, 256K bytes)	
	LX	8K points (8192 points, 1K bytes)	
	LY	8K points (8192 points, 1K bytes)	
Maximum number of link points per station	LB	16K points (16384 points, 2K bytes), extended mode: 32K points (32768 points, 4K bytes)	
	LW	16K points (16384 points, 32K bytes), extended mode: 128K points (131072 points, 256K bytes)	
	LX	8K points (8192 points, 1K bytes)	
	LY	8K points (8192 points, 1K bytes)	
Transient transmission capacity		1920 bytes maximum	
Communication speed		1Gbps	
Network topology		Duplex loop	Line topology, star topology (coexistence of line topology and star topology is also possible), and ring topology
Communication cable		Optical fiber cable which satisfies 1000BASE-SX standard: Multi-mode optical fiber (GI)	Ethernet cable which satisfies 1000BASE-T standard: Category 5e or higher, straight cable (double shielded, STP)
Maximum station-to-station distance		550m (when the outside diameter of the core is 50 μ m) 275m (when the outside diameter of the core is 62.5 μ m)	100m (conforms to ANSI/TIA/EIA-568-B (Category 5e))
Overall cable distance		66000m (when 120 stations are connected and the outside diameter of the core is 50 μ m) 33000m (when 120 stations are connected and the outside diameter of the core is 62.5 μ m)	Line topology: 11900m (when 120 stations are connected) Star topology: Depends on the system configuration. Ring topology: 12000m (when 120 stations are connected)
Number of cascade connections		—	20 levels maximum
Maximum number of connectable stations		120 stations (control station: 1, normal station: 119)*1	
Maximum number of networks		239	
Maximum number of groups		32	
Communication method		Token ring	Token passing
Optical fiber specifications		Standard: IEEE802.3, IEC 60793-2-10 Types A1a.1 Outside diameter of the core/clad: 50 μ m, 62.5 μ m/ 125 μ m Transmission loss: 3.0dB/km or lower [λ =850nm] Transmission band: 500MHz·km or higher (λ =850nm)	—
Connector specifications		Duplex LC connector Standard: IEC 61754-20 Type LC connector Connection loss: 0.3dB or lower Polished surface: PC (Physical Contact) polishing	RJ45 connector
Laser class (IEC60825-1)		Class 1 laser product	—

*1 When using a CC-Link IE Controller Network-equipped module in a normal station, maximum number of connectable stations differs depending on the CPU module used in a control station. For details, refer to the user's manual for the control station used.

2.3 Performance Specifications of CC-Link IE Field Network

The following table lists the performance specifications of CC-Link IE Field Network.

Item			RJ71GF11-T2	RJ71EN71, RnENCPU (network part)
Maximum number of link points per network			RX	16K points (16384 points, 2K bytes)
			RY	16K points (16384 points, 2K bytes)
			RWr	8K points (8192 points, 16K bytes)
			RWw	8K points (8192 points, 16K bytes)
Maximum number of link points per station	Master station		RX	16K points (16384 points, 2K bytes)
			RY	16K points (16384 points, 2K bytes)
			RWr	8K points (8192 points, 16K bytes)
			RWw	8K points (8192 points, 16K bytes)
	When the submaster function is used ^{*3}	Master operating station	RX	16K points
			RY	16K points (Own station send range is 2K points.)
			RWr	8K points
			RWw	8K points (Own station send range is 1024 points.) 8K points when communication mode is "High-Speed" (Own station send range is 256 points.)
		Submaster operating station ^{*1}	RX	2K points (assigned for the station number 0 or submaster station)
			RY	2K points (assigned for the station number 0 or submaster station)
			RWr	1024 points (assigned for the station number 0 or submaster station) 256 points when communication mode is "High-Speed"
			RWw	1024 points (assigned for the station number 0 or submaster station) 256 points when communication mode is "High-Speed"
	Local station ^{*1*3}		RX	2K points (2048 points, 256 bytes)
			RY	2K points (2048 points, 256 bytes)
			RWr	1K points (1024 points, 2K bytes) 256 points (512 bytes) when communication mode is "High-Speed"
			RWw	1K points (1024 points, 2K bytes) 256 points (512 bytes) when communication mode is "High-Speed"
Safety communications ^{*2}	Maximum number of safety connections per network		1814 connections	—
	Maximum number of safety connections per station		120 connections	
	Maximum number of link points per safety connection		8 words (input: 8 words, output: 8 words)	
Transient transmission capacity			1920 bytes maximum	
Communication speed			1Gbps	
Network topology			Line topology, star topology (coexistence of line topology and star topology is also possible), and ring topology	
Communication cable			Ethernet cable which satisfies 1000BASE-T standard: Category 5e or higher, straight cable (double shielded, STP)	
Maximum station-to-station distance			100m (conforms to ANSI/TIA/EIA-568-B (Category 5e))	
Overall cable distance			Line topology: 12000m (when 121 stations are connected) Star topology: Depends on the system configuration. Ring topology: 12100m (when 121 stations are connected)	
Number of cascade connections			20 levels maximum	
Maximum number of connectable stations			121 stations (master station: 1, slave station: 120)	
Maximum number of networks			239	
Communication method			Token passing	

*1 The maximum number of points that a master station can assign to one station. A submaster station and a local station can receive the data from other stations in addition to this number of points.

*2 This function is not available for the RJ71EN71. For the RJ71GF11-T2, availability depends on the firmware version. (MELSEC iQ-R CC-Link IE Field Network User's Manual (Application))

*3 Submaster station and local stations cannot be connected when communication mode is "High-Speed Remote Net".

2.4 Hardware Specifications

The following table lists the hardware specifications of each module.
For the hardware specifications of the CPU module, refer to the following.
 MELSEC iQ-R CPU Module User's Manual (Startup)

Item		RJ71EN71	RJ71GP21-SX	RJ71GF11-T2
Number of occupied I/O points		32 points		
Internal current consumption (5VDC)		0.82A	0.88A	0.82A
External dimensions	Height	106mm		
	Width	27.8mm		
	Depth	110mm		
Weight		0.17kg	0.18kg	0.17kg

3 FUNCTION LIST

3.1 Function List of Ethernet

This section describes the functions of Ethernet. For details on the functions, refer to the following.

 MELSEC iQ-R Ethernet User's Manual (Application)

○: Usable, ×: Not usable

Function	Description	Availability	
		RJ71EN71, RnENCPU (network part)	CPU module (built-in Ethernet port part)
Connection with MELSOFT product and GOT	Allows the programming and monitoring using the engineering tool, and monitoring and testing programmable controller from the GOT with Ethernet connection.	○	○
SLMP communication	Reads/writes the buffer memory, devices, and others from the external device to an SLMP-compatible device connected in the same network as the Ethernet-equipped module. Read/write can also be executed to a CPU module device.	○	○
Predefined protocol communication	Allows the communication processing only with the program of the start instruction when the protocol data for communication with the external device is registered using the engineering tool. The protocol required for communication with the external device (such as temperature controller and barcode reader) can be set easily using the engineering tool's communication protocol support function.	○	○
Socket communications	Exchanges arbitrary data with an external device connected by Ethernet over TCP/IP or UDP/IP using dedicated instructions.	○ ^{*1}	○
Fixed buffer communication	Exchanges arbitrary data between the CPU module and external device using the fixed buffer of the RJ71EN71 and the RnENCPU (network part).	○	×
Random access buffer communication	Reads/writes data from multiple external devices to the random access buffer of the RJ71EN71 and the RnENCPU (network part).	○	×
Link dedicated instruction communication	Reads/writes data from/to other station CPU modules on other networks via Ethernet using the link dedicated instructions.	○	×
File transfer function (FTP server)	Reads/writes data in file units using the dedicated FTP commands from an external device.	○	○
Time setting function (SNTP client)	Automatically performs time setting of the CPU module by collecting clock data from the time information server (SNTP server) on the LAN.	○ ^{*1}	○
IP filter function	Identifies the IP address of the access source to limit access to the Ethernet-equipped module.	○ ^{*1}	○
Remote password	Prevents illegal access of the CPU module from a remote location.	○	○
IP address change function	Changes the CPU module's IP address without changing the parameter settings.	×	○
Ethernet diagnostics	Checks the connection state, protocol state, and line state using the engineering tool.	○	○
Automatic detection of connected devices	Detects devices supporting iQSS which are connected to the CPU module (built-in Ethernet port part), and automatically displays them on "List of devices" and "Device map area" using an engineering tool. For details, refer to the following.  iQ Sensor Solution Reference Manual	×	○
Communication setting reflection	Reflects the communication settings (such as IP addresses) in devices supporting iQSS in "Device map area" which are connected over Ethernet. For details, refer to the following.  iQ Sensor Solution Reference Manual	×	○
Sensor parameter read/write	Reads/writes parameters from/to iQSS-compatible devices. For details, refer to the following.  iQ Sensor Solution Reference Manual	×	○

*1 This function cannot be used when "Q Compatible Ethernet" is selected for the network type.

3.2 Function List of CC-Link IE Controller Network

This section describes the functions of CC-Link IE Controller Network. For details on the functions, refer to the following.

📖 MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application)

Cyclic transmission

○: Available, △: Partially available, ×: Not available

Function		Description	Availability	
			Control station	Normal station
Communications with other stations	Communications using LB and LW	Allows each station to write data to its own send range of a link device (LB, LW) to send them to all other stations on the network.	○	○
	Communications using LX and LY	Exchanges data between the I/O master station that controls LX and LY and another station on a one-to-one (1:1) basis.	○	○
Access to devices and link devices	Link refresh	Automatically transfers data between the link devices (LB, LW, LX, LY, SB, SW) of the CC-Link IE Controller Network-equipped module and devices of the CPU module, or between the link devices (SB, SW) of the CC-Link IE Controller Network-equipped module and the module labels of the CPU module.	○	○
	Direct access to link devices	Directly accesses the link devices of the CC-Link IE Controller Network-equipped module from the program.	○	○
Cyclic data integrity assurance		Assures the cyclic data integrity in units of 32 bits or station-based units.	○	○
Interlink transmission		Transfers the link device (LB, LW) data of a CC-Link IE Controller Network-equipped module to another network module at a relay station.	○	○
Cyclic transmission punctuality assurance		Keeps the link scan time constant using the following methods. • Specification of the number of transient transmissions: Specifies the number of transient transmissions within one link scan. • Constant link scan: Specifies the link scan time.	○	×
Group cyclic transmission		Divides the stations within the network into groups and specifies the stations that share cyclic data (shared group). This setting allows cyclic data to be shared among the stations having the same shared group number and not to be received from those having a different shared group number. Stations having no shared group number assigned will share cyclic data with all stations.	○	○
Number of send points extension by using extended mode		Sets a CC-Link IE Controller Network-equipped module to the extended mode using an engineering tool so that the number of send points per station will be extended to a maximum of 32K points for the link relay (LB) and 128K points for the link register (LW) in one module.	○	○
Cyclic transmission stop and restart		Stops the cyclic transmission during debugging and other operations. (Data reception from other stations and data sending from the own station are stopped.) Also, the stopped cyclic transmission is restarted. Transient transmission does not stop.	○	○

Transient transmission

○: Available, △: Partially available, ×: Not available

Function		Description	Availability	
			Control station	Normal station
Communications within the same network		Performs the transient transmission to other stations using dedicated instructions and the engineering tool.	○	○
Communications with different networks		Performs the transient transmission seamlessly to stations on different networks using dedicated instructions and the engineering tool.	○	○
Dedicated instruction		An instruction for using functions of modules. (📖 MELSEC iQ-R Programming Manual (Instructions, Standard Functions/Function Blocks))	△	○
Group transient transmission		Sends data to all stations of the same transient transmission group number by dividing the transient transmission target stations into groups.	○	○

RAS

○: Available, △: Partially available, ×: Not available

Function	Description	Availability	
		Control station	Normal station
Automatic return	Automatically returns the station disconnected from the network due to a data link error to the network when it recovers and restarts data link.	○	○
Loopback function	Continues data link with normal stations even if a cable disconnection or faulty station occurs.	○	○
Control station switching	Continues data link with a normal station (sub-control station) that serves as a control station even if the control station goes down.	×	○
Normal station disconnection	Disconnects only the normal station where an error occurs, and continues the data link with the stations that are operating normally. In a line topology, all stations connected after the faulty station are disconnected.	○	×

Diagnostics

○: Available, △: Partially available, ×: Not available

Function		Description	Availability	
			Control station	Normal station
CC-Link IE Controller Network diagnostics		Checks the status of CC-Link IE Controller Network using the engineering tool. The error locations, error causes, and corrective actions can be checked in the engineering tool.	○	○
Diagnostics of the module	Unit communication test	Checks the hardware inside the CC-Link IE Controller Network-equipped module. This test should be conducted when the communication is unstable.	○	○
Diagnostics of own network	Cable test	Checks the connection status of the Ethernet cables.*1	○	○
Diagnostics of other network	Communication test	Checks whether the communication route for transient transmission from the own station to the destination station is correct or not.	○	○
	IP communication test	Checks whether no error occurs in the communication route when the IP packet transfer function is used.	○	○

*1 The optical fiber cable cannot be checked.

Others

○: Available, △: Partially available, ×: Not available

Function	Description	Availability	
		Control station	Normal station
Reserved station specification	Specifies stations reserved for future use. The reserved stations are not actually connected, but counted as connected stations. The stations are not detected as faulty stations even though they are not actually connected.	○	×
Interrupt Request to CPU Module	Makes an interrupt request to the CPU module to start the interrupt program if the interrupt conditions preset using the engineering tool are met. Interrupt conditions are based on the changes in the link devices (LB, LW, LX) and the network statuses (SB, SW) checked every link scan or the data reception status of the channel specified via the RECVS instruction.	○	○
IP packet transfer function	Performs communications in a protocol such as FTP and HTTP using the specified IP address of an Ethernet device, over CC-Link IE Controller Network. With this function, two networks of CC-Link IE Controller Network and Ethernet are not required, resulting in reduced wiring cost.	○	○
Station number setting using a program	Sets the station numbers of a normal station (own station) using a program. When there are normal stations with the same program and network parameters (excluding the station numbers), setting the station numbers using a program allows project data items other than the station number to be the same, leading to reduced development work hours. (MELSEC iQ-R Programming Manual (Instructions, Standard Functions/Function Blocks))	×	○

3.3 Function List of CC-Link IE Field Network

The following table lists the functions of CC-Link IE Field Network. For details on the functions, refer to the following.

📖 MELSEC iQ-R CC-Link IE Field Network User's Manual (Application)

Cyclic transmission

○: Available, △: Partially available, ×: Not available

Function		Description	Availability	
			Master station, submaster station	Local station
Communications with other stations	Communications using RX and RY	Communicates I/O data in units of bits between the master station and other stations.	○	○
	Communications using RWr and RWw	Communicates I/O data in units of words between the master station and other stations.		
Access to devices and link devices	Link refresh	Automatically transfers data between the link device of the master/local module and the device of the CPU module	○	○
	Direct access to link devices	Directly accesses the link devices of the master/local module from the program.		
Cyclic data integrity assurance		Assures the cyclic data integrity in units of 32 bits or station-based units.	○	○
Interlink transmission		Transfers data in the link devices of the master station or submaster station to another network module on a relay station.	○	×
Mode selection for cyclic transmission		Selects the mode for optimizing the performance of cyclic transmission based on the cyclic transmission and transient transmission frequency. The mode is selected from "Normal", "High-Speed", or "High-Speed Remote Net".	○ ^{*1}	×
Sequence scan synchronization specification		Selects whether link scan is set to asynchronous or synchronous with the sequence scan of the CPU module.	○	×
Cyclic transmission punctuality assurance		Keeps the link scan time constant by setting the constant link scan time.	○	×
Input status setting for data link faulty station		Selects whether input data from another station where a data link error occurs is cleared or held.	○	○
Output status setting for CPU STOP		Selects whether cyclic data output is held or cleared when the CPU module mounted with a master/local module is set to STOP.	○	○
Output status setting for CPU stop error		Selects whether cyclic transmission output is held or cleared when a stop error occurs in the CPU module which a master/local module is mounted with.	○	○
Cyclic transmission stop and restart		Stops the cyclic transmission during debugging and other operations. (Data reception from a slave station and data sending from the own station are stopped.) Also, the stopped cyclic transmission is restarted. Transient transmission does not stop.	○	○

*1 The "High-Speed Remote Net" mode can be set only for the master station.

Availability of "High-Speed Remote Net" depends on the firmware version of the CC-Link IE Field Network-equipped master/local module.

📖 MELSEC iQ-R CC-Link IE Field Network User's Manual (Application)

Transient transmission

○: Available, △: Partially available, ×: Not available

Function	Description	Availability	
		Master station, submaster station	Local station
Communications within the same network	Performs the transient transmission to other stations using dedicated instructions and the engineering tool.	○	○
Communications with different networks	Performs the transient transmission seamlessly to stations on different networks using dedicated instructions and the engineering tool.	○	○
Dedicated instruction	An instruction for using functions of modules. (MELSEC iQ-R Programming Manual (Instructions, Standard Functions/Function Blocks))	○	△

RAS

○: Available, △: Partially available, ×: Not available

Function	Description	Availability	
		Master station, submaster station	Local station
Slave station disconnection	Disconnects only the slave station where an error occurs, and continues the data link with the stations that are operating normally. In a line topology, all stations connected after the faulty station are disconnected.	○	×
Automatic return	Automatically returns the station disconnected from the network due to a data link error to the network when it recovers and restarts data link.	○	○
Loopback function	Continues data link with normal stations even if a cable disconnection or faulty station occurs. All stations after the cable disconnection point or faulty station are disconnected in a line topology. By using this function with ring topology, data link continues with normal stations.	○	○
Submaster function	Allows the submaster station to control slave stations instead of the master station when the master station is disconnected in a system where the master station and submaster station are connected on the same network. Using this function prevents the entire network from going down due to disconnection of the master station.	○	×

Diagnostics

○: Available, △: Partially available, ×: Not available

Function		Description	Availability	
			Master station, submaster station	Local station
CC-Link IE Field Network diagnostics		Checks the status of CC-Link IE Field Network using the engineering tool. The error locations, error causes, and corrective actions can be checked in the engineering tool.	○	○
Diagnostics of the module	Unit communication test	Checks the hardware of the master/local module. This test should be conducted when the communication is unstable.	○	○
Diagnostics of own network	Cable test	Checks the connection status of the Ethernet cables.	○	○
Diagnostics of other network	Communication test	Checks whether the communication route for transient transmission from the own station to the destination station is correct or not.	○	○
	IP communication test	Checks whether no error occurs in the communication path when the IP packet transfer function is used.	○	○

Others

○: Available, △: Partially available, ×: Not available

Function	Description	Availability	
		Master station, submaster station	Local station
CC-Link IE Field Network synchronous communication function ^{*1}	Synchronizes control intervals between slave stations over CC-Link IE Field Network according to synchronization cycle specified in the master station. This allows different slave stations on the same network to operate with the same timing. (MELSEC iQ-R Inter-Module Synchronization Function Reference Manual)	△ ^{*2*3}	○
Reserved station specification	Specifies stations reserved for future use. The reserved stations are not actually connected, but counted as connected stations. The stations are not detected as faulty stations even though they are not actually connected.	○	×
Temporary cancel of the reserved station setting	Temporarily cancels the reserved station specification without changing the parameters.	○	×
Error invalid station and temporary error invalid station setting	Prevents the master station from detecting a slave station as a faulty station even if the slave station is disconnected during data link. This function is used to replace a slave station during data link, for instance.	○	×
Interrupt request to CPU module	Checks interrupt conditions every link scan, and makes an interrupt request to the CPU module to start the interrupt program if the interrupt conditions are met.	○	○
IP packet transfer function	Enables communications in a protocol such as FTP and HTTP using the specified IP address of an Ethernet device, over CC-Link IE Field Network. With this function, two networks of CC-Link IE Field Network and Ethernet are not required, resulting in reduced wiring cost.	○	○
Station number setting using a program	Sets the station numbers of a local station (own station) using a program. When there are local stations with the same program and network parameters (excluding the station numbers), setting the station numbers using a program allows project data items other than the station number to be the same, leading to reduced development work hours. (MELSEC iQ-R Programming Manual (Instructions, Standard Functions/Function Blocks))	×	○
Automatic detection of connected devices	Reduces the time of setting parameters by automatically reading information of slave stations. For details, refer to the following. iQ Sensor Solution Reference Manual	△ (Master station only)	×
Safety communication function ^{*4}	Establishes a safety connection and enables one-on-one safety communications periodically between safety stations in the same network.	△ (Master station only) ^{*2}	○

^{*1} When the network synchronization communication is performed with local stations, set the inter-module synchronization cycle to any of the following.

- 0.888ms
- 1.777ms
- 3.555ms
- 7.111ms
- 0.8 to 10.0ms (set in increments of 0.05ms)

For the inter-module synchronization cycle when the network synchronization communication is performed with the slave stations other than local stations, refer to the manual for the slave station used.

For the setting method of the inter-module synchronization cycle, refer to the following.

MELSEC iQ-R Inter-Module Synchronization Function Reference Manual

^{*2} This function cannot be used in the network including the submaster station.

^{*3} This function cannot be used when the control CPU of the CC-Link IE Field Network-equipped master/local module is the Safety CPU.

^{*4} This function is not available for the RJ71EN71. For the RJ71GF11-T2, availability depends on the firmware version.

MELSEC iQ-R CC-Link IE Field Network User's Manual (Application)

4 PROCEDURES BEFORE OPERATION

This chapter describes the procedures before operation.

1. Network construction

Configure the system and set the parameters which are required for start-up.

- Wiring ( Page 54 WIRING)
- Parameter setting ( User's Manual (Application) for each network)

2. Network diagnostics

Using network diagnostics, check if the cables are connected properly and communication are performed normally with the configured parameters.

For details, refer to the following.

 User's Manual (Application) for each network


3. Programming

Create a program. For details, refer to the following.

 Page 61 COMMUNICATION EXAMPLES

5 SYSTEM CONFIGURATION

This chapter describes the system configuration of each network.

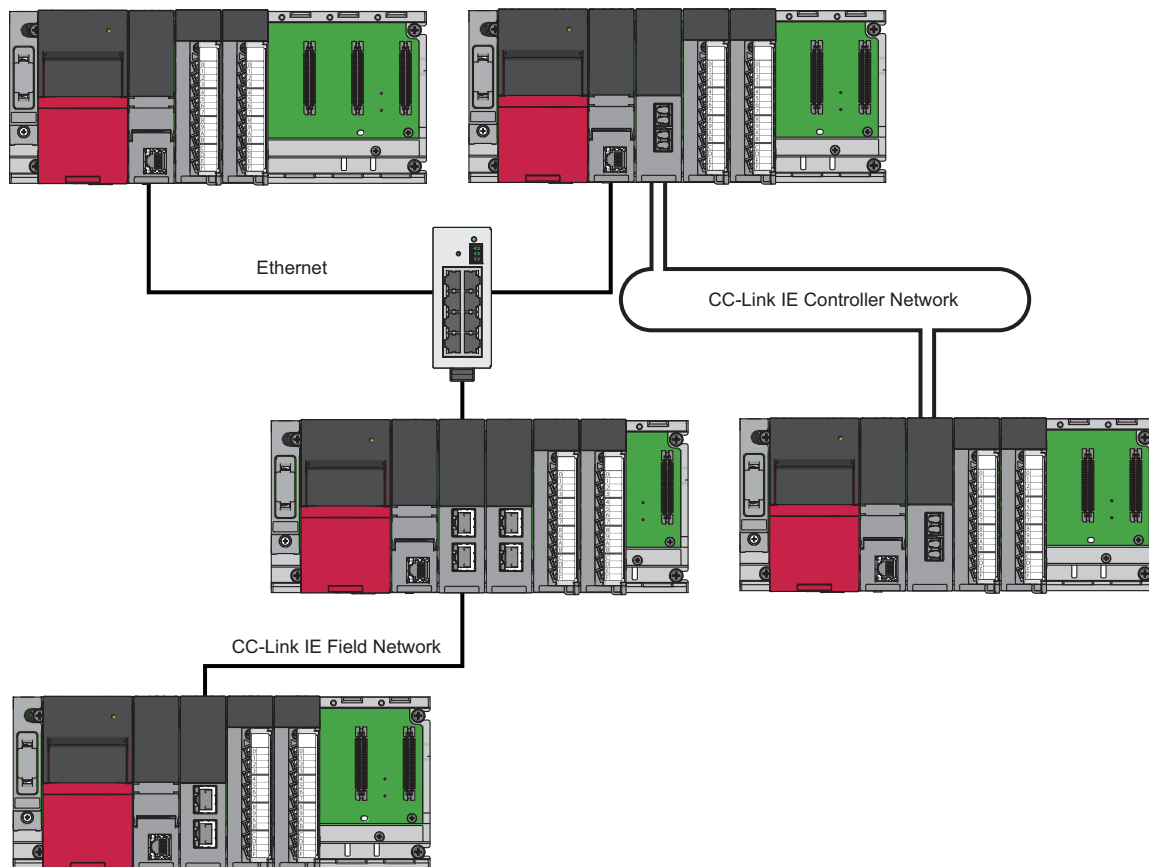


5.1 Ethernet Configuration

This section describes the system configuration of Ethernet.

Direct connection to an engineering tool

Engineering tool can be directly connected only with a single Ethernet cable, without using a hub.

In direct connection, communications can be performed simply by the transfer setup, without setting IP address.

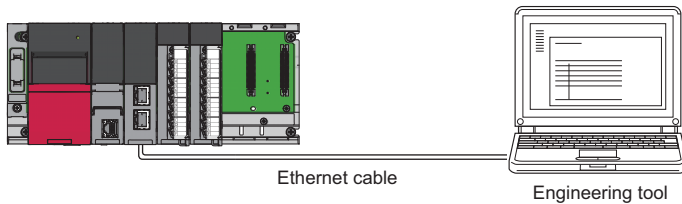


Direct connection can cause an unauthorized connection from a remote location as an Ethernet cable is longer than an USB cable.

Unauthorized connection can be prevented by setting "Disable" in the following item.

Navigation window ⇒ [Parameter] ⇒ Target module ⇒ [Module Parameter] ⇒ [Application Settings] ⇒ [Security] ⇒ [Disable Direct Connection with MELSOFT]

Connection with external devices and other stations

Connecting the module with external devices and other stations via Ethernet enables the collection or modification of programmable controller data, monitoring of CPU module operation, status control, and data communication.

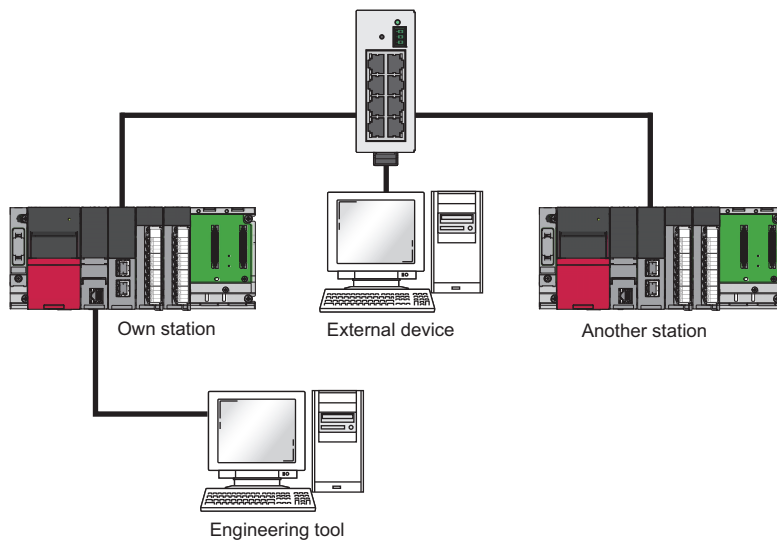

5.2 CC-Link IE Controller Network Configuration

CC-Link IE Controller Network is configured using optical fiber cables or Ethernet cables.


Precautions

CC-Link IE Controller Network of the optical fiber cable and CC-Link IE Controller Network of the Ethernet cable cannot be combined by using a media converter (optical fiber cable $\Leftrightarrow$ Ethernet cable).

When optical fiber cables are used

Network topology


Connect the RJ71GP21-SX in a loop by using optical fiber cables. (Duplex loop connection)

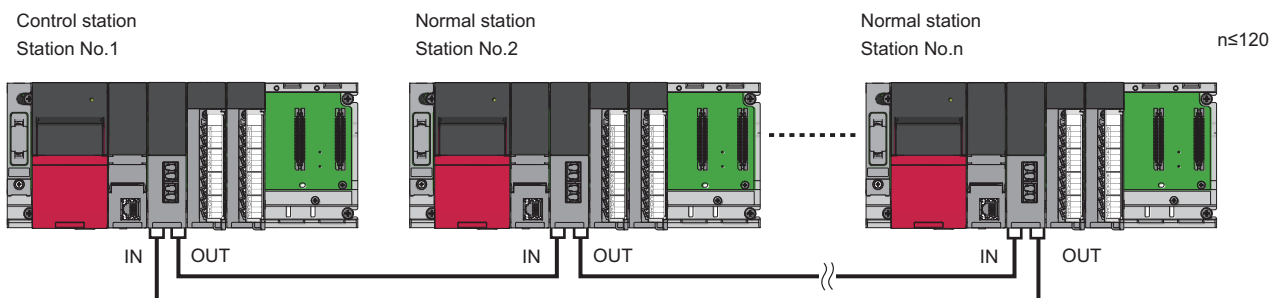

The RJ71GP21-SX has IN connector and OUT connector. Connect the IN connector of own station to OUT connector of another station and OUT connector of own station to IN connector of another station.

Station number and connection position


Modules can be connected in any order regardless of the station number.


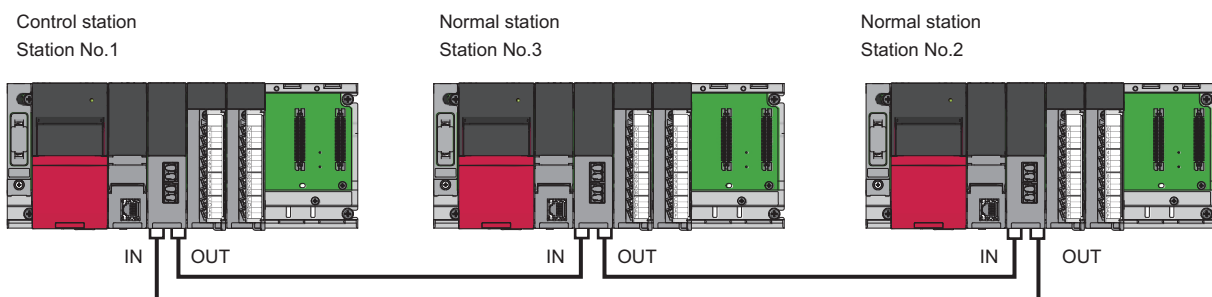


When Ethernet cables are used

For the Ethernet-equipped module, configure the network in star topology, line topology, or ring topology using the Ethernet cables.

Star topology and line topology can be combined in a network. Ring topology cannot be combined with star or line topology.

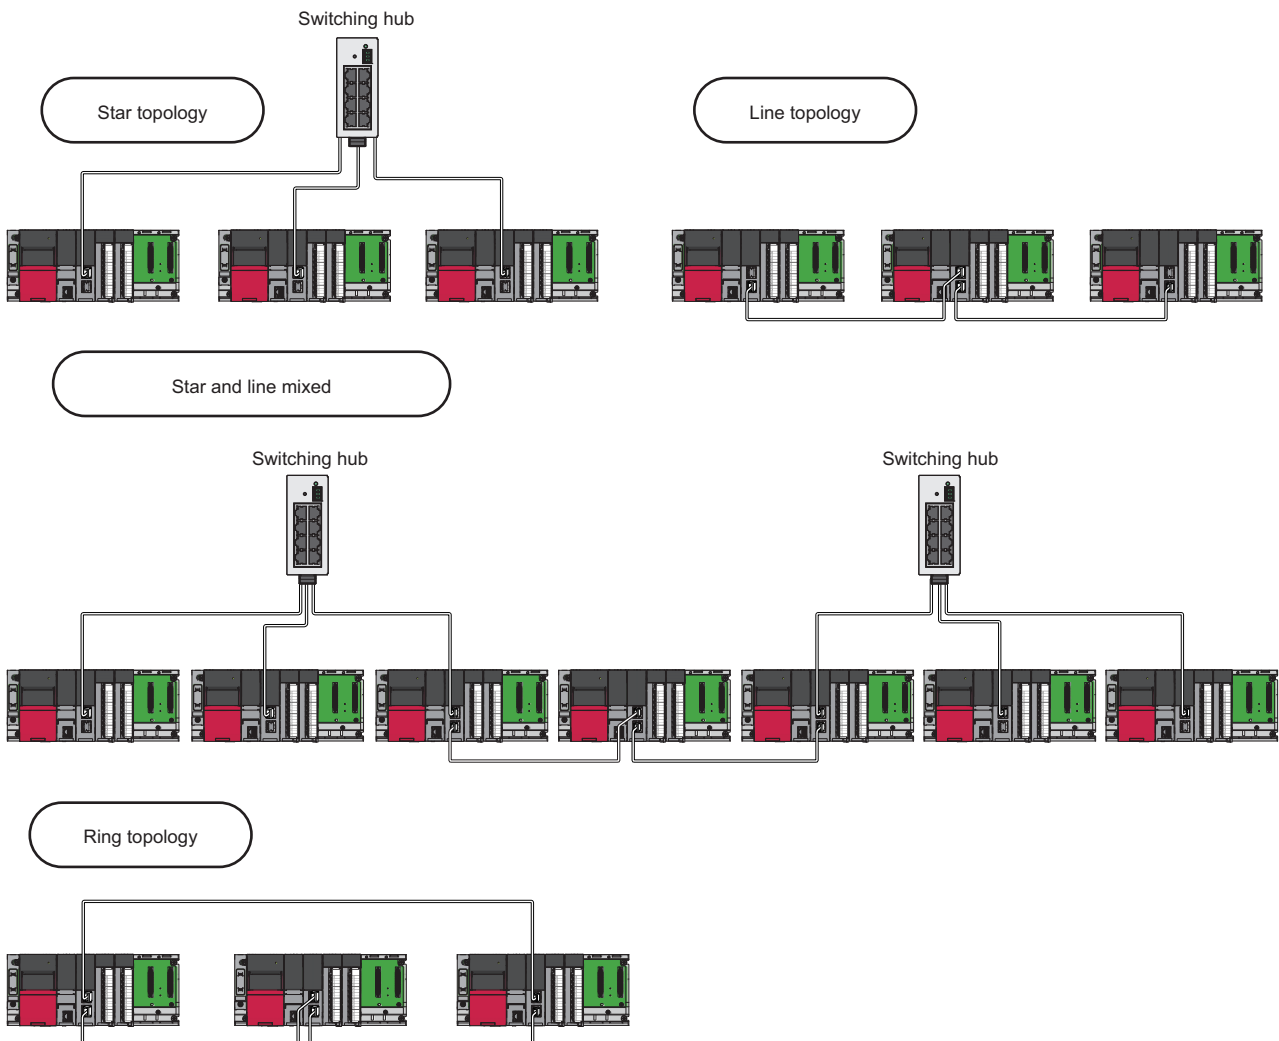


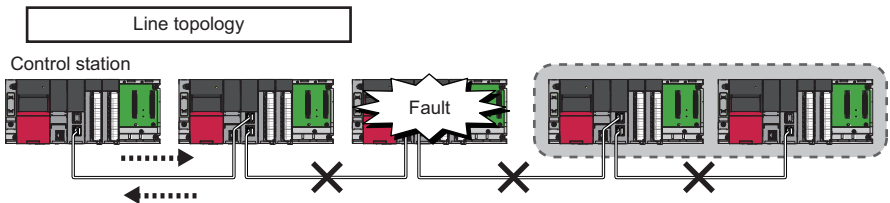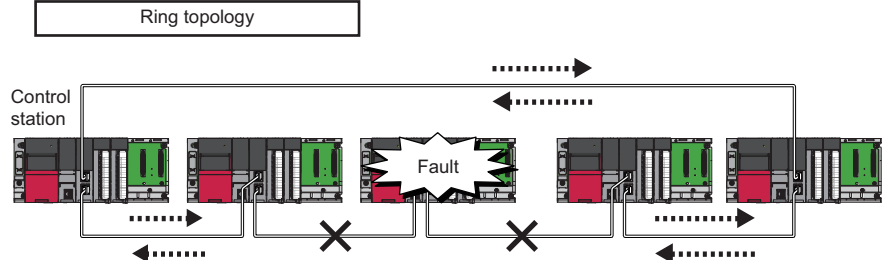Item	Description
Star topology	The network is configured into a star shape using a switching hub and Ethernet cables. Normal stations can be easily added to the network using this topology.*1 When an error occurs in a normal station, data link can be continued with the stations that are operating normally.
Line topology	The network is configured into a line using Ethernet cables. A switching hub is not required.*1 When an error occurs in a normal station, the stations connected after the faulty station will be disconnected. 
Ring topology	The network is configured into a ring using Ethernet cables. A switching hub is not required.*1 When an error occurs in a normal station, data link can be continued with the stations that are operating normally. For the RJ71EN71, ring topology is available only when "CC-Link IE Control" is selected as network type for P1 connector. 

*1 Add/remove normal stations one by one. If multiple slave stations are added/removed at a time, all stations on the network will be reconnected, and an error may momentarily occur in all the stations.


Station number and connection position

Modules can be connected in any order regardless of the station number.

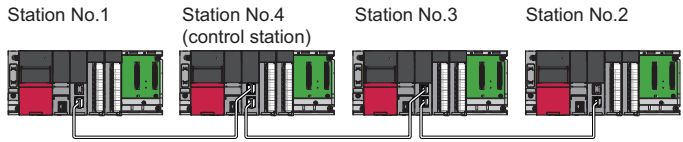

Cascade connection

Cascade connection is available up to 20 levels.

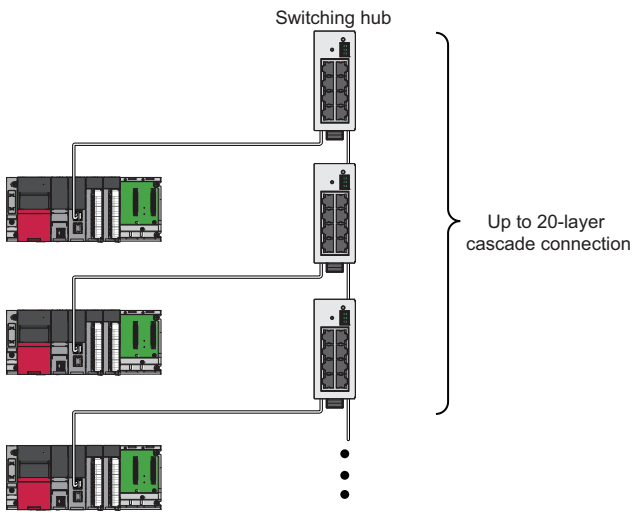

Precautions when Ethernet cables are used

Addition of the normal stations

If a normal station is added to a system having 119 normal stations, the system operates as follows.

■When the firmware version of the control station is "05" or later

Baton pass and data link are not performed in the normal station added after the 120th station, and other stations continues baton pass and data link.

Even if the disconnected stations are returned to a system having 120 or more normal stations, the stations may not start data link.

Point

- Whether 120 or more normal stations are connected can be checked using 'Number of connected modules over occurrence status' (SB0099). Number of connected modules detected by 'Number of connected modules over occurrence status' (SB0099) is the total of the normal stations which are currently connected and the disconnected stations (normal stations which were previously connected).
- The number of stations which were previously connected can be cleared by executing the network map update of the CC-Link IE Controller Network diagnostics. (📖 MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application))
- A data link error may be momentarily detected in all the stations since all stations on the network will be reconnected when executing the network map update.

5

■When the firmware version of the control station is "04" or earlier

All stations will fail and data link cannot be performed.

Incorrectly configured ring topology

Do not use a switching hub for ring topology.

Ring topology


When using a ring topology, select "Ring" in the following setting for the control station.

🖱️ Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ Target module ⇒ [Module Parameter] ⇒ [Basic Settings] ⇒ [Network Topology]


Offline mode station in ring topology

In following conditions, the station connected to the offline mode station cannot detect loopback

- One of the Ethernet cables connected to the offline mode station is disconnected.

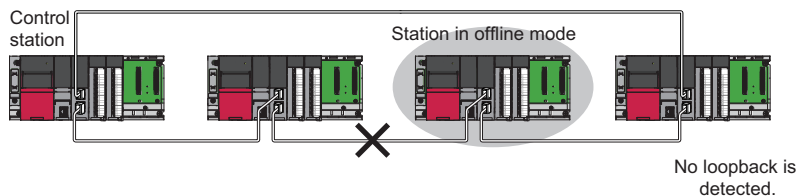

- A station connected to the offline mode station is disconnected.

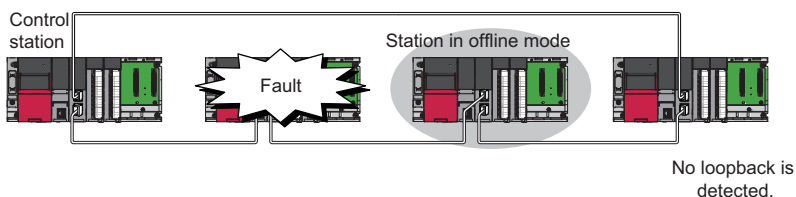

To detect loopback, set the offline mode station as a reserved station.

When the offline mode station is disconnected, loopback can be detected.

Following stations operate as same as a station in the offline mode.

- A station during the RESET status
- A station with no station number setting

Connecting/disconnecting a cable and powering off/on a device

When the operations listed below are performed, the following will occur depending on the firmware version of the control station.

Network configuration	Operation
Star topology	• Powering off and on a normal station or switching hub • Connecting/disconnecting an Ethernet cable connected to the switching hub • Disconnecting an Ethernet cable from a normal station and connecting it to another normal station or a switching hub • Disconnecting more than 9 stations, or half the number of normal stations or more in the system • Changing the network topology when adding a normal station
Line topology, ring topology	• Simultaneously powering off/on multiple stations • Simultaneously connecting/disconnecting Ethernet cables to/from multiple stations (When a data link faulty station returns, a data link error will occur in all the stations.) • Disconnecting more than 9 stations, or half the number of normal stations or more in the system • Changing the network topology when adding a normal station

■When the firmware version of the control station is "05" or later

The actual network configuration and the network map of the CC-Link IE Controller Network diagnostics may be a mismatch. Whether mismatch is occurred or not can be checked using 'Network configuration mismatch occurrence status' (SB0098). When using a ring topology, the following may be occurred.

- The station number of the loopback station cannot be detected correctly.
- Even if a switching hub is used, data link does not stop.

The actual network configuration and network map can be matched by executing the network map update of the CC-Link IE Controller Network diagnostics. ( MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application))

A data link error may be momentarily detected in all the stations since all stations on the network will be reconnected when executing the network map update.

■When the firmware version of the control station is "04" or earlier

A data link error may occur in all the stations.

Connected station numbers

Do not duplicate station numbers. Data link may be stopped when the station number is duplicated.


5.3 CC-Link IE Field Network Configuration

CC-Link IE Field Network is configured using Ethernet cables.

Network topology

For the CC-Link IE Field Network-equipped master/local module, configure the network in star topology, line topology, or ring topology using the Ethernet cables.

Star topology and line topology can be combined in a network. Ring topology cannot be combined with star or line topology.

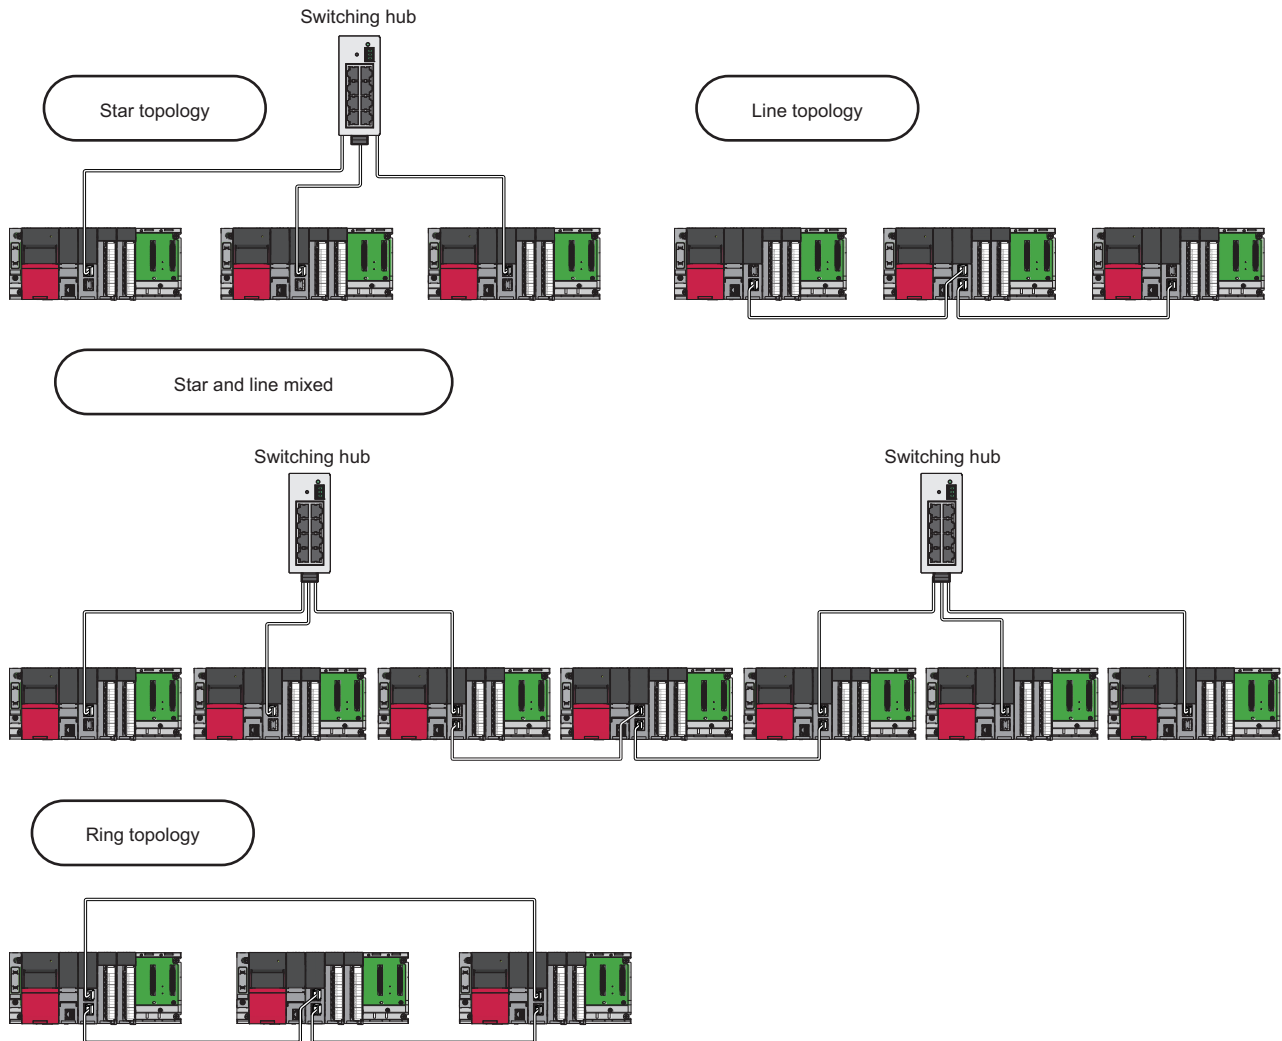


Item	Description
Star topology	The network is configured into a star shape using a switching hub and Ethernet cables. Slave stations can be easily added to the network using this topology.*1 When an error occurs in a slave station, data link can be continued with the stations that are operating normally.
Line topology	The network is configured into a line using Ethernet cables. A switching hub is not required.*1 When an error occurs in a slave station, the stations connected after the faulty station will be disconnected. Line topology (1) Master station (station No.0)
Ring topology	The network is configured into a ring using Ethernet cables. A switching hub is not required.*1 When an error occurs in a slave station, data link can be continued with the stations that are operating normally. For the RJ71EN71, ring topology is available only when "CC-Link IE Field" is selected as network type for P1 connector. Ring topology (1) Master station (station No.0)

*1 Add/remove slave stations one by one. If multiple slave stations are added/removed at a time, all stations on the network will be reconnected, and an error may momentarily occur in all the stations.

Station number and connection position


Modules can be connected in any order regardless of the station number.

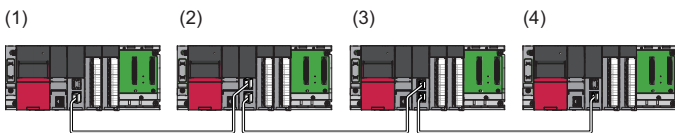

- (1) Station number 1
- (2) Station number 0 (master station)
- (3) Station number 3
- (4) Station number 2

Cascade connection

Cascade connection is available up to 20 levels.

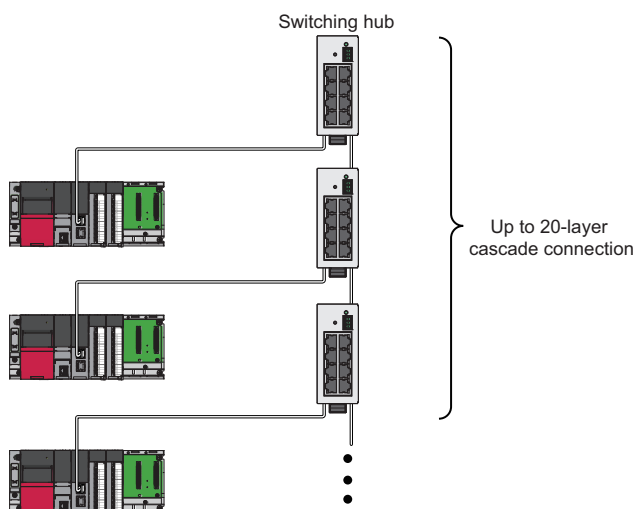

Restriction

Up to 4 levels can be connected when the synchronous communication function of CC-Link IE Field is used.

When mounting with the Safety CPU

When the RJ71GF11-T2 is mounted with the Safety CPU, safety communications is available in addition to the standard communications (cyclic transmission and transient transmission).

For details on the safety communications, refer to the following.

📖 MELSEC iQ-R CC-Link IE Field Network User's Manual (Application)

Precautions

Addition of slave stations (including a submaster station)

If a slave station (including a submaster station) is added to a system having 120 slave stations (including a submaster station), the system operates as follows.

■When the firmware version of the master station is "05" or later

Baton pass and data link are not performed in the slave stations (including a submaster station) added after the 121st station, and other stations continues baton pass and data link.

Even if the disconnected stations are returned to a system having 121 or more slave stations (including a submaster station), the stations may not start data link.

Point

- Whether 121 or more slave stations (including a submaster station) are connected can be checked using 'Number of connected modules over occurrence status' (SB0099). Number of connected modules detected by 'Number of connected modules over occurrence status' (SB0099) is the total of the slave stations (including a submaster station) which are currently connected and the disconnected stations (slave stations which were previously connected).
- The number of stations which were previously connected can be cleared by executing the network map update of the CC-Link IE Field Network diagnostics. ( MELSEC iQ-R CC-Link IE Field Network User's Manual (Application))
- A data link error may momentarily occur in all the stations and outputs of the connected slave stations may turn off since all stations on the network will be reconnected when executing the network map update. Set output data if needed. ( Page 52 Output hold when a data link error occurs)

■When the firmware version of the master station is "04" or earlier

All stations will fail and data link cannot be performed.

Incorrectly configured ring topology

Do not use a switching hub for ring topology.

Ring topology


When using a ring topology, select "Ring" in the following setting for the master station.

 Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ Target module ⇒ [Module Parameter] ⇒ [Basic Settings] ⇒ [Network Topology]

Offline mode station in ring topology


In following conditions, the station connected to the offline mode station cannot detect loopback

- One of the Ethernet cables connected to the offline mode station is disconnected.

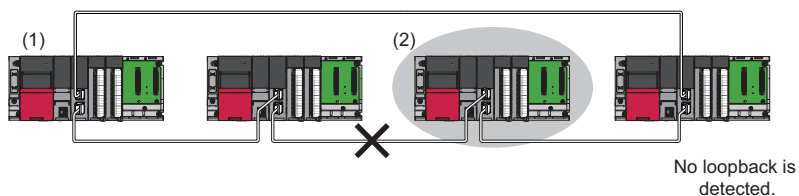

- (1) Master station
(2) Station in offline mode

- A station connected to the offline mode station is disconnected.

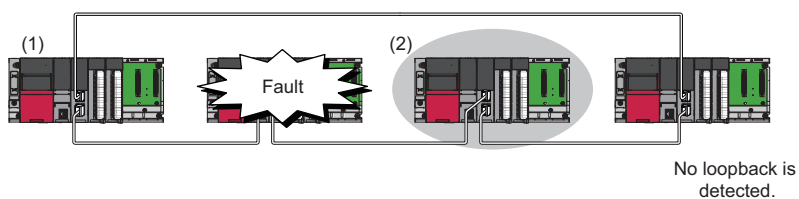

- (1) Master station
(2) Station in offline mode

To detect loopback, set the offline mode station as a reserved station.

When the offline mode station is disconnected, loopback can be detected.

Point

Following stations operate as same as a station in the offline mode.

- A station during the RESET status
- A station with no station number setting

Connecting/disconnecting a cable and powering off/on a device

When the operations listed below are performed, the following will occur depending on the firmware version of the control station.

Network configuration	Operation
Star topology	• Powering off and on a slave station or switching hub • Connecting/disconnecting an Ethernet cable connected to the switching hub • Disconnecting an Ethernet cable from a slave station and connecting it to another slave station or a switching hub • Disconnecting more than 9 stations, or half the number of slave stations or more in the system • Changing the network topology when adding a slave station
Line topology, ring topology	• Simultaneously powering off/on multiple stations • Simultaneously connecting/disconnecting Ethernet cables to/from multiple stations (When a data link faulty station returns, a data link error will occur in all the stations.) • Disconnecting more than 9 stations, or half the number of slave stations or more in the system • Changing the network topology when adding a slave station

■When the firmware version of the master station is "05" or later

The actual network configuration and the network map of the CC-Link IE Field Network diagnostics may be a mismatch. Whether mismatch is occurred or not can be checked using 'Network configuration mismatch occurrence status' (SB0098). When using a ring topology, the following may be occurred.

- The station number of the loopback station cannot be detected correctly.
- Even if a switching hub is used, data link does not stop.

Point

The actual network configuration and network map can be matched by executing the network map update of the CC-Link IE Field Network diagnostics. ( MELSEC iQ-R CC-Link IE Field Network User's Manual (Application))

A data link error may momentarily occur in all the stations and outputs of the connected slave stations may turn off since all stations on the network will be reconnected when executing the network map update. Set output data if needed. ( Page 52 Output hold when a data link error occurs)

■When the firmware version of the master station is "04" or earlier

A data link error may momentarily occur in all the stations and outputs of the connected slave stations may turn off since all stations on the network will be reconnected. Set output data if needed. ( Page 52 Output hold when a data link error occurs)

Output hold when a data link error occurs

Setting the following allows to hold the outputs when a data link error occurs.

■Master/local module

Select the "Hold" in the following setting.

 Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ Target module ⇒ [Module Parameter] ⇒ [Application Settings] ⇒ [Supplementary Cyclic Settings] ⇒ [I/O Maintenance Settings] ⇒ [Data Link Error Station Setting]

■For a head module whose serial number (first five digits) is "12071" or earlier

Select the "Hold" in the following setting using GX Works2.

 Project window ⇒ [Parameter] ⇒ [PLC Parameter] ⇒ "I/O Assignment" ⇒ [Detailed Setting] button ⇒ [Error Time Output Mode]

This setting is not required for a head module whose serial number (first five digits) is "12072" or later.)

Connected station numbers

Do not duplicate station numbers. Data link may be stopped when the station number is duplicated.

5.4 Precautions for System Configuration

Connecting devices to the same network

Do not connect the devices as described below. Doing so may cause the disconnection of all stations.

- The devices having different network types (such as CC-Link IE Controller Network and CC-Link IE Controller Network) are connected to the same network line.
- The Ethernet devices (such as personal computers) in various networks are connected to one switching hub.

Connecting devices to the CPU module (built-in Ethernet port part)

When connecting devices to the CPU module (built-in Ethernet port part), power off the CPU module before connection.

6 WIRING

This chapter describes the wiring methods, wiring products, and wiring precautions when each network is used.

6.1 Ethernet Wiring

This section describes the wiring when Ethernet is used.

Wiring methods

The following describes connection and disconnection of the Ethernet cable.

■Connecting the cable

1. Push the Ethernet cable connector into the Ethernet-equipped module until it clicks. Pay attention to the connector's direction.
2. Lightly pull it to check that it is securely connected.
3. Check whether the LINK LED of the port connected with an Ethernet cable is on. ^{*1}

^{*1} The time between the cable connection and the LINK LED turning on may vary. The LINK LED usually turns on in a few seconds. Note, however, that the time may be extended further if the link-up processing is repeated depending on the status of the device on the line. Check that the cables are connected properly if the LINK LED does not turn on.

■Disconnecting the cable

1. Press the latch down and unplug the Ethernet cable.

■Precautions

- Place the Ethernet cable in a duct or clamp them. If not, dangling cable may swing or inadvertently be pulled, resulting in damage to the module or cables or malfunction due to poor contact.
- Do not touch the core of the cable-side or module-side connector, and protect it from dirt or dust. If oil from your hand, dirt or dust is attached to the core, it can increase transmission loss, arising a problem in data link.
- Check that the Ethernet cable is not disconnected or not shorted and there is no problem with the connector connection.
- Do not use Ethernet cables with broken latches. Doing so may cause the cable to unplug or malfunction.
- Hold the connector part when connecting and disconnecting the Ethernet cable. Pulling the cable connected to the module may result in malfunction or damage to the module or cable.
- For connectors without Ethernet cable, attached connector cover should be placed to prevent foreign matter such as dirt or dust.
- The maximum segment length of the Ethernet cable is 100m. However, the length may be shorter depending on the operating environment of the cable. For details, contact your cable manufacturer.
- The bend radius of the Ethernet cable is limited. For details, check the specifications of the Ethernet cable to be used.

Wiring products

The following describes the devices used for Ethernet.

Point

An Ethernet-equipped module determines whether to use 1000BASE-T/100BASE-TX/10BASE-T and the full-duplex/half-duplex communication mode based on the hub. For connection to the hub with no automatic negotiation function, set the communication mode on the hub side to meet the mode of the Ethernet-equipped module. (
Page 28 Performance Specifications of Ethernet
)

Ethernet cable

Use Ethernet cable that meets the following standards.

Communication speed	Ethernet cable	Connector	Type
1Gbps*1	Category 5e or higher, straight cable (shielded, STP)	RJ45 connector	1000BASE-T
	Category 5e or higher, crossing cable (shielded, STP)		
100Mbps	Category 5 or higher, straight cable (shielded, STP)		100BASE-TX
	Category 5 or higher, crossing cable (shielded, STP)		
10Mbps	Category 3 or higher, straight cable (shielded, STP)		10BASE-T
	Category 3 or higher, straight cable (UTP)		
	Category 3 or higher, crossing cable (shielded, STP)		
	Category 3 or higher, crossing cable (UTP)		

*1 The CPU module (built-in Ethernet port part) does not support the communication speed.

Point

A communication error may occur due to high-frequency noise from devices other than a programmable controller in a given connection environment. The following describes countermeasures to be taken on the Ethernet-equipped module side to avoid high-frequency noise influence.

Wiring

- Do not bundle the cable with the main circuit or power cable or do not place it near those lines.
- Place the cable in a duct.
- When using a UTP cable, use STP cables.

Communication method

- Use TCP/IP for data communications with connected devices.
- Increase the number of retries of communications if needed.

Transmission speed

- Change the communication speed to be slower than the speed of communications connected with an Ethernet cable in "Communication Speed" of "Application Settings". (
MELSEC iQ-R Ethernet User's Manual (Application)
)

Hubs

Use hubs that support the transmission speed of communication when using hub in the Ethernet.

6.2 Wiring of CC-Link IE Controller Network

This section describes the wiring when CC-Link IE Controller Network is used.

For the RJ71GP21-SX

Wiring methods

The following describes connection and disconnection of the optical fiber cable.

■Connecting the cable

1. Push the optical fiber cable connector into the RJ71GP21-SX until it clicks. Pay attention to the connector's direction.
2. Lightly pull it to check that it is securely connected.

■Disconnecting the cable

1. Press the connector hook down and unplug the optical fiber cable.

■Precautions

- The RJ71GP21-SX has IN connector and OUT connector. Connect the IN connector of own station to OUT connector of another station and OUT connector of own station to IN connector of another station.
- The bend radius of the optical fiber cable is limited. For details, check the specifications of the cable used.
- Place the optical fiber cable in a duct or clamp them. If not, dangling cable may swing or inadvertently be pulled, resulting in damage to the module or cables or malfunction due to poor contact.
- When handling an optical fiber cable, do not touch the optical fiber core of the cable-side or module-side connector, and protect it from dirt or dust. If oil from your hand, dirt or dust is attached to the core, it can increase transmission loss, arising a problem in data link.
- Hold the connector part when connecting or disconnecting the optical fiber cable. Pulling the cable connected to the module may result in malfunction or damage to the module or cable.

Wiring products

The following describes the devices used for CC-Link IE Controller Network (when optical fiber cables are used).

■Optical fiber cable

Use optical fiber cable that meets the following standards.

Optical fiber cable	Connector	Type
Optical fiber cable (multi-mode optical fiber (GI))	Duplex LC connector	The following conditioning cables: • IEEE802.3 (1000BASE-SX) • IEC 60793-2-10 Types A1a.1

Optical fiber cables with connectors are available from Mitsubishi Electric System & Service Co., Ltd. (Catalogs of the optical fiber cables are also available.)

In addition, the connector processing of cable length is available for your preference. Please consult your local Mitsubishi representative.

Type	Model (Manufacturer)
Multi-mode fiber (GI)	QG series (Mitsubishi Electric System & Service Co., Ltd.)

For the RJ71EN71 or the RnENCPU (network part)

Wiring methods

The following describes connection and disconnection of the Ethernet cable.

■Connecting the cable

1. Push the Ethernet cable connector into the RJ71EN71 or the RnENCPU (network part) until it clicks. Pay attention to the connector's direction.
2. Lightly pull it to check that it is securely connected.
3. Check whether the LINK LED of the port connected with an Ethernet cable is on. ^{*1}

^{*1} The time between the cable connection and the LINK LED turning on may vary. The LINK LED usually turns on in a few seconds. Note, however, that the time may be extended further if the link-up processing is repeated depending on the status of the device on the line. If the LINK LED does not turn on, refer to the following and take corrective actions.


📖 MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application)

Point


Both P1 connector and P2 connector can be used. (Ring topology is available only when "CC-Link IE Control" is selected as network type for P1 connector.)

- When only one connector is used in star topology, either P1 connector or P2 connector is applicable.
- When two connectors are used in line topology and ring topology, the cable can be connected between P1 and P1, P2 and P2, or between P1 and P2.

Connection between P1s or P2s

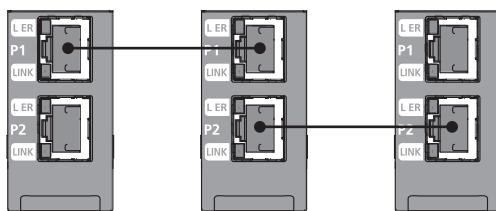

Connection between P1 and P2

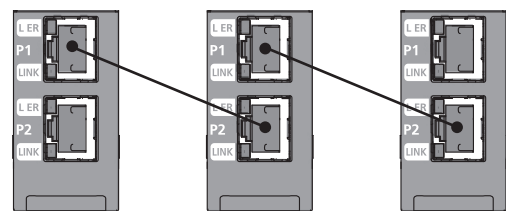

■Disconnecting the cable

1. Press the latch down and unplug the Ethernet cable.

■Precautions

- Place the Ethernet cable in a duct or clamp them. If not, dangling cable may swing or inadvertently be pulled, resulting in damage to the module or cables or malfunction due to poor contact.
- Do not touch the core of the cable-side or module-side connector, and protect it from dirt or dust. If oil from your hand, dirt or dust is attached to the core, it can increase transmission loss, arising a problem in data link.
- Check that the Ethernet cable is not disconnected or not shorted and there is no problem with the connector connection.
- Do not use Ethernet cables with broken latches. Doing so may cause the cable to unplug or malfunction.
- Hold the connector part when connecting and disconnecting the Ethernet cable. Pulling the cable connected to the module may result in malfunction or damage to the module or cable.
- For connectors without Ethernet cable, attached connector cover should be placed to prevent foreign matter such as dirt or dust.
- The maximum station-to-station distance of the Ethernet cable is 100m. However, the length may be shorter depending on the operating environment of the cable. For details, contact your cable manufacturer.
- The bend radius of the Ethernet cable is limited. For details, check the specifications of the Ethernet cable to be used.

Wiring products

The following describes the devices used for CC-Link IE Controller Network (when Ethernet cables are used).

■Ethernet cable

Use Ethernet cable that meets the following standards.

Ethernet cable	Connector	Type
Category 5e or higher, straight cable (double shielded, STP)	RJ45 connector	The following conditioning cables: • IEEE802.3 (1000BASE-T) • ANSI/TIA/EIA-568-B (Category 5e)

Cables for CC-Link IE Controller Network are available from Mitsubishi Electric System & Service Co., Ltd. (Catalogs for cable are also available.)

In addition, the connector processing of cable length is available for your preference. Please consult your local Mitsubishi representative.

Type	Model (Manufacturer)
Straight cable (double shielded, STP)	SC-E5EW series (Mitsubishi Electric System & Service Co., Ltd.)

■Hubs

Use hubs that meet all the conditions listed below. Operation is not guaranteed if the hubs do not meet these conditions.

- Compliance with the IEEE802.3 (1000BASE-T)
- Support of the auto MDI/MDI-X function
- Support of the auto-negotiation function
- Switching hub (layer 2 switch) ^{*1}

^{*1} A repeater hub is not available.

Type	Model (Manufacturer)
Industrial switching hub	NZ2EHG-T8 (Mitsubishi Electric Corporation)

6.3 Wiring of CC-Link IE Field Network

This section describes the wiring when CC-Link IE Field Network is used.

Wiring methods

The following describes connection and disconnection of the Ethernet cable.

■Connecting the cable

1. Push the Ethernet cable connector into the CC-Link IE Field Network-equipped master/local module until it clicks. Pay attention to the connector's direction.
2. Lightly pull it to check that it is securely connected.
3. Check whether the LINK LED of the port connected with an Ethernet cable is on. ^{*1}

^{*1} The time between the cable connection and the LINK LED turning on may vary. The LINK LED usually turns on in a few seconds. Note, however, that the time may be extended further if the link-up processing is repeated depending on the status of the device on the line. If the LINK LED does not turn on, refer to the following and take corrective actions.


📖 MELSEC iQ-R CC-Link IE Field Network User's Manual (Application)

Point


Both P1 connector and P2 connector can be used. (For the RJ71EN71 and the RnENCPU (network part), ring topology is available only when "CC-Link IE Field" is selected as network type for P1 connector.)

- When only one connector is used in star topology, either P1 connector or P2 connector is applicable.
- When two connectors are used in line topology and ring topology, the cable can be connected between P1 and P1, P2 and P2, or between P1 and P2.

Connection between P1s or P2s

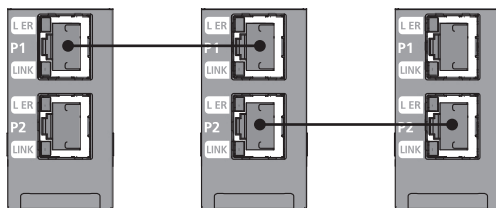

Connection between P1 and P2

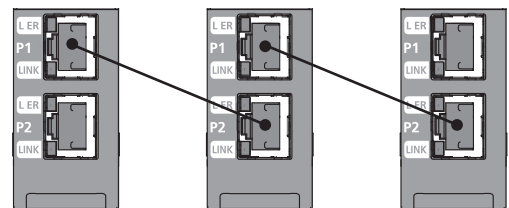

■Disconnecting the cable

1. Press the latch down and unplug the Ethernet cable.

■Precautions

- Place the Ethernet cable in a duct or clamp them. If not, dangling cable may swing or inadvertently be pulled, resulting in damage to the module or cables or malfunction due to poor contact.
- Do not touch the core of the cable-side or module-side connector, and protect it from dirt or dust. If oil from your hand, dirt or dust is attached to the core, it can increase transmission loss, arising a problem in data link.
- Check that the Ethernet cable is not disconnected or not shorted and there is no problem with the connector connection.
- Do not use Ethernet cables with broken latches. Doing so may cause the cable to unplug or malfunction.
- Hold the connector part when connecting and disconnecting the Ethernet cable. Pulling the cable connected to the module may result in malfunction or damage to the module or cable.
- For connectors without Ethernet cable, attached connector cover should be placed to prevent foreign matter such as dirt or dust.
- The maximum station-to-station distance of the Ethernet cable is 100m. However, the length may be shorter depending on the operating environment of the cable. For details, contact your cable manufacturer.
- The bend radius of the Ethernet cable is limited. For details, check the specifications of the Ethernet cable to be used.

Wiring products

The following describes the devices used for CC-Link IE Field Network.

■Ethernet cable

Use Ethernet cable that meets the following standards.

Ethernet cable	Connector	Type
Category 5e or higher, straight cable (double shielded, STP)	RJ45 connector	The following conditioning cables: • IEEE802.3 (1000BASE-T) • ANSI/TIA/EIA-568-B (Category 5e)

Cables for CC-Link IE Field Network are available from Mitsubishi Electric System & Service Co., Ltd. (Catalogs for cable are also available.)

In addition, the connector processing of cable length is available for your preference. Please consult your local Mitsubishi representative.

Type	Model (Manufacturer)
Straight cable (double shielded, STP)	SC-E5EW series (Mitsubishi Electric System & Service Co., Ltd.)

■Hubs

Use hubs that meet all the conditions listed below. Operation is not guaranteed if the hubs do not meet these conditions.

- Compliance with the IEEE802.3 (1000BASE-T)
- Support of the auto MDI/MDI-X function
- Support of the auto-negotiation function
- Switching hub (layer 2 switch)^{*1}

^{*1} A repeater hub is not available.

Type	Model (Manufacturer)
Industrial switching hub	NZ2EHG-T8 (Mitsubishi Electric Corporation)

Use the CC-Link IE Field Network synchronization communication-compatible switching hubs when using the CC-Link IE Field Network synchronization communication function.

CC-Link IE Field Network synchronization communication-compatible switching hubs are available from Mitsubishi Electric System & Service Co., Ltd. Please consult your local Mitsubishi representative.

Type	Model (Manufacturer)
CC-Link IE Field Network synchronization communication-compatible switching hub	DT135TX (Mitsubishi Electric System & Service Co., Ltd.)

7 COMMUNICATION EXAMPLES


7.1 Communication Examples of Ethernet

This section describes the socket communications examples using Active open of TCP/IP communications.

System configuration example

The following system configuration is used to explain socket communications.

System configuration

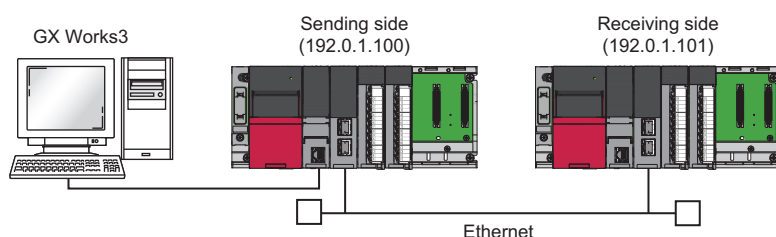


Sending side


Connect the engineering tool to the CPU module on the sending side and set the parameters.

1. Set the CPU module in the following item.

 [Project] ⇒ [New]

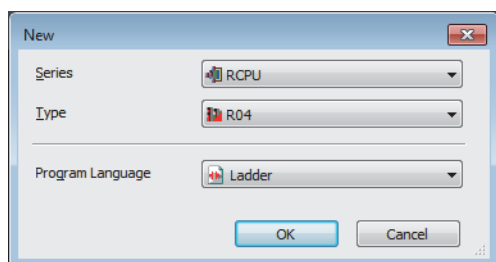


2. Click the [Yes] button to add the module labels of the CPU module.

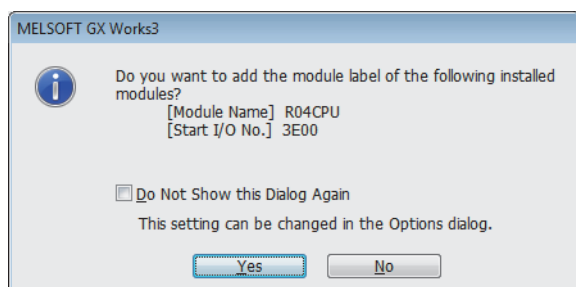


3. Set the RJ71EN71 in the following item.

Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ Right-click ⇒ [Add New Module]

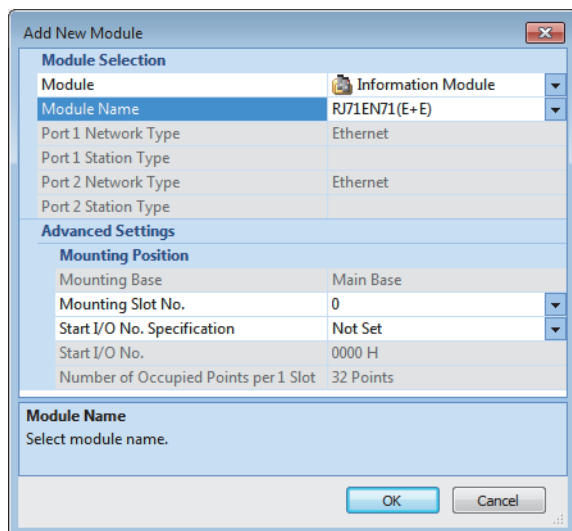

The "Add New Module" dialog box is shown. It has a "Module Selection" section with a "Module" dropdown set to "Information Module" and a "Module Name" dropdown set to "RJ71EN71(E+E)". Below this are fields for "Port 1 Network Type" (Ethernet), "Port 1 Station Type", "Port 2 Network Type" (Ethernet), and "Port 2 Station Type". An "Advanced Settings" section includes "Mounting Position" with "Mounting Base" (Main Base), "Mounting Slot No." (0), "Start I/O No. Specification" (Not Set), "Start I/O No." (0000 H), and "Number of Occupied Points per 1 Slot" (32 Points). At the bottom, there is a "Module Name" field with the instruction "Select module name." and "OK" and "Cancel" buttons.


4. Click the [Yes] button to add the module labels of the RJ71EN71.

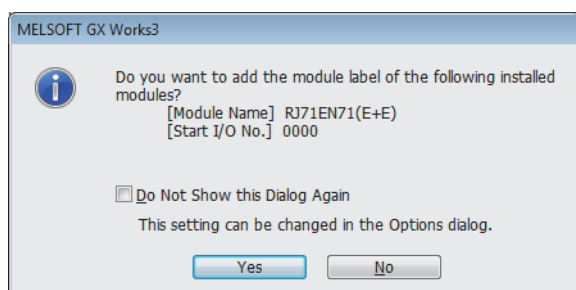

The "MELSOFT GX Works3" dialog box is shown. It contains an information icon and the text: "Do you want to add the module label of the following installed modules?". Below this, it lists "[Module Name] RJ71EN71(E+E)" and "[Start I/O No.] 0000". There is a checkbox labeled "Do Not Show this Dialog Again" with the note "This setting can be changed in the Options dialog." at the bottom. "Yes" and "No" buttons are at the bottom.

5. Set the contents of "Basic Settings" in the following item.

Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ [RJ71EN71] ⇒ [Port 1 Module Parameter (Ethernet)] ⇒ [Basic Settings]

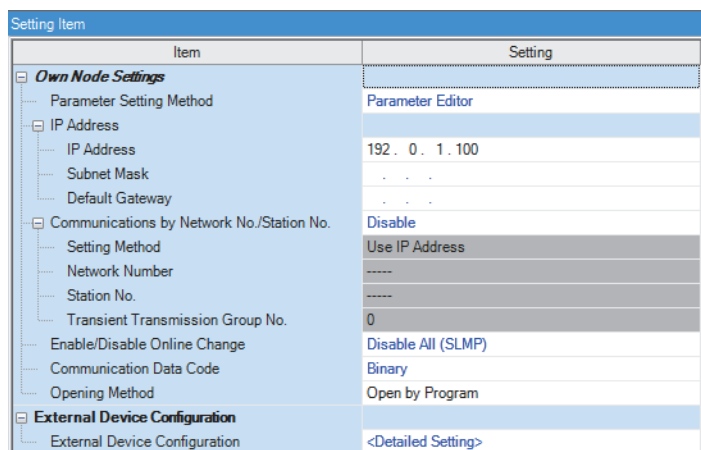

The "Setting Item" dialog box is shown. It has a tree view on the left and a list of settings on the right. The tree view includes "Own Node Settings" (expanded), "IP Address", "Subnet Mask", "Default Gateway", "Communications by Network No./Station No." (expanded), "Setting Method", "Network Number", "Station No.", "Transient Transmission Group No.", "Enable/Disable Online Change", "Communication Data Code", "Opening Method", "External Device Configuration" (expanded), and "External Device Configuration". The settings list on the right includes "Parameter Editor", "192 . 0 . 1 . 100", "Disable", "Use IP Address", "Disable All (SLMP)", "Binary", "Open by Program", and "<Detailed Setting>".

6. Set the network configuration in the following item.

Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ [RJ71EN71] ⇒ [Port 1 Module Parameter (Ethernet)] ⇒ [Basic Settings] ⇒ [External Device Configuration]

No.	Model Name	Communication Method	Protocol	Fixed Buffer Send/Receive Setting	PLC		Sensor/Device				Existence Confirmation
					IP Address	Port No.	IP Address	Port No.	Subnet Mask	Default Gateway	
1	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.100						KeepAlive
2	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.100						KeepAlive
3	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.100						KeepAlive
4	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.100						KeepAlive
5	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.100						KeepAlive
6	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.100						KeepAlive
7	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.100						KeepAlive
8	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.100						KeepAlive
9	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.100						KeepAlive
10	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.100						KeepAlive
11	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.100						KeepAlive
12	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.100						KeepAlive
13	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.100						KeepAlive
14	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.100						KeepAlive
15	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.100						KeepAlive
16	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.100						KeepAlive
17	Active Connection Module	Sodiet Communication	TCP		192.0.1.100	8192		192.0.1.101	4096		KeepAlive

7. Write the set parameters to the CPU module. Then reset the CPU module or power off and on the system.

[Online] ⇒ [Write to PLC]

Point

In this example, default values were used for parameters that are not shown above. For the parameters, refer to the following.

📖 MELSEC iQ-R Ethernet User's Manual (Application)

Receiving side

Connect the engineering tool to the CPU module on the receiving side and set the parameters.

1. Set the CPU module and add a module label of the CPU module. The setting method of the CPU module and addition method of the module label are the same as those of when setting the sending side. (👉 Page 61 Sending side)
2. Set the RJ71EN71 and add the module labels of the RJ7171EN71. The setting method of the RJ71EN71 and addition method of the module label are the same as those of when setting the sending side. (👉 Page 61 Sending side)

3. Set the contents of "Basic Settings" in the following item.

Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ [RJ71EN71] ⇒ [Port 1 Module Parameter (Ethernet)] ⇒ [Basic Settings]

Setting Item	Item	Setting
Own Node Settings	Parameter Setting Method	Parameter Editor
	IP Address	
	IP Address	192 . 0 . 1 . 101
	Subnet Mask	. . .
	Default Gateway	. . .
	Communications by Network No./Station No.	Disable
	Setting Method	Use IP Address
	Network Number	-----
	Station No.	-----
	Transient Transmission Group No.	0
Enable/Disable Online Change	Disable All (SLMP)	
Communication Data Code	Binary	
Opening Method	Do Not Open by Program	
External Device Configuration	External Device Configuration	<Detailed Setting>

4. Set the network configuration in the following item.

Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ [RJ71EN71] ⇒ [Port 1 Module Parameter (Ethernet)] ⇒ [Basic Settings] ⇒ [External Device Configuration]

Ethernet Configuration (Start I/O: 0000)

Ethernet Configuration Edit View Close with Discarding the Setting Close with Reflecting the Setting

No.	Model Name	Communication Method	Protocol	Fixed Buffer Send/Receive Setting	PLC		Sensor/Device					Existence Confirmation
					IP Address	Port No.	MAC Address	Host Name	IP Address	Port No.	Subnet Mask	
	Host Station				192.0.1.101							
1	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.101							KeepAlive
2	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.101							KeepAlive
3	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.101							KeepAlive
4	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.101							KeepAlive
5	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.101							KeepAlive
6	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.101							KeepAlive
7	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.101							KeepAlive
8	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.101							KeepAlive
9	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.101							KeepAlive
10	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.101							KeepAlive
11	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.101							KeepAlive
12	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.101							KeepAlive
13	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.101							KeepAlive
14	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.101							KeepAlive
15	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.101							KeepAlive
16	MELSOFT Connection Module	MELSOFT Connection	TCP		192.0.1.101							KeepAlive
17	Unpassive Connection Module	Socket Communication	TCP		192.0.1.101	4096						KeepAlive

Host Station Connected Count : 17

Connection No. 1 Connection No. 2 Connection No. 3 Connection No. 4 Connection No. 5 Connection No. 6 Connection No. 7 Connection No. 8 Connection No. 9 Connection No. 10 Connection No. 11 Connection No. 12 Connection No. 13 Connection No. 14 Connection No. 15 Connection No. 16 Connection No. 17

MELSOFT C onnection M odule MELSOFT C onnection M odule MELSOFT C onnection M odule MELSOFT C onnection M odule MELSOFT C onnection M odule MELSOFT C onnection M odule MELSOFT C onnection M odule MELSOFT C onnection M odule MELSOFT C onnection M odule MELSOFT C onnection M odule MELSOFT C onnection M odule MELSOFT C onnection M odule MELSOFT C onnection M odule MELSOFT C onnection M odule MELSOFT C onnection M odule Unpassive C onnection M odule

5. Write the set parameters to the CPU module. Then reset the CPU module or power off and on the system.

[Online] ⇒ [Write to PLC]




In this example, default values were used for parameters that are not shown above. For the parameters, refer to the following.


📖 MELSEC iQ-R Ethernet User's Manual (Application)


Program example

Sending side

Classification	Label name	Description	Device																																																																												
Module label	RCPU.stSM.bAlways_ON	Always on	SM400																																																																												
	EN71_EE_1.bnCompletion_ConnectionOpen[17]	Open completion signal (connection No.17)	U0\G1900001.0																																																																												
	EN71_EE_1.bnStatus_ConnectionOpenExecution[17]	Open request signal (connection No.17)	U0\G1900009.0																																																																												
	EN71_EE_1.uCompletion_EthernetInitialized.0	Initial status	U0\G1900024.0																																																																												
Label to be defined	Define global labels as shown below:																																																																														
	<table><tr><th>Label Name</th><th>Data Type</th><th>Class</th><th>Assign (Device/Label)</th></tr><tr><td>bRunRefresh</td><td>Bit</td><td>VAR_GLOBAL ▼</td><td>M0</td></tr><tr><td>bStartOpen</td><td>Bit</td><td>VAR_GLOBAL ▼</td><td>M1</td></tr><tr><td>bStartOpenFB</td><td>Bit</td><td>VAR_GLOBAL ▼</td><td>M20</td></tr><tr><td>bRunOpen</td><td>Bit</td><td>VAR_GLOBAL ▼</td><td>M2</td></tr><tr><td>bOpen_OK</td><td>Bit</td><td>VAR_GLOBAL ▼</td><td>M3</td></tr><tr><td>bOpen_NG</td><td>Bit</td><td>VAR_GLOBAL ▼</td><td>M4</td></tr><tr><td>uOpenErrID</td><td>Word [Unsigned]/Bit String [16-bit]</td><td>VAR_GLOBAL ▼</td><td>D0</td></tr><tr><td>bStartSend</td><td>Bit</td><td>VAR_GLOBAL ▼</td><td>M5</td></tr><tr><td>bRunSend</td><td>Bit</td><td>VAR_GLOBAL ▼</td><td>M6</td></tr><tr><td>bSend_OK</td><td>Bit</td><td>VAR_GLOBAL ▼</td><td>M7</td></tr><tr><td>bSend_NG</td><td>Bit</td><td>VAR_GLOBAL ▼</td><td>M8</td></tr><tr><td>uSendErrID</td><td>Word [Unsigned]/Bit String [16-bit]</td><td>VAR_GLOBAL ▼</td><td>D10</td></tr><tr><td>uSendData</td><td>Word [Unsigned]/Bit String [16-bit](0..3)</td><td>VAR_GLOBAL ▼</td><td>D1000</td></tr><tr><td>bStartClose</td><td>Bit</td><td>VAR_GLOBAL ▼</td><td>M13</td></tr><tr><td>bRunClose</td><td>Bit</td><td>VAR_GLOBAL ▼</td><td>M14</td></tr><tr><td>bClose_OK</td><td>Bit</td><td>VAR_GLOBAL ▼</td><td>M15</td></tr><tr><td>bClose_NG</td><td>Bit</td><td>VAR_GLOBAL ▼</td><td>M16</td></tr><tr><td>uCloseErrID</td><td>Word [Unsigned]/Bit String [16-bit]</td><td>VAR_GLOBAL ▼</td><td>D30</td></tr></table>	Label Name	Data Type	Class	Assign (Device/Label)	bRunRefresh	Bit	VAR_GLOBAL ▼	M0	bStartOpen	Bit	VAR_GLOBAL ▼	M1	bStartOpenFB	Bit	VAR_GLOBAL ▼	M20	bRunOpen	Bit	VAR_GLOBAL ▼	M2	bOpen_OK	Bit	VAR_GLOBAL ▼	M3	bOpen_NG	Bit	VAR_GLOBAL ▼	M4	uOpenErrID	Word [Unsigned]/Bit String [16-bit]	VAR_GLOBAL ▼	D0	bStartSend	Bit	VAR_GLOBAL ▼	M5	bRunSend	Bit	VAR_GLOBAL ▼	M6	bSend_OK	Bit	VAR_GLOBAL ▼	M7	bSend_NG	Bit	VAR_GLOBAL ▼	M8	uSendErrID	Word [Unsigned]/Bit String [16-bit]	VAR_GLOBAL ▼	D10	uSendData	Word [Unsigned]/Bit String [16-bit](0..3)	VAR_GLOBAL ▼	D1000	bStartClose	Bit	VAR_GLOBAL ▼	M13	bRunClose	Bit	VAR_GLOBAL ▼	M14	bClose_OK	Bit	VAR_GLOBAL ▼	M15	bClose_NG	Bit	VAR_GLOBAL ▼	M16	uCloseErrID	Word [Unsigned]/Bit String [16-bit]	VAR_GLOBAL ▼	D30		
Label Name	Data Type	Class	Assign (Device/Label)																																																																												
bRunRefresh	Bit	VAR_GLOBAL ▼	M0																																																																												
bStartOpen	Bit	VAR_GLOBAL ▼	M1																																																																												
bStartOpenFB	Bit	VAR_GLOBAL ▼	M20																																																																												
bRunOpen	Bit	VAR_GLOBAL ▼	M2																																																																												
bOpen_OK	Bit	VAR_GLOBAL ▼	M3																																																																												
bOpen_NG	Bit	VAR_GLOBAL ▼	M4																																																																												
uOpenErrID	Word [Unsigned]/Bit String [16-bit]	VAR_GLOBAL ▼	D0																																																																												
bStartSend	Bit	VAR_GLOBAL ▼	M5																																																																												
bRunSend	Bit	VAR_GLOBAL ▼	M6																																																																												
bSend_OK	Bit	VAR_GLOBAL ▼	M7																																																																												
bSend_NG	Bit	VAR_GLOBAL ▼	M8																																																																												
uSendErrID	Word [Unsigned]/Bit String [16-bit]	VAR_GLOBAL ▼	D10																																																																												
uSendData	Word [Unsigned]/Bit String [16-bit](0..3)	VAR_GLOBAL ▼	D1000																																																																												
bStartClose	Bit	VAR_GLOBAL ▼	M13																																																																												
bRunClose	Bit	VAR_GLOBAL ▼	M14																																																																												
bClose_OK	Bit	VAR_GLOBAL ▼	M15																																																																												
bClose_NG	Bit	VAR_GLOBAL ▼	M16																																																																												
uCloseErrID	Word [Unsigned]/Bit String [16-bit]	VAR_GLOBAL ▼	D30																																																																												

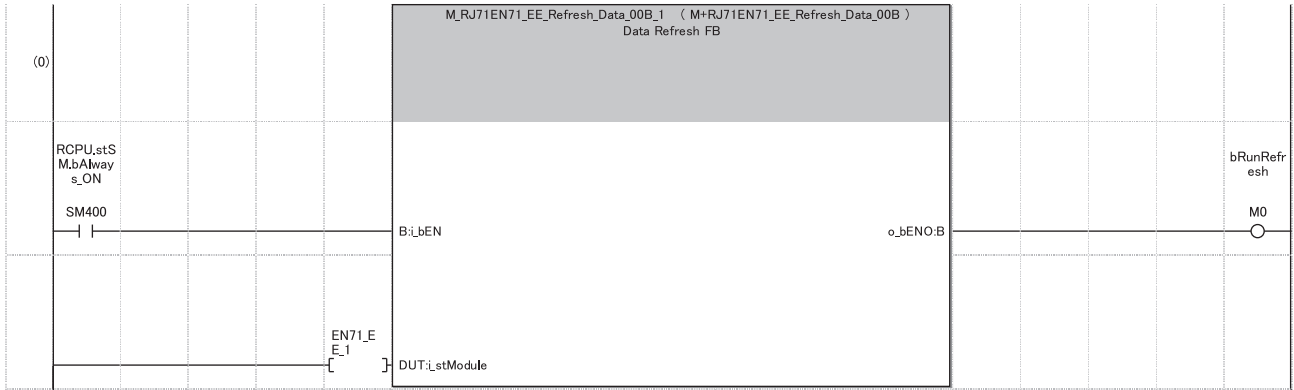

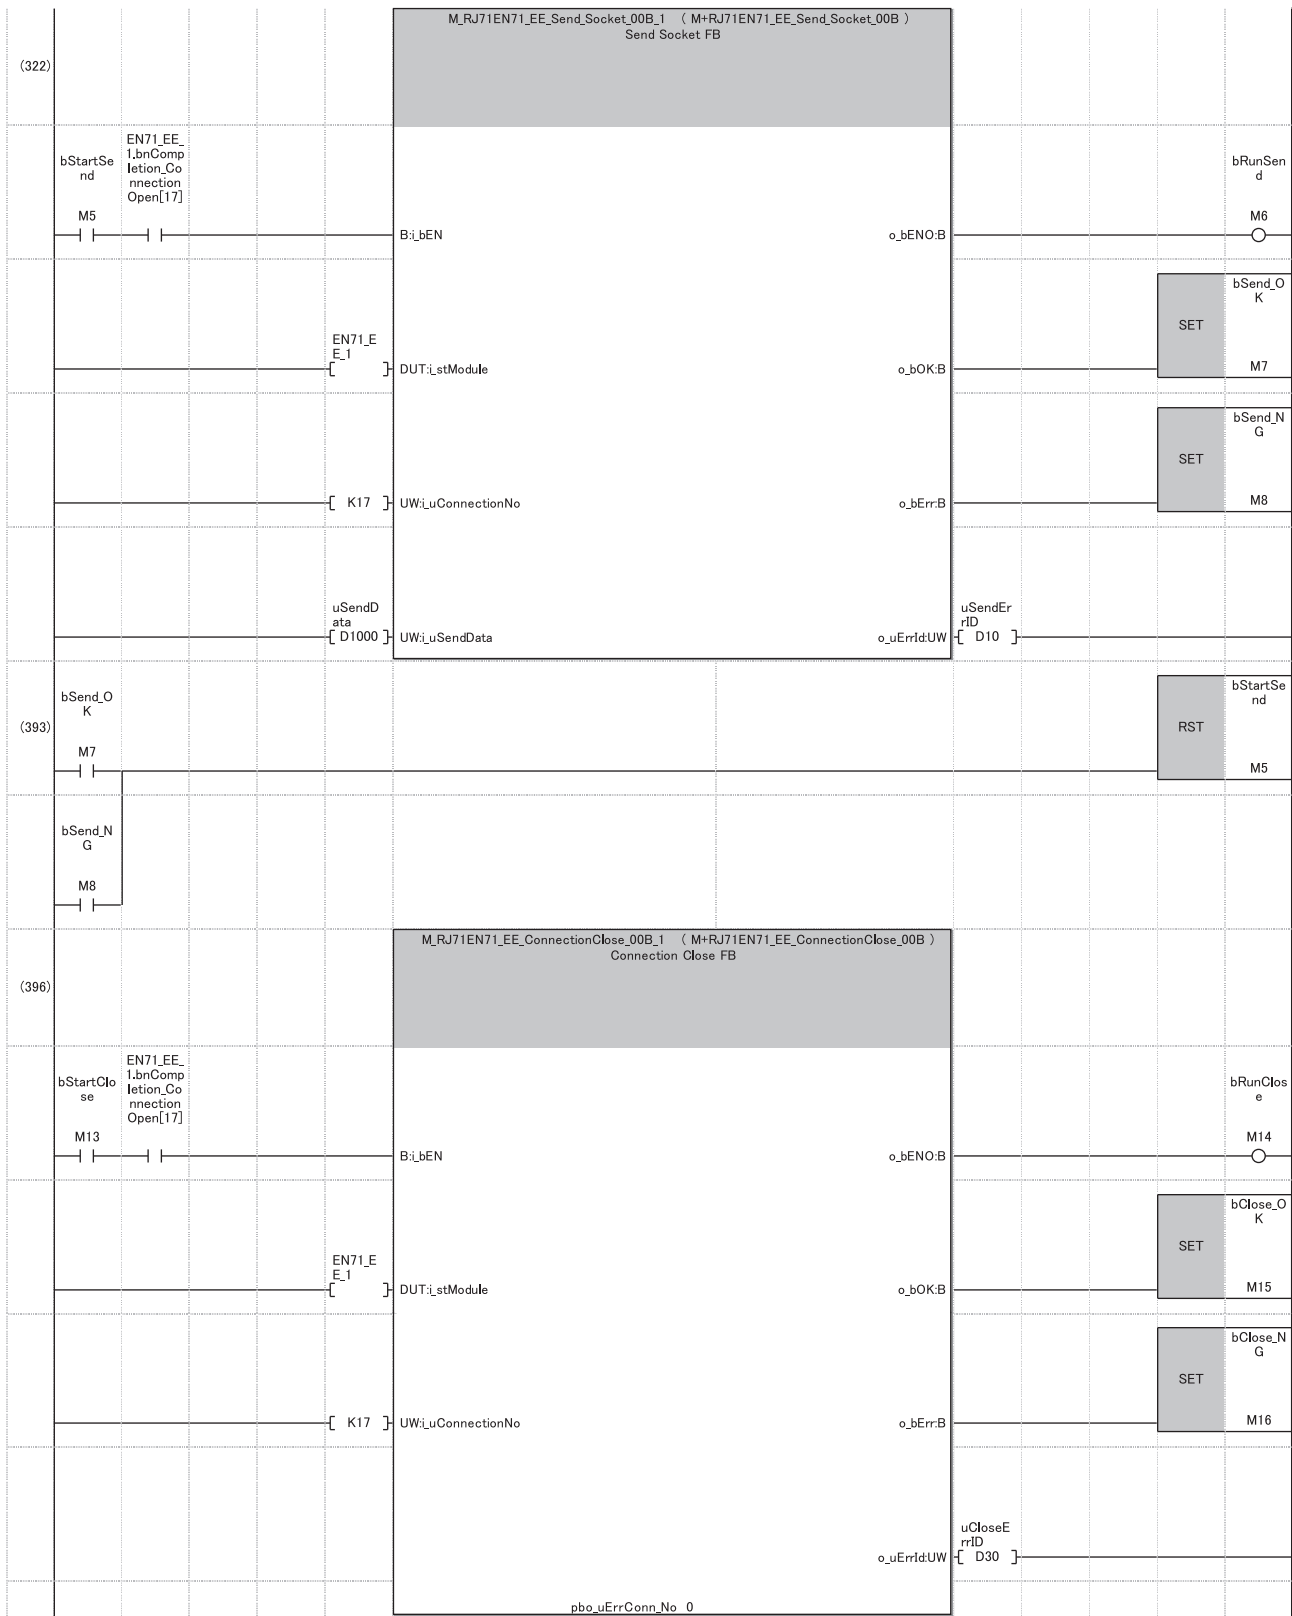


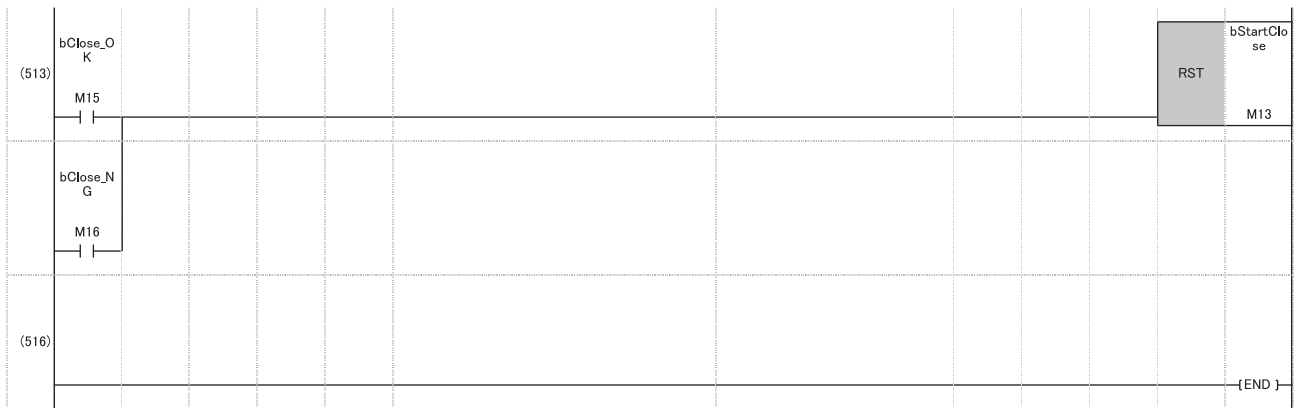


- (0) The refresh processing of the module label is performed. (The processing is required for when using the module function block.*1)
When the refresh processing is completed, 'bRunRefresh' (M0) is turned on.
- (68) When 'bStartOpen' (M1) is turned on, the open processing of connection No.17 is performed.
When the open processing is completed successfully, 'bOpen_OK' (M3) is turned on.
- (280) When 'bStartSend' (M5) is turned on, the send data is stored and data is sent to the external device of connection No.17.
When the data send is completed successfully, 'bSend_OK' (M7) is turned on.
- (396) When 'bStartClose' (M13) is turned on, the close processing of connection No.17 is performed.
When the close processing is completed successfully, 'bClose_OK' (M15) is turned on.
- *1 The refresh processing using the above FB is not required when the Ethernet function of the CPU module (CPU part for the RnENCPU) is used.

Receiving side

Classification	Label name	Description	Device																																				
Module label	RCPU.stSM.bAlways_ON	Always on	SM400																																				
	EN71_EE_1.bnCompletion_ConnectionOpen[17]	Open completion signal (connection No.17)	U0\G1900001.0																																				
	EN71_EE_1.bnCompletion_ReceiveSocket_FixedBuffer[17]	Socket/fixed buffer reception status signal (connection No.17)	U0\G1900017.0																																				
	EN71_EE_1.uCompletion_EthernetInitialized.0	Initial status	U0\G1900024.0																																				
Label to be defined	Define global labels as shown below:																																						
	<table><tr><th>Label Name</th><th>Data Type</th><th>Class</th><th>Assign (Device/Label)</th></tr><tr><td>bRunRefresh</td><td>Bit</td><td>VAR_GLOBAL</td><td>M0</td></tr><tr><td>bStartRecv</td><td>Bit</td><td>VAR_GLOBAL</td><td>M9</td></tr><tr><td>bRunRecv</td><td>Bit</td><td>VAR_GLOBAL</td><td>M10</td></tr><tr><td>bRecv_OK</td><td>Bit</td><td>VAR_GLOBAL</td><td>M11</td></tr><tr><td>bRecv_NG</td><td>Bit</td><td>VAR_GLOBAL</td><td>M12</td></tr><tr><td>uRecvErrID</td><td>Word (Unsigned)/Bit String [16-bit]</td><td>VAR_GLOBAL</td><td>D20</td></tr><tr><td>uRecvData</td><td>Word (Unsigned)/Bit String [16-bit](0..5119)</td><td>VAR_GLOBAL</td><td>D2000</td></tr><tr><td>bStartRecvFB</td><td>Bit</td><td>VAR_GLOBAL</td><td>M17</td></tr></table>			Label Name	Data Type	Class	Assign (Device/Label)	bRunRefresh	Bit	VAR_GLOBAL	M0	bStartRecv	Bit	VAR_GLOBAL	M9	bRunRecv	Bit	VAR_GLOBAL	M10	bRecv_OK	Bit	VAR_GLOBAL	M11	bRecv_NG	Bit	VAR_GLOBAL	M12	uRecvErrID	Word (Unsigned)/Bit String [16-bit]	VAR_GLOBAL	D20	uRecvData	Word (Unsigned)/Bit String [16-bit](0..5119)	VAR_GLOBAL	D2000	bStartRecvFB	Bit	VAR_GLOBAL	M17
Label Name	Data Type	Class	Assign (Device/Label)																																				
bRunRefresh	Bit	VAR_GLOBAL	M0																																				
bStartRecv	Bit	VAR_GLOBAL	M9																																				
bRunRecv	Bit	VAR_GLOBAL	M10																																				
bRecv_OK	Bit	VAR_GLOBAL	M11																																				
bRecv_NG	Bit	VAR_GLOBAL	M12																																				
uRecvErrID	Word (Unsigned)/Bit String [16-bit]	VAR_GLOBAL	D20																																				
uRecvData	Word (Unsigned)/Bit String [16-bit](0..5119)	VAR_GLOBAL	D2000																																				
bStartRecvFB	Bit	VAR_GLOBAL	M17																																				

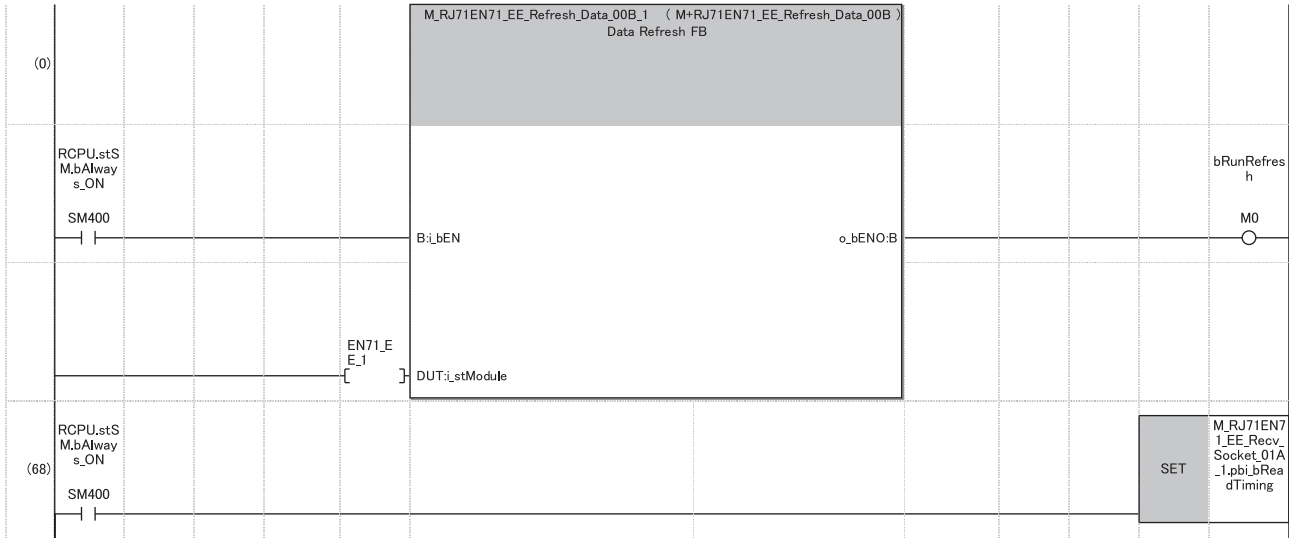

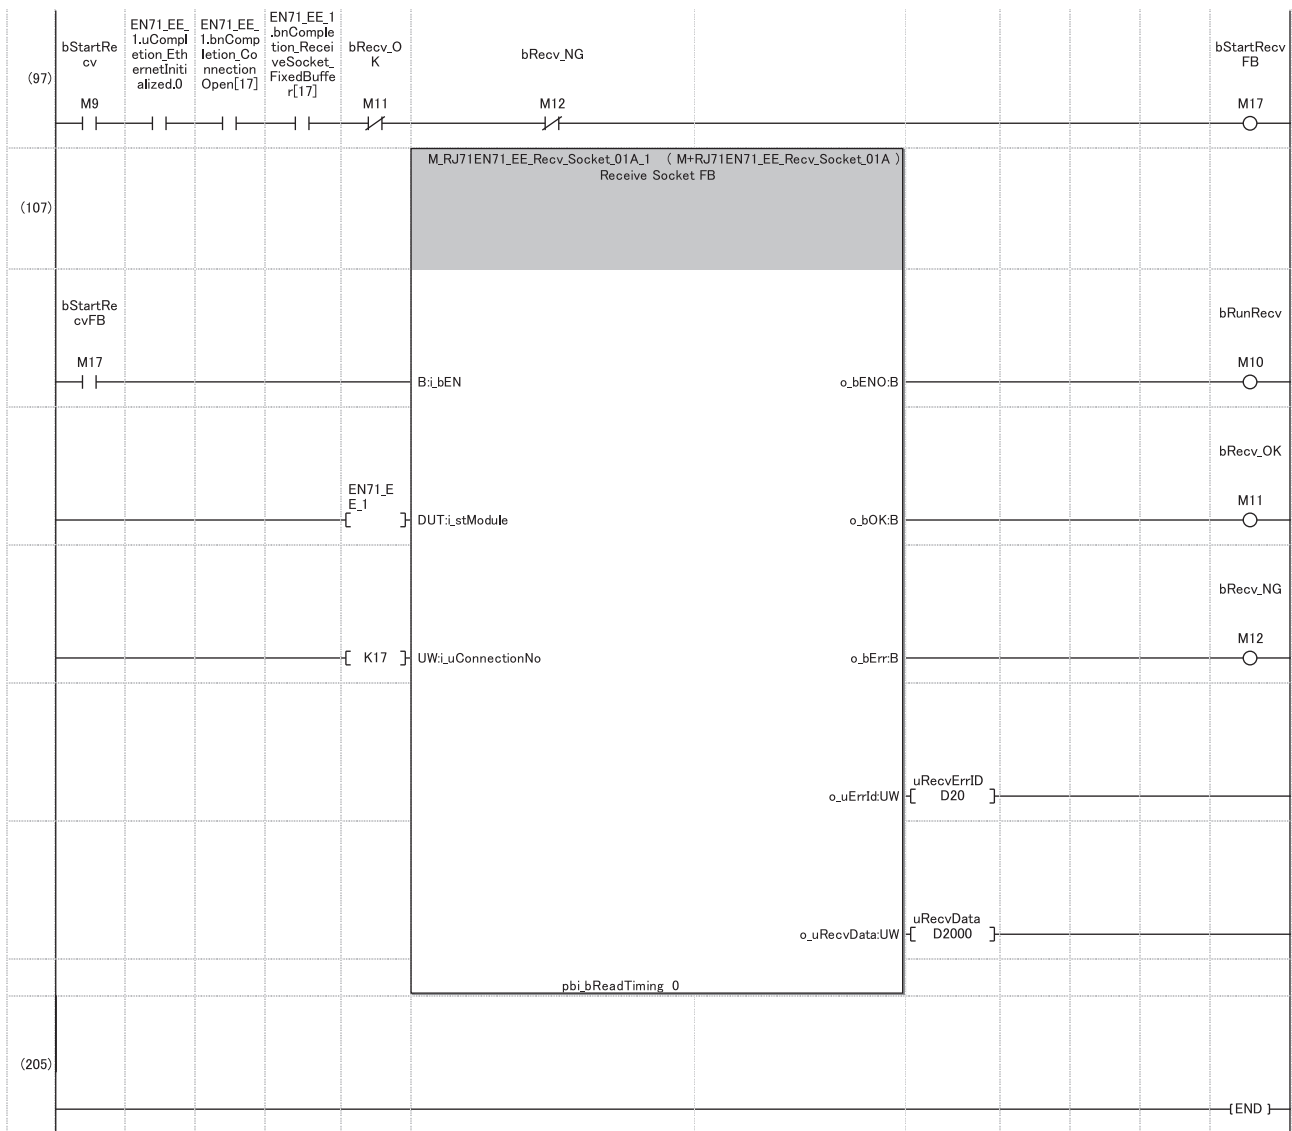

(0) The refresh processing of the module label is performed. (The processing is required for when using the module function block.*1)
When the refresh processing is completed, 'bRunRefresh' (M0) is turned on.

(97) When 'bStartRecv' (M9) is turned on, the data sent by the external device of connection No.17 is received and stored in 'uRecvData' (D2000).
(The device range in which data is stored varies depending on the data length of the received data.)
When the data receive is completed successfully, 'bRecv_OK' (M11) is turned on.

*1 The refresh processing using the above FB is not required when the Ethernet function of the CPU module (CPU part for the RnENCPU) is used.

Point

- Secure sufficient device areas according to the maximum length of data sent from the send source to prevent the device areas used for other purposes from being overwritten by the receive data.
- When the data receive is consecutively executed, turn on pbi_bReadTiming (read timing) as shown in the above program.
- To receive data at shorter intervals than the scan time of the CPU module, add the normally closed contact of 'bRecv_OK' (M11) and 'bRecv_NG' (M12) to the execution conditions of FB for receiving as shown in the above program. When there is no normally closed contact of 'bRecv_OK' (M11) and 'bRecv_NG' (M12), 'bStartRecvFB' (M17) is not turned off and on and the FB for receiving may not be executed.

7.2 Communication Examples of CC-Link IE Controller Network


This section describes communications between the control station and normal station.

System configuration example

The following system configuration is used to explain communication between the control station and normal station.

System configuration

- Power supply module: R61P
- CPU Module: R04CPU
- CC-Link IE Controller Network-equipped module: RJ71GP21-SX
- Input module: RX10
- Output module: RY10R2

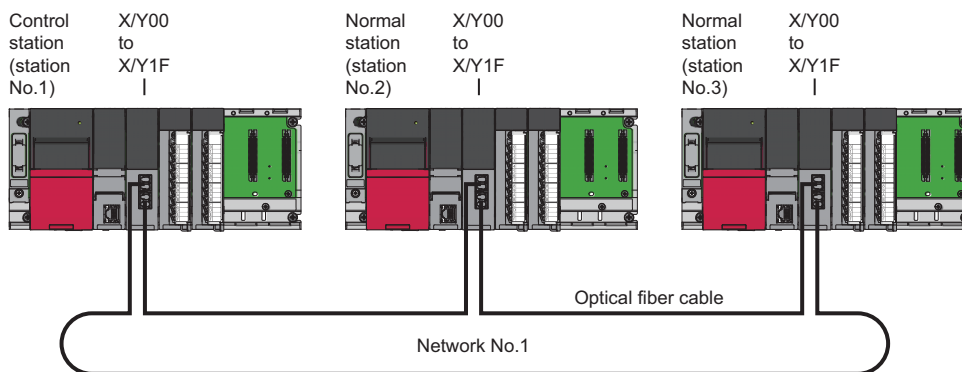


7

Link device assignment


512 points are assigned to each station.

■LB and LW assignment

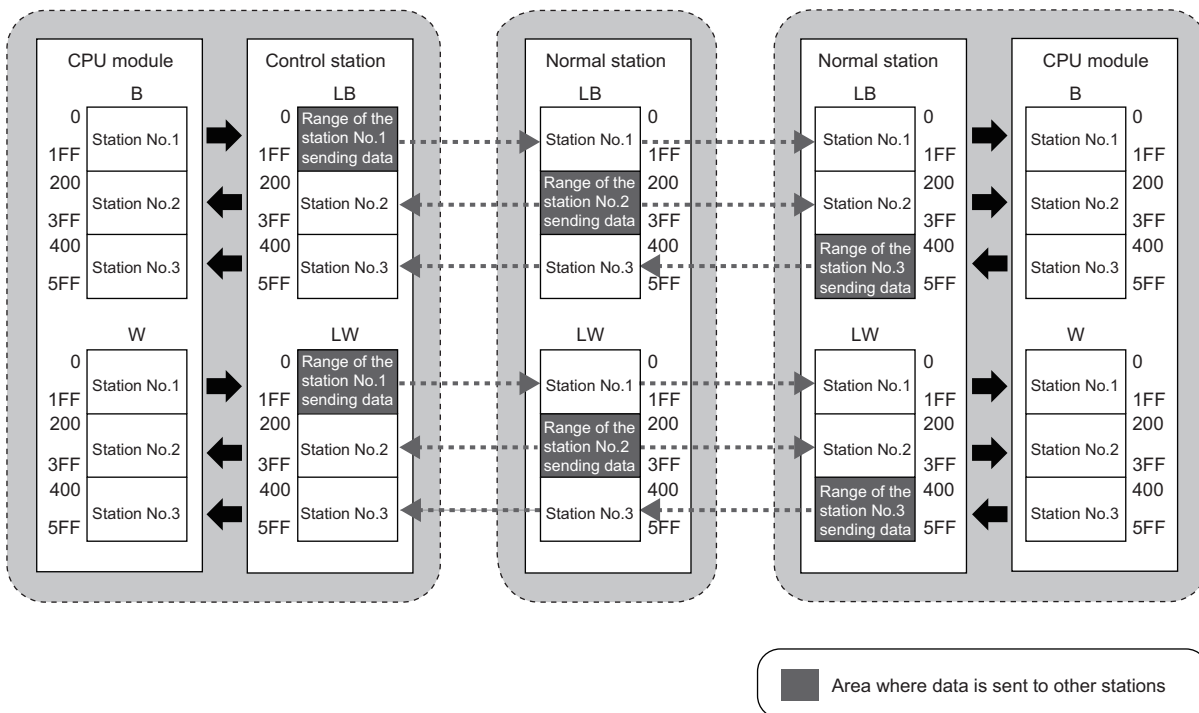


Setting in the control station

Connect the engineering tool to the CPU module on the control station and set the parameters.

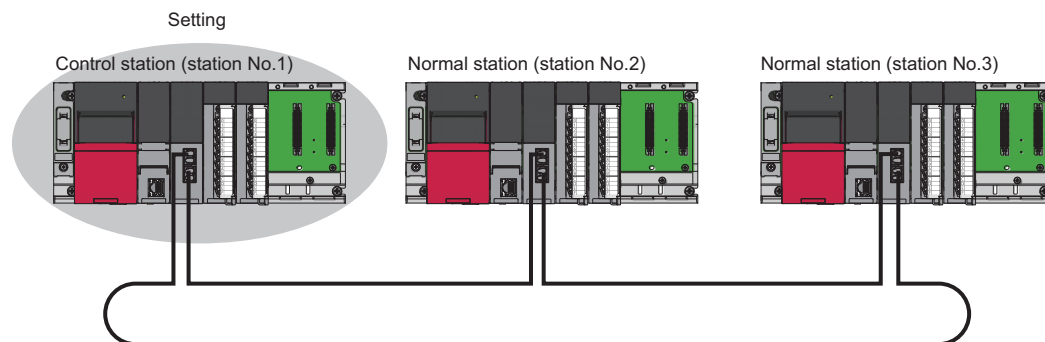


1. Set the CPU module in the following item.

☞ [Project] ⇒ [New]

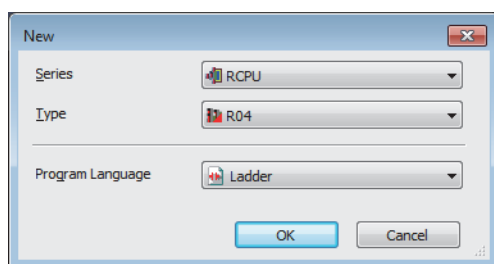


2. Click the [Yes] button to add the module labels of the CPU module.

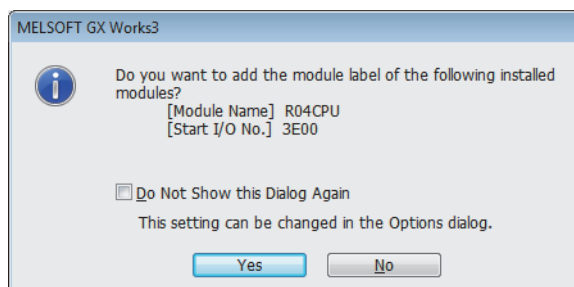


3. Set the CC-Link IE Controller Network-equipped module in the following item.

☞ Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ Right-click ⇒ [Add New Module]

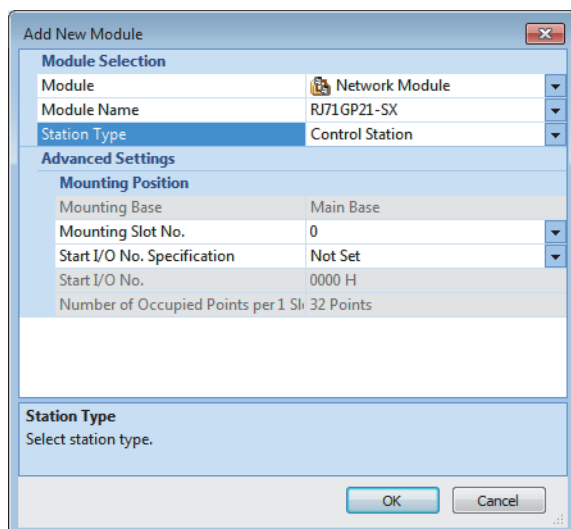

4. Click the [Yes] button to add a module label of the CC-Link IE Controller Network-equipped module.

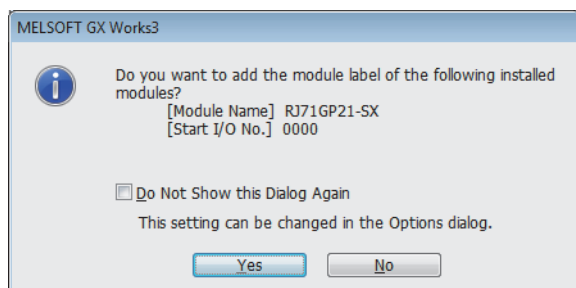

5. Set the contents of "Required Settings" in the following item.

Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ [RJ71GP21-SX] ⇒ [Module Parameter] ⇒ [Required Settings]

Setting Item	
Item	Setting
Station Type	
Station Type	Control Station
Network Number	
Network Number	1
Station Number	
Station No.	1
Network Range Assignment	
Network Range Assignment Setting	<Detailed Setting>

6. Set the network range assignment in the following item.

Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ [RJ71GP21-SX] ⇒ [Module Parameter] ⇒ [Required Settings] ⇒ [Network Number]

Setting Item

Total No. of Stations 3

Switch Windows LB/LW Setting (1)

Batch Setting(G)

Station No.	Station Type	LB/LW Setting (1)						Reserved Station	Pairing	Shared Group
		LB			LW					
		Points	Start	End	Points	Start	End			
1	Control Station	512	0000	01FF	512	00000	001FF	No Setting	Disable	
2	Normal Station	512	0200	03FF	512	00200	003FF	No Setting	Disable	
3	Normal Station	512	0400	05FF	512	00400	005FF	No Setting	Disable	

7. Set the refresh settings in the following item.

Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ [RJ71GP21-SX] ⇒ [Module Parameter] ⇒ [Basic Settings] ⇒ [Refresh Setting]

No.	Link Side						CPU Side				
	Device Name	Points	Start	End			Target	Device Name	Points	Start	End
-	SB	512	00000	001FF			Module Lab				
-	SW	512	00000	001FF			Module Lab				
1	LB	1536	00000	005FF			Device	B	1536	00000	005FF
2	LW	1536	00000	005FF			Device	W	1536	00000	005FF

8. Write the set parameters to the CPU module on the control station. Then reset the CPU module or power off and on the system.

[Online] ⇒ [Write to PLC]

Point

In this example, default values were used for parameters that are not shown above. For the parameters, refer to the following.

📖 MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application)

Setting in the normal stations

Connect the engineering tool to the CPU module on the normal station and set the parameters. Set the station number 2 and 3 to the same setting.

1. Set the CPU module and add a module label of the CPU module. The setting method of the CPU module and addition method of the module label are the same as those of the control station. (☞ Page 72 Setting in the control station)
2. Set the CC-Link IE Controller Network-equipped module in the following item.

☞ Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ Right-click ⇒ [Add New Module]

3. Add a module label of the CC-Link IE Controller Network-equipped module. The addition method of the module label is the same as that of the control station. (☞ Page 72 Setting in the control station)
4. Set the contents of "Required Settings" in the following item. Set "Station No." to 2 or 3.

☞ Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ [RJ71GP21-SX] ⇒ [Module Parameter] ⇒ [Required Settings]

Setting Item	
Item	Setting
Station Type	
Station Type	Normal Station
Network Number	
Network Number	1
Station Number	
Setting Method	Parameter Editor
Station No.	2

5. Set the refresh settings in the following item. Set the station number 2 and 3 of the normal station to the same refresh settings.

☞ Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ [RJ71GP21-SX] ⇒ [Module Parameter] ⇒ [Basic Settings] ⇒ [Refresh Setting]

No.	Link Side					CPU Side				
	Device Name	Points	Start	End		Target	Device Name	Points	Start	End
-	SB	512	00000	001FF	↔	Module Lab				
-	SW	512	00000	001FF	↔	Module Lab				
1	LB	1536	00000	005FF	↔	Device	B	1536	00000	005FF
2	LW	1536	00000	005FF	↔	Device	W	1536	00000	005FF

6. Write the set parameters to the CPU module on the normal station. Then reset the CPU module or power off and on the system.

☞ [Online] ⇒ [Write to PLC]

In this example, default values were used for parameters that are not shown above. For the parameters, refer to the following.

MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application)


Checking the network status

Once parameters are set for the control station and normal station, the CC-Link IE Controller Network diagnostics of the engineering tool can be used to check whether data link is normally operating.

1. Connect the engineering tool to the CPU module on the control station.
2. Start the CC-Link IE Controller Network diagnostics.

[Diagnostics] ⇒ [CC-Link IE Control Diagnostics (Optical Cable)]

If the following display appears, data link is normal.

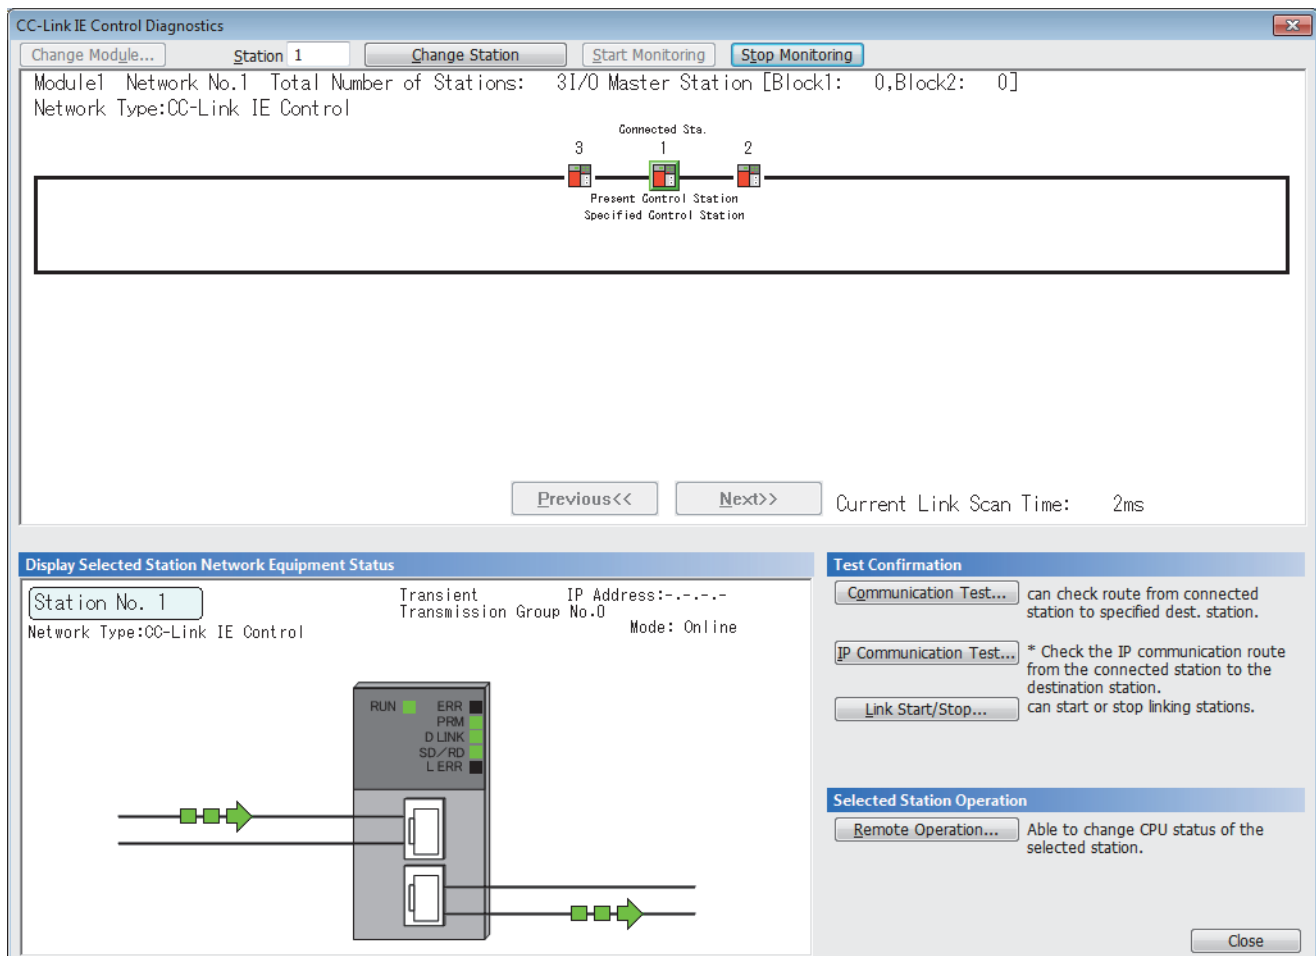

When an icon indicating an error is displayed in "Network information display" in the "CC-Link IE Control Diagnostics", use the CC-Link IE Controller Network diagnostics to identify the cause of the error and take actions. (MELSEC iQ-R CC-Link IE Controller Network User's Manual (Application))

Program example


This section describes program examples.

Program example of cyclic transmission

The following shows a program example of cyclic transmission.

■Overview of the program example

D0 of the control station (station No.1) is sent to Y50 to Y5F of the normal station (station No.2) through cyclic transmission. In the program example, an interlock is established with link relay (LB) and cyclic data is sent.

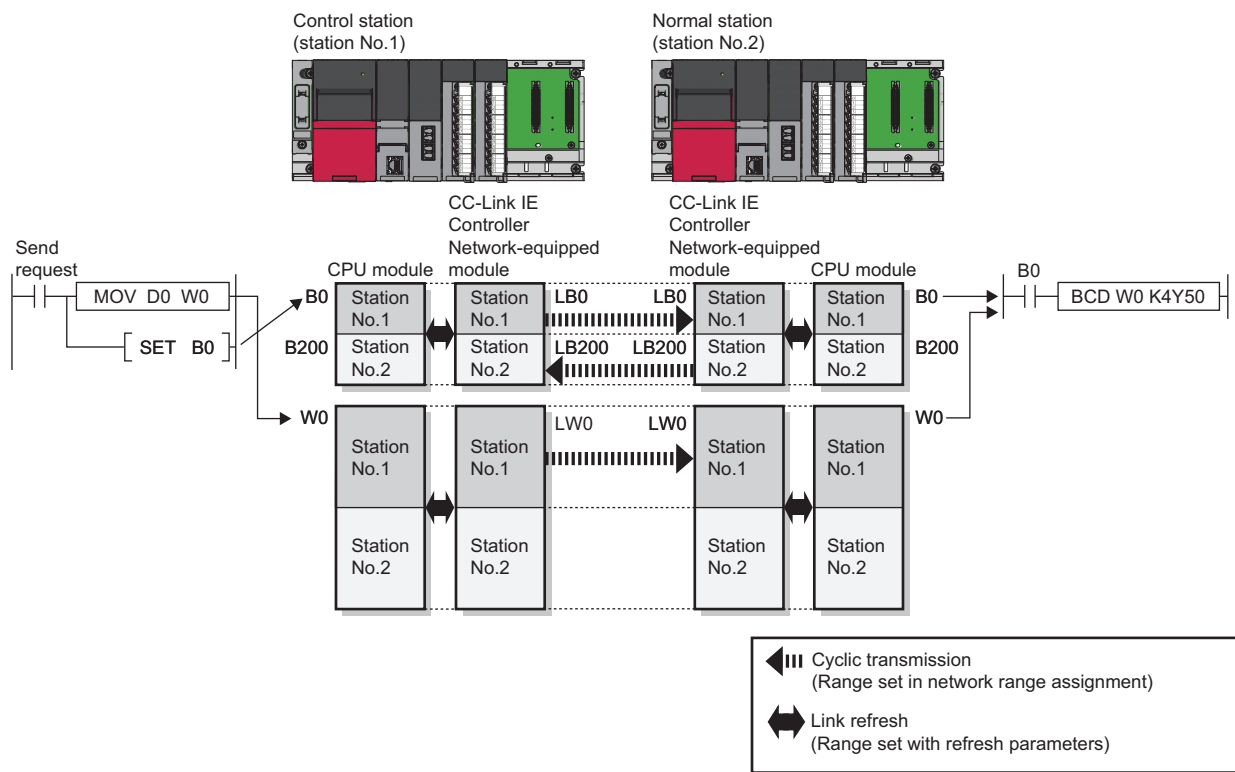


■Program example

When creating a cyclic communication program, establish an interlock using 'Data link error status of own station' (SB0049) and 'Data link status of each station' (SW00B0 to SW00B7).

- Control station (station No.1)


Classification	Label name	Description	Device																																											
Module label	GP21_1.bDetect_DataLinkError	Data link error status of own station	SB0049																																											
	GP21_1.bnSts_CyclicTransmissionError_Station[2]	Data link status of each station (station No.2)	SW00B0.1																																											
Label to be defined	Define global labels as shown below:																																													
	<table><thead><tr><th></th><th>Label Name</th><th>Data Type</th><th></th><th>Class</th><th>Assign (Device/Label)</th></tr></thead><tbody><tr><td>1</td><td>bSendRequest</td><td>Bit</td><td>VAR_GLOBAL</td><td>▼</td><td>M300</td></tr><tr><td>2</td><td>bCommunicationFlag</td><td>Bit</td><td>VAR_GLOBAL</td><td>▼</td><td>M310</td></tr><tr><td>3</td><td>bHandShake1</td><td>Bit</td><td>VAR_GLOBAL</td><td>▼</td><td>B0</td></tr><tr><td>4</td><td>bHandShake2</td><td>Bit</td><td>VAR_GLOBAL</td><td>▼</td><td>B200</td></tr><tr><td>5</td><td>uData</td><td>Word [Unsigned]/Bit String [16-bit]</td><td>VAR_GLOBAL</td><td>▼</td><td>W0</td></tr><tr><td>6</td><td>uOutputData</td><td>Word [Unsigned]/Bit String [16-bit]</td><td>VAR_GLOBAL</td><td>▼</td><td>D0</td></tr></tbody></table>		Label Name	Data Type		Class	Assign (Device/Label)	1	bSendRequest	Bit	VAR_GLOBAL	▼	M300	2	bCommunicationFlag	Bit	VAR_GLOBAL	▼	M310	3	bHandShake1	Bit	VAR_GLOBAL	▼	B0	4	bHandShake2	Bit	VAR_GLOBAL	▼	B200	5	uData	Word [Unsigned]/Bit String [16-bit]	VAR_GLOBAL	▼	W0	6	uOutputData	Word [Unsigned]/Bit String [16-bit]	VAR_GLOBAL	▼	D0			
	Label Name	Data Type		Class	Assign (Device/Label)																																									
1	bSendRequest	Bit	VAR_GLOBAL	▼	M300																																									
2	bCommunicationFlag	Bit	VAR_GLOBAL	▼	M310																																									
3	bHandShake1	Bit	VAR_GLOBAL	▼	B0																																									
4	bHandShake2	Bit	VAR_GLOBAL	▼	B200																																									
5	uData	Word [Unsigned]/Bit String [16-bit]	VAR_GLOBAL	▼	W0																																									
6	uOutputData	Word [Unsigned]/Bit String [16-bit]	VAR_GLOBAL	▼	D0																																									

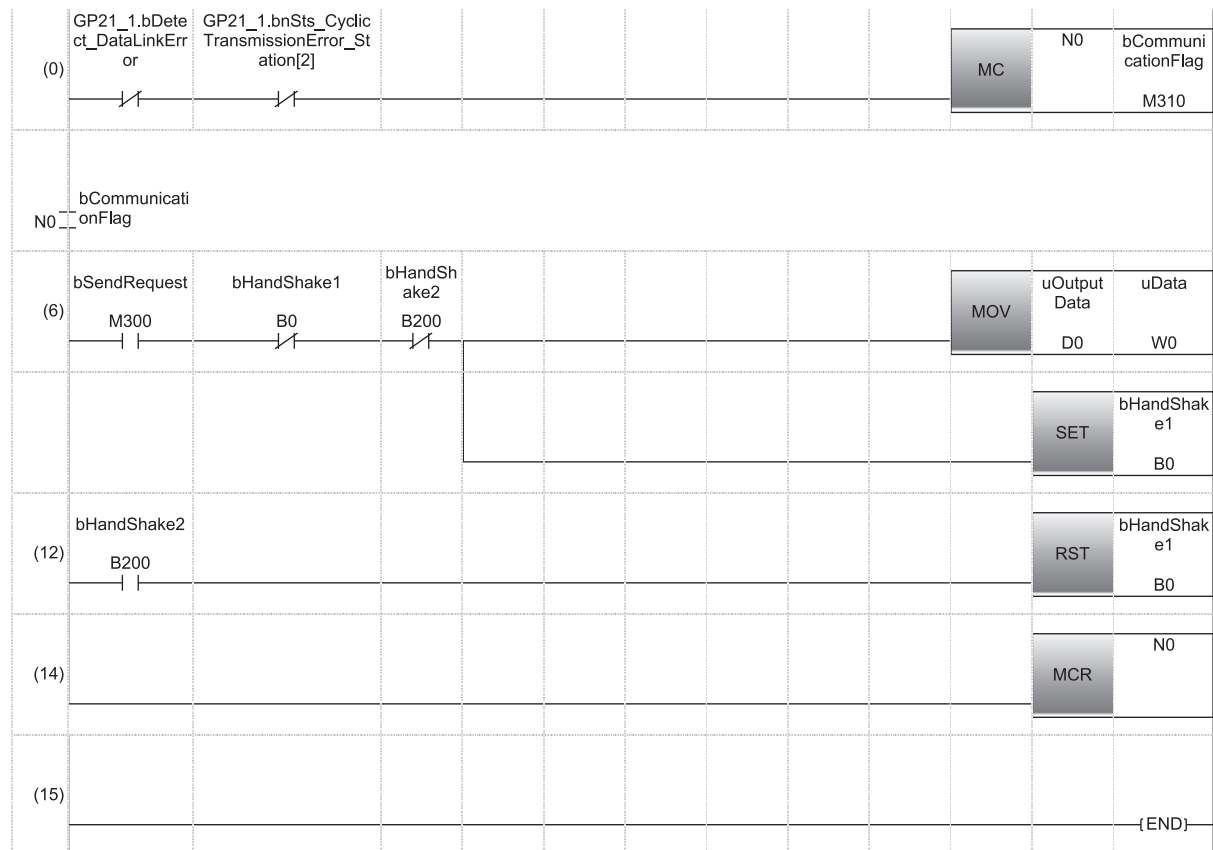

- (6) When 'bSendRequest' (M300) is turned on, the contents of 'uOutputData' (D0) is stored in 'uData' (W0).
 When data storage is completed, 'bHandShake1' (B0) is turned on.
 Link relay (LB) is sent through cyclic transmission after link register (LW).
- (12) When data are sent to the receiving station and 'bHandShake2' (B200) is turned on, 'bHandShake1' (B0) is turned off.

• Normal station (station No.2)

Classification	Label name	Description	Device																														
Module label	GP21_1.bDetect_DataLinkError	Data link error status of own station	SB0049																														
	GP21_1.bnSts_CyclicTransmissionError_Station[1]	Data link status of each station (station No.1)	SW00B0.0																														
Label to be defined	Define global labels as shown below:																																
	<table><tr><th></th><th>Label Name</th><th>Data Type</th><th>Class</th><th>Assign (Device/Label)</th></tr><tr><td>1</td><td>bCommunicationFlag</td><td>Bit</td><td>VAR_GLOBAL</td><td>M311</td></tr><tr><td>2</td><td>bHandShake1</td><td>Bit</td><td>VAR_GLOBAL</td><td>B0</td></tr><tr><td>3</td><td>bHandShake2</td><td>Bit</td><td>VAR_GLOBAL</td><td>B200</td></tr><tr><td>4</td><td>uData</td><td>Word [Unsigned]/Bit String [16-bit]</td><td>VAR_GLOBAL</td><td>W0</td></tr><tr><td>5</td><td>uOutputData</td><td>Word [Unsigned]/Bit String [16-bit]</td><td>VAR_GLOBAL</td><td>K4Y50</td></tr></table>		Label Name	Data Type	Class	Assign (Device/Label)	1	bCommunicationFlag	Bit	VAR_GLOBAL	M311	2	bHandShake1	Bit	VAR_GLOBAL	B0	3	bHandShake2	Bit	VAR_GLOBAL	B200	4	uData	Word [Unsigned]/Bit String [16-bit]	VAR_GLOBAL	W0	5	uOutputData	Word [Unsigned]/Bit String [16-bit]	VAR_GLOBAL	K4Y50		
	Label Name	Data Type	Class	Assign (Device/Label)																													
1	bCommunicationFlag	Bit	VAR_GLOBAL	M311																													
2	bHandShake1	Bit	VAR_GLOBAL	B0																													
3	bHandShake2	Bit	VAR_GLOBAL	B200																													
4	uData	Word [Unsigned]/Bit String [16-bit]	VAR_GLOBAL	W0																													
5	uOutputData	Word [Unsigned]/Bit String [16-bit]	VAR_GLOBAL	K4Y50																													

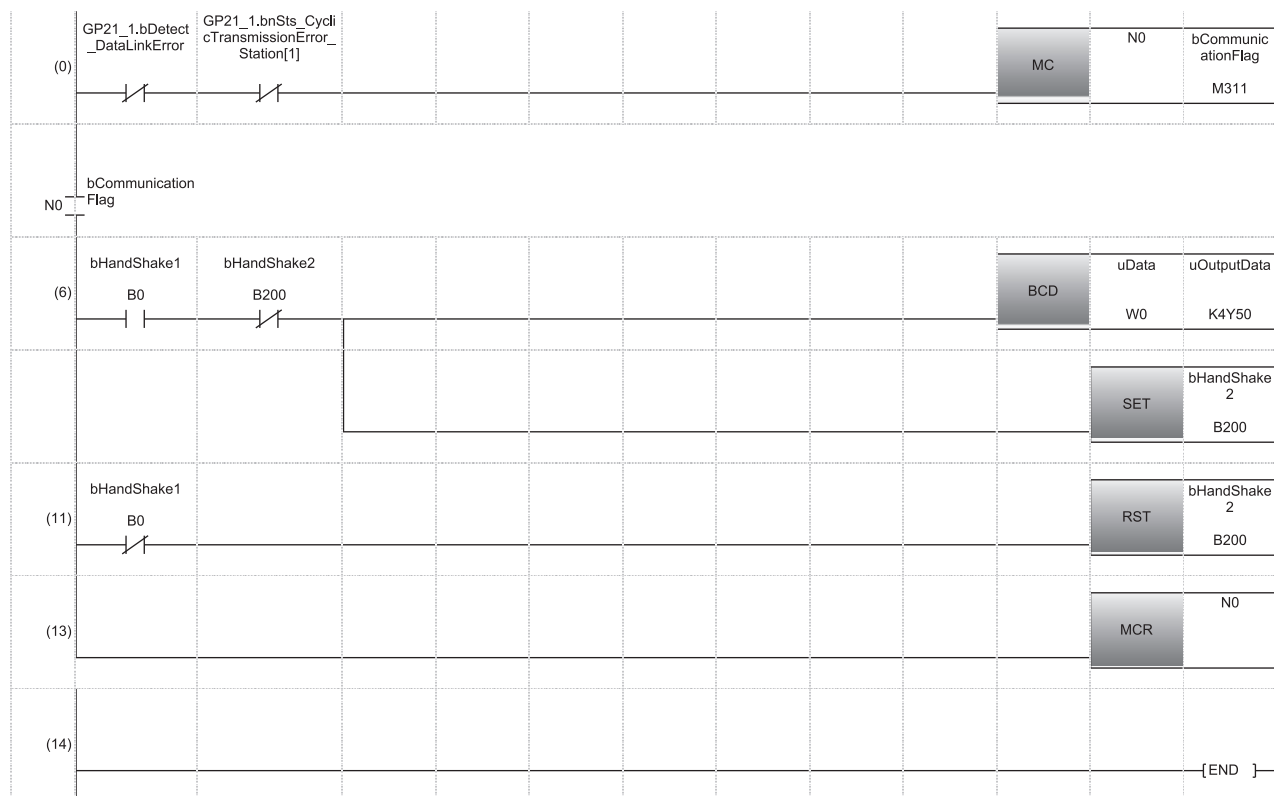

- (6) When 'bHandShake1' (B0) is turned on, the contents of 'uData' (W0) is stored in 'uOutputData' (Y50 to Y5F). When data storage is completed, 'bHandShake2' (B200) is turned on.

Program example of error detection in other stations

■Data flow

In the program example, the baton pass status and cyclic transmission status of each station is monitored and some network errors in other stations are detected in a system configured with three stations.


Point

- When a disconnection or a reconnection of stations is detected, the CC-Link IE Controller Network executes the line control in all stations to reconstruct the loop.
- During the line control processing, the 'Baton pass status of each station' (SW00A0 to SW00A7) and 'Data link status of each station' (SW00B0 to SW00B7) are turned on for up to 100ms. (Normally for up to 50ms.) Therefore, set a value of error monitoring timer to more than 100ms and within the allowable range of your system.

■Program example

The setting value of error monitoring timer is 200ms.

Classification	Label name	Description	Device																									
Module label	GP21_1.bDetect_BatonPassError	Baton pass error status of own station	SB0047																									
	GP21_1.bDetect_DataLinkError	Data link error status of own station	SB0049																									
	GP21_1.bnSts_BatonPassError_Station[1]	Baton pass status of each station (station No.1)	SW00A0.0																									
	GP21_1.bnSts_BatonPassError_Station[2]	Baton pass status of each station (station No.2)	SW00A0.1																									
	GP21_1.bnSts_BatonPassError_Station[3]	Baton pass status of each station (station No.3)	SW00A0.2																									
	GP21_1.bnSts_CyclicTransmissionError_Station[1]	Data link status of each station (station No.1)	SW00B0.0																									
	GP21_1.bnSts_CyclicTransmissionError_Station[2]	Data link status of each station (station No.2)	SW00B0.1																									
	GP21_1.bnSts_CyclicTransmissionError_Station[3]	Data link status of each station (station No.3)	SW00B0.2																									
Label to be defined	Define global labels as shown below:																											
	<table><thead><tr><th></th><th>Label Name</th><th>Data Type</th><th>Class</th><th>Assign (Device/Label)</th></tr></thead><tbody><tr><td>1</td><td>bOwnStationNormal</td><td>Bit</td><td>VAR_GLOBAL</td><td>M10</td></tr><tr><td>2</td><td>bErrorStationExist</td><td>Bit</td><td>VAR_GLOBAL</td><td>M20</td></tr><tr><td>3</td><td>tErrorCheckTimer</td><td>Timer(0..2)</td><td>VAR_GLOBAL</td><td>T0</td></tr><tr><td>4</td><td>wErrorCount</td><td>Word [Signed]</td><td>VAR_GLOBAL</td><td>D100</td></tr></tbody></table>		Label Name	Data Type	Class	Assign (Device/Label)	1	bOwnStationNormal	Bit	VAR_GLOBAL	M10	2	bErrorStationExist	Bit	VAR_GLOBAL	M20	3	tErrorCheckTimer	Timer(0..2)	VAR_GLOBAL	T0	4	wErrorCount	Word [Signed]	VAR_GLOBAL	D100		
	Label Name	Data Type	Class	Assign (Device/Label)																								
1	bOwnStationNormal	Bit	VAR_GLOBAL	M10																								
2	bErrorStationExist	Bit	VAR_GLOBAL	M20																								
3	tErrorCheckTimer	Timer(0..2)	VAR_GLOBAL	T0																								
4	wErrorCount	Word [Signed]	VAR_GLOBAL	D100																								

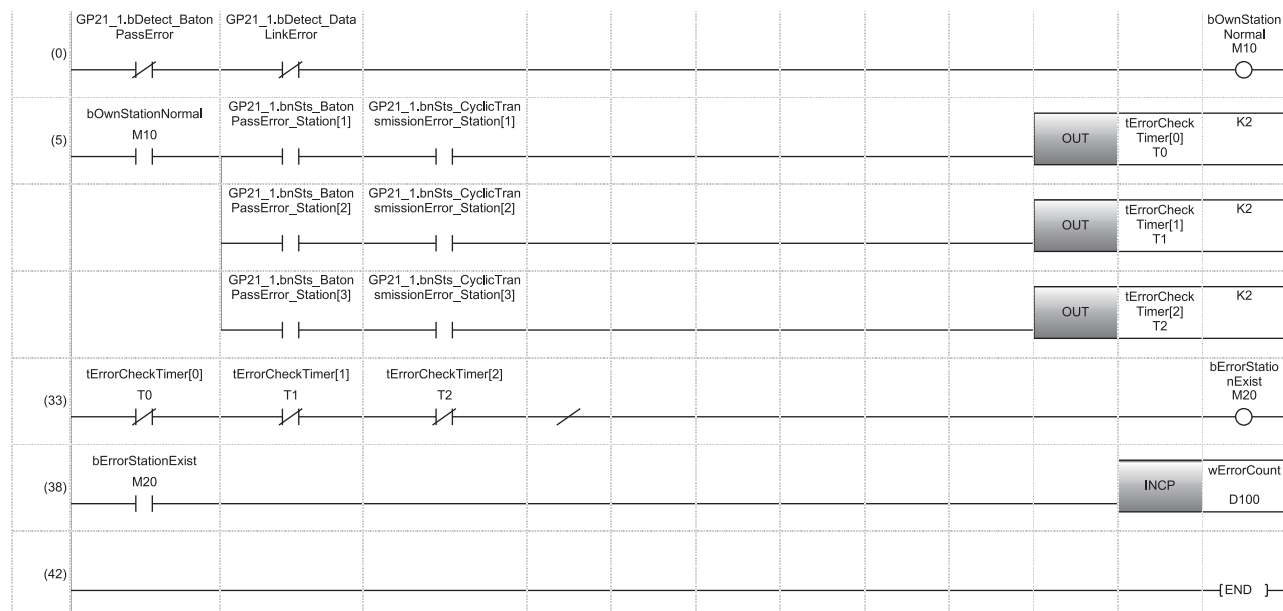

(38) Processing program for error detection

7.3 Communication Examples of CC-Link IE Field Network


This section describes communications between the master station and local station.

System configuration example

The following system configuration is used to explain communication between the master station and local station.

System configuration


- Power supply module: R61P
- CPU Module: R04CPU
- Master/local module: RJ71GF11-T2
- Input module: RX10
- Output module: RY10R2

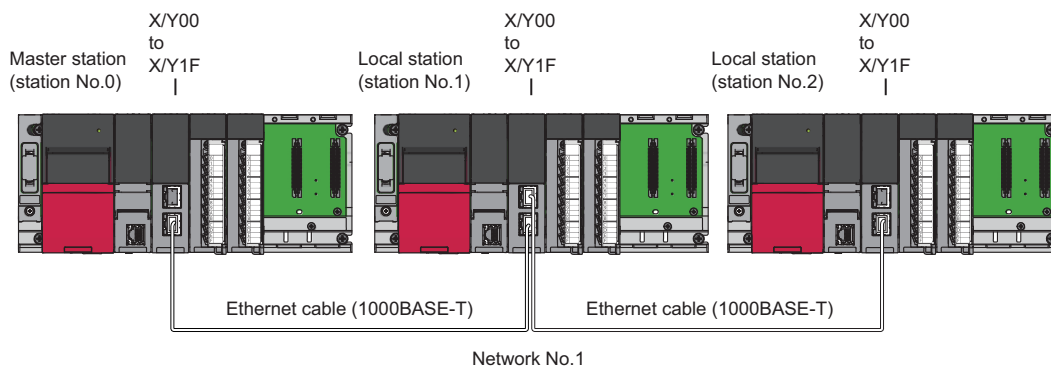


Link device assignment

256 points are assigned to each station.

■RX/RX assignment

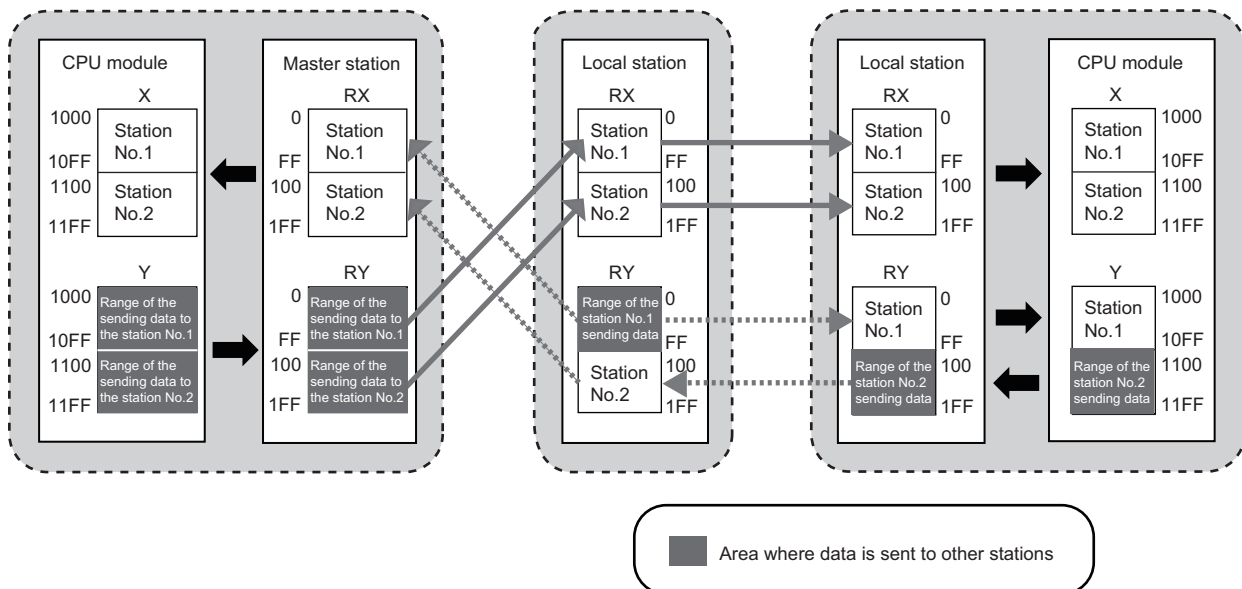


■RWr/RWw assignment

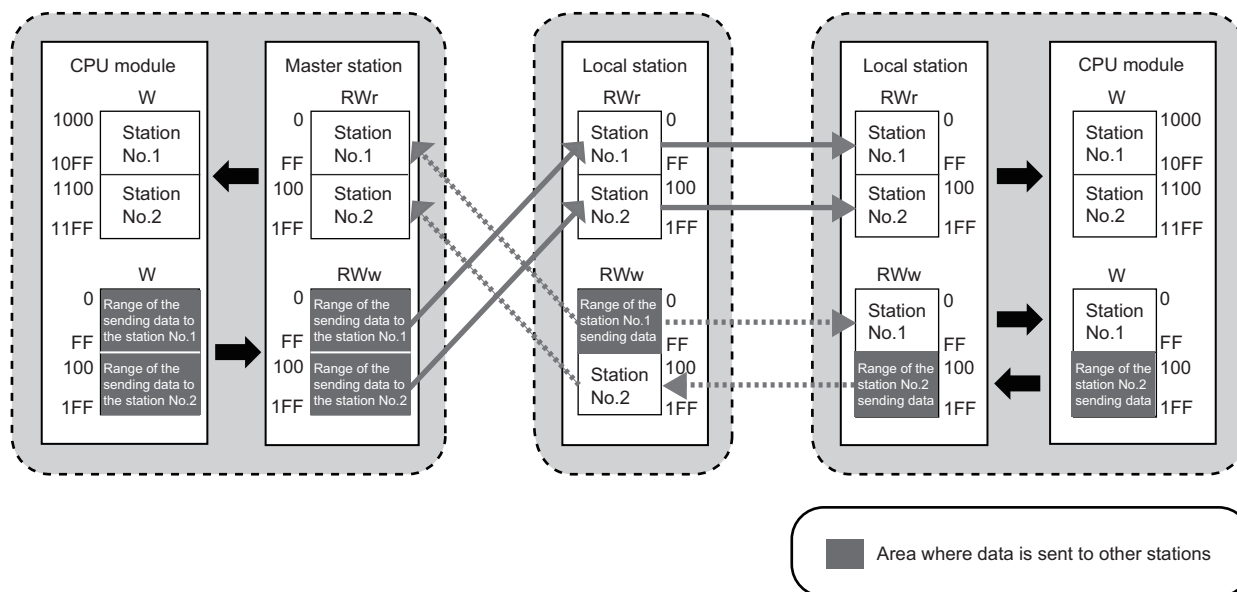


Setting in the master station

Connect the engineering tool to the CPU module on the master station and set the parameters.

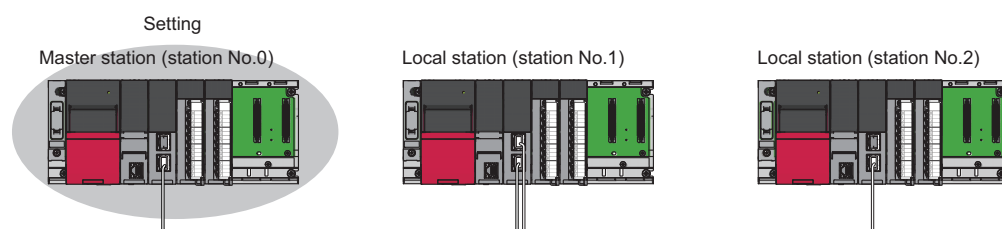


1. Set the CPU module in the following item.

[Project] ⇄ [New]

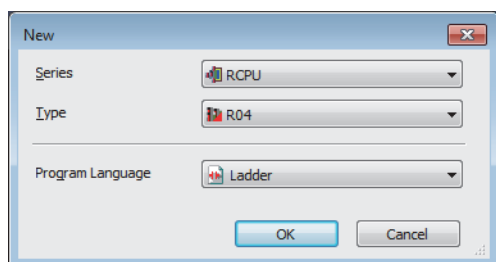


2. Click the [Yes] button to add the module labels of the CPU module.

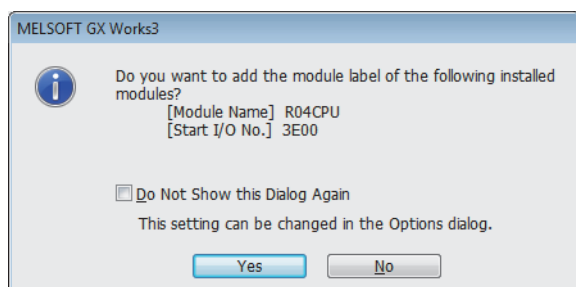


3. Set the master/local module in the following item.

Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ Right-click ⇒ [Add New Module]

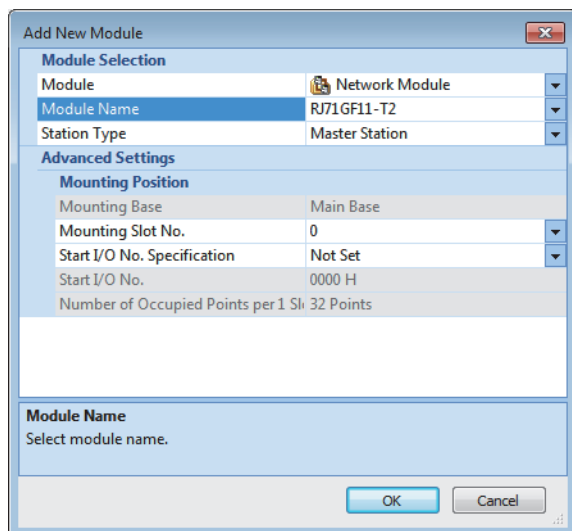

The "Add New Module" dialog box is shown. It has a "Module Selection" section with dropdowns for "Module" (Network Module), "Module Name" (RJ71GF11-T2), and "Station Type" (Master Station). Below this is an "Advanced Settings" section with a "Mounting Position" subsection containing fields for "Mounting Base" (Main Base), "Mounting Slot No." (0), "Start I/O No. Specification" (Not Set), "Start I/O No." (0000 H), and "Number of Occupied Points per 1 Slot" (32 Points). At the bottom, there is a "Module Name" label and a text field with the placeholder "Select module name." and "OK" and "Cancel" buttons.

4. Click the [Yes] button to add the module labels of the master/local module.

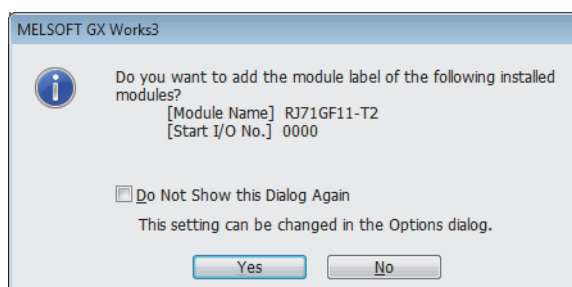

The "MELSOFT GX Works3" dialog box is shown. It contains an information icon and the text: "Do you want to add the module label of the following installed modules?" followed by "[Module Name] RJ71GF11-T2" and "[Start I/O No.] 0000". There is a checkbox labeled "Do Not Show this Dialog Again" with the note "This setting can be changed in the Options dialog." at the bottom. "Yes" and "No" buttons are at the bottom.


5. Set the contents of "Required Settings" in the following item.

Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ [RJ71GF11-T2] ⇒ [Module Parameter] ⇒ [Required Settings]

Setting Item	
Item	Setting
Station Type	
Station Type	Master Station
Network Number	
Network Number	1
Station Number	
Setting Method	Parameter Editor
Station No.	0
Parameter Setting Method	
Setting Method of Basic/Application Settings	Parameter Editor

6. Set the network configuration in the following item.

Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ [RJ71GF11-T2] ⇒ [Module Parameter] ⇒ [Basic Settings]
⇒ [Network Configuration Settings]

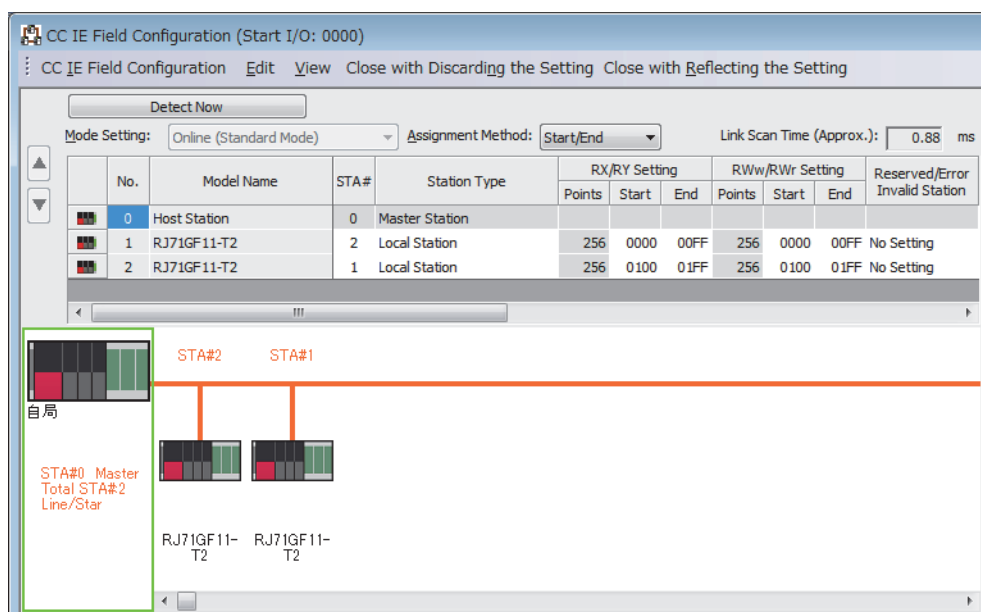

7. Set the refresh settings in the following item.

Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ [RJ71GF11-T2] ⇒ [Module Parameter] ⇒ [Basic Settings]
⇒ [Refresh Setting]

No.	Link Side					CPU Side				
	Device Name	Points	Start	End		Target	Device Name	Points	Start	End
-	SB	512	00000	001FF	↔	Module Lab				
-	SW	512	00000	001FF	↔	Module Lab				
1	RX	512	00000	001FF	↔	Device	X	512	01000	011FF
2	RY	512	00000	001FF	↔	Device	Y	512	01000	011FF
3	RWw	512	00000	001FF	↔	Device	W	512	01000	011FF
4	RWw	512	00000	001FF	↔	Device	W	512	00000	001FF

8. Write the set parameters to the CPU module on the master station. Then reset the CPU module or power off and on the system.

[Online] ⇒ [Write to PLC]


Point

In this example, default values were used for parameters that are not shown above. For the parameters, refer to the following.

📖 MELSEC iQ-R CC-Link IE Field Network User's Manual (Application)

Setting in the local station

Connect the engineering tool to the CPU module on the local station and set the parameters. Set the station number 1 and 2 to the same setting.

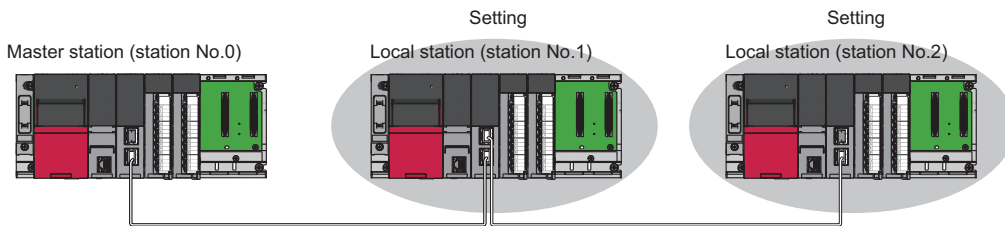

1. Set the CPU module and add a module label of the CPU module. The setting method of the CPU module and addition method of the module label are the same as those of the master station. (Page 81 Setting in the master station)
2. Set the master/local module in the following item.

Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ Right-click ⇒ [Add New Module]

Add New Module

Module Selection

Module: Network Module

Module Name: RJ71GF11-T2

Station Type: Local Station

Advanced Settings

Mounting Position

Mounting Base: Main Base

Mounting Slot No.: 0

Start I/O No. Specification: Not Set

Start I/O No.: 0000 H

Number of Occupied Points per 1 Slot: 32 Points

Module Name

Select module name.

OK Cancel

3. Add a module label of the master/local module. The addition method of the module label is the same as that of the master station. (Page 81 Setting in the master station)
4. Set the contents of "Required Settings" in the following item. For station No.2, set "Station No." to "2".

Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ [RJ71GF11-T2] ⇒ [Module Parameter] ⇒ [Required Settings]

Setting Item	
Item	Setting
Station Type	
Station Type	Local Station
Network Number	
Network Number	1
Station Number	
Setting Method	Parameter Editor
Station No.	1
Parameter Setting Method	
Setting Method of Basic/Application Settings	Parameter Editor

- Set the refresh settings in the following item. Set the station number 1 and 2 of the local station to the same refresh settings.

Navigation window ⇒ [Parameter] ⇒ [Module Information] ⇒ [RJ71GF11-T2] ⇒ [Module Parameter] ⇒ [Basic Settings]
⇒ [Refresh Setting]

No.	Link Side					CPU Side				
	Device Name	Points	Start	End		Target	Device Name	Points	Start	End
-	SB	512	00000	001FF		Module Lab				
-	SW	512	00000	001FF		Module Lab				
1	RX	512	00000	001FF		Device	X	512	01000	011FF
2	RY	512	00000	001FF		Device	Y	512	01000	011FF
3	RWr	512	00000	001FF		Device	W	512	01000	011FF
4	RWw	512	00000	001FF		Device	W	512	00000	001FF

- Write the set parameters to the CPU module on the local station. Then reset the CPU module or power off and on the system.

[Online] ⇒ [Write to PLC]

Point

In this example, default values were used for parameters that are not shown above. For the parameters, refer to the following.

📖 MELSEC iQ-R CC-Link IE Field Network User's Manual (Application)


Checking the network status

Once parameters are set for the master station and local station, the CC-Link IE Field Network diagnostics of the engineering tool can be used to check whether data link is normally operating.

1. Connect the engineering tool to the CPU module on the master station.
2. Start the CC-Link IE Field Network diagnostics.

 [Diagnostics] ⇒ [CC-Link IE Field Diagnostics]

If the following display appears, data link is normal.

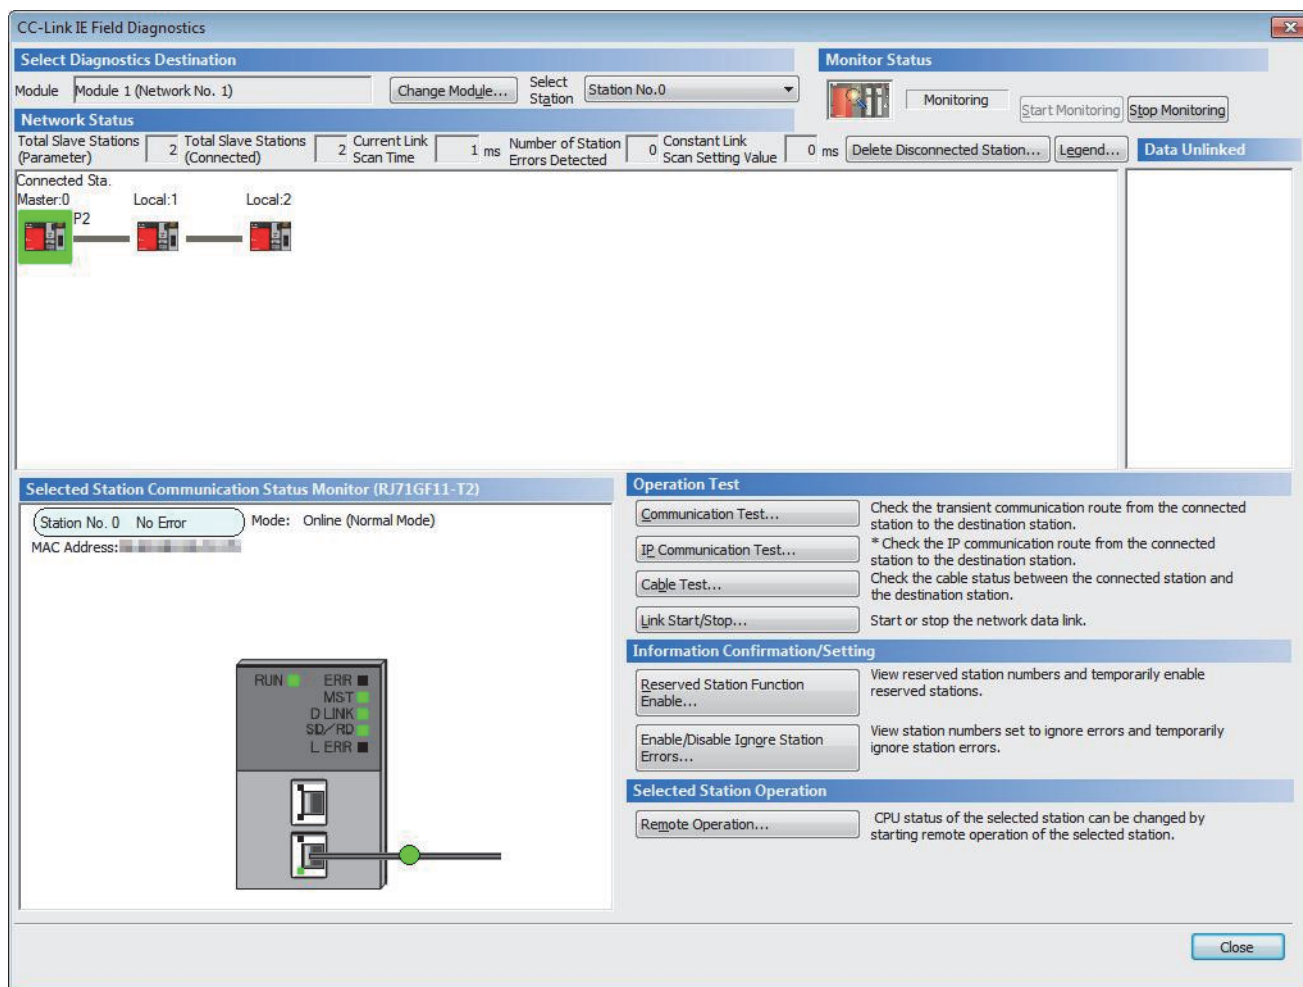


When an icon indicating an error is displayed in "Network Status" in "CC-Link IE Field Diagnostics", use the CC-Link IE Field Network diagnostics to identify the cause of the error and take actions. (📖 MELSEC iQ-R CC-Link IE Field Network User's Manual (Application))

Program example

- Master station (station No.0)

Classification	Label name	Description	Device																																										
Module label	GF11_1.bSts_DataLinkError	Data link error status of own station	SB0049																																										
	GF11_1.bnSts_DataLinkError_Station[1]	Data link status of each station (station No.1)	SW00B0.0																																										
	GF11_1.bnSts_DataLinkError_Station[2]	Data link status of each station (station No.2)	SW00B0.1																																										
Label to be defined	Define global labels as shown below:																																												
<table><tr><th></th><th>Label Name</th><th>Data Type</th><th></th><th>Class</th><th>Assign (Device/Label)</th></tr><tr><td>1</td><td>bStartDirection_1</td><td>Bit</td><td>...</td><td>VAR_GLOBAL</td><td>▼ M0</td></tr><tr><td>2</td><td>bStartDirection_2</td><td>Bit</td><td>...</td><td>VAR_GLOBAL</td><td>▼ M1</td></tr><tr><td>3</td><td>wnSendDataStationNo1</td><td>Word [Signed](0..255)</td><td>...</td><td>VAR_GLOBAL</td><td>▼ D0</td></tr><tr><td>4</td><td>wnRecvDataStationNo1</td><td>Word [Signed](0..255)</td><td>...</td><td>VAR_GLOBAL</td><td>▼ D1000</td></tr><tr><td>5</td><td>wnSendDataStationNo2</td><td>Word [Signed](0..255)</td><td>...</td><td>VAR_GLOBAL</td><td>▼ D300</td></tr><tr><td>6</td><td>wnRecvDataStationNo2</td><td>Word [Signed](0..255)</td><td>...</td><td>VAR_GLOBAL</td><td>▼ D1300</td></tr></table>					Label Name	Data Type		Class	Assign (Device/Label)	1	bStartDirection_1	Bit	...	VAR_GLOBAL	▼ M0	2	bStartDirection_2	Bit	...	VAR_GLOBAL	▼ M1	3	wnSendDataStationNo1	Word [Signed](0..255)	...	VAR_GLOBAL	▼ D0	4	wnRecvDataStationNo1	Word [Signed](0..255)	...	VAR_GLOBAL	▼ D1000	5	wnSendDataStationNo2	Word [Signed](0..255)	...	VAR_GLOBAL	▼ D300	6	wnRecvDataStationNo2	Word [Signed](0..255)	...	VAR_GLOBAL	▼ D1300
	Label Name	Data Type		Class	Assign (Device/Label)																																								
1	bStartDirection_1	Bit	...	VAR_GLOBAL	▼ M0																																								
2	bStartDirection_2	Bit	...	VAR_GLOBAL	▼ M1																																								
3	wnSendDataStationNo1	Word [Signed](0..255)	...	VAR_GLOBAL	▼ D0																																								
4	wnRecvDataStationNo1	Word [Signed](0..255)	...	VAR_GLOBAL	▼ D1000																																								
5	wnSendDataStationNo2	Word [Signed](0..255)	...	VAR_GLOBAL	▼ D300																																								
6	wnRecvDataStationNo2	Word [Signed](0..255)	...	VAR_GLOBAL	▼ D1300																																								

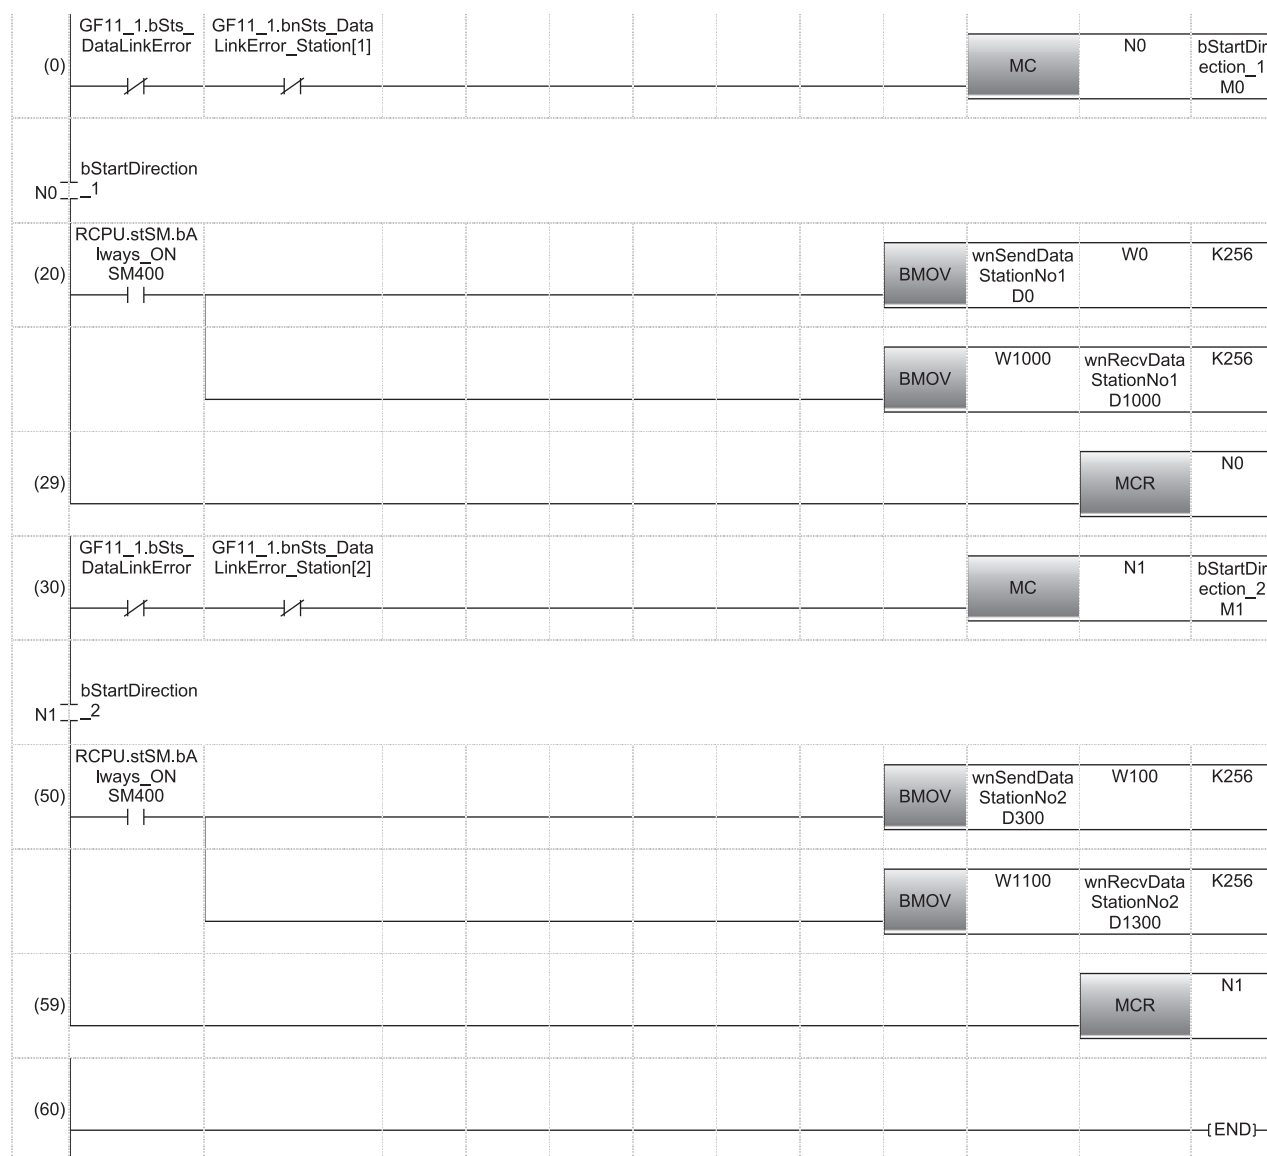

- (20) Communication program with station No.1
 (50) Communication program with station No.2

7



If no response is received for several link scans, the 'Data link status of each station' (SW00B0 to SW00B7) is determined to be a cyclic transmission faulty station.

APPENDIX


Appendix 1 External Dimensions

This chapter describes the external dimensions of each module.

For the external dimensions of the CPU module, refer to the following.


 MELSEC iQ-R CPU Module User's Manual (Startup)

RJ71EN71

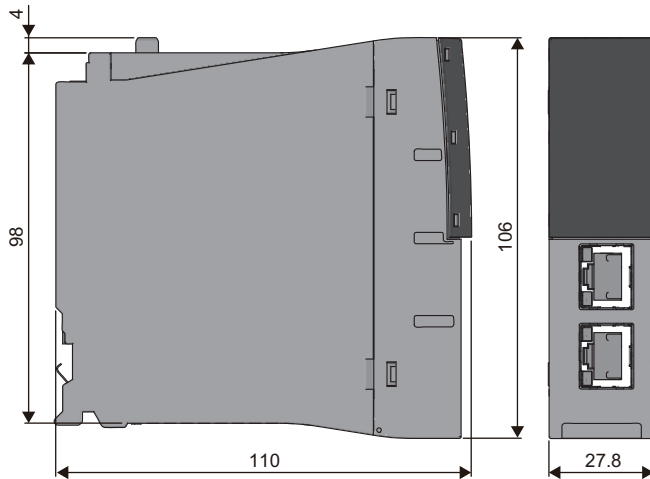


(Unit: mm)

RJ71GP21-SX

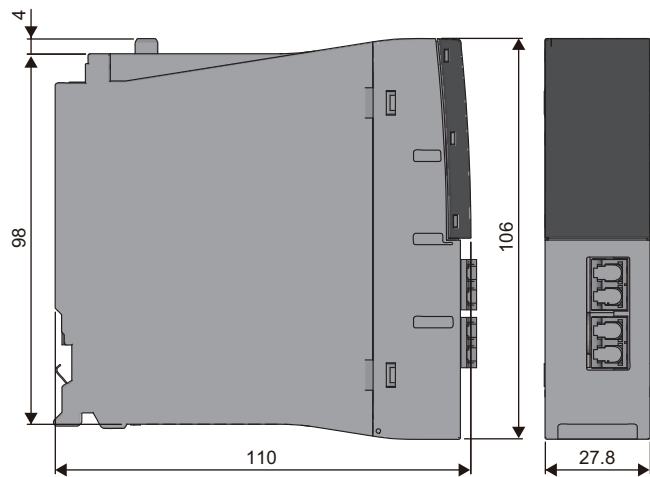

(Unit: mm)

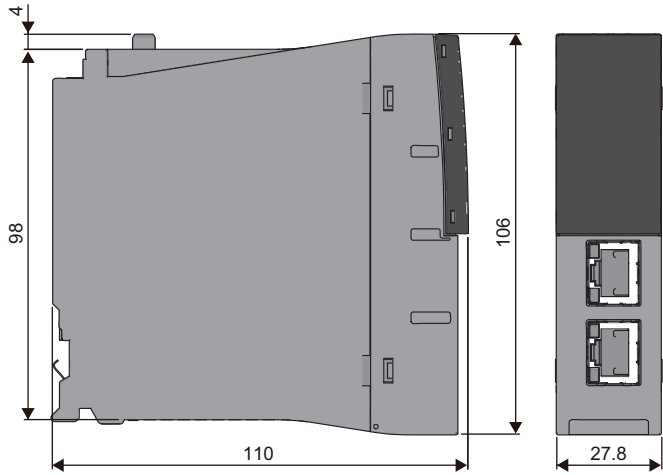

(Unit: mm)

INDEX

0 to 9

1000BASE-T	55
100BASE-TX	55
10BASE-T	55

B

Baton pass	13
------------------	----

C

Cascade connection	28,44,49
CC-Link IE Controller Network-equipped module	13
CC-Link IE Field Network-equipped master/local module	13
Combination of network	17
Communication mode	28
Connector specifications	29
Control CPU	13
Control station switching	34
CPU module (built-in Ethernet port part)	13

D

Data transmission speed	28
Device	13
Disconnection	13

E

Engineering tool	13
Ethernet-equipped module	13
External dimensions	31

F

FTP	13
-----------	----

G

Global label	13
--------------------	----

I

Incorrectly configured ring topology	45,50
Intelligent device station	13
Intelligent function module	13
Internal current consumption (5VDC)	31

J

Jumbo frame	28
-------------------	----

L

Label	13
Link device	14
Link refresh	14
Link scan time	14
Local station	14

M

Master operating station	14
Master station	14
Maximum frame size	28
Maximum number of connectable stations	29
Maximum number of groups	29
Maximum number of link points per network ..	29,30
Maximum number of link points per station ..	29,30
Maximum number of networks	29,30
Maximum segment length	28
Maximum station-to-station distance	29
MELSECNET/10	14
MELSECNET/H	14
Module label	14

N

Network module	14
Network type	17
Number of occupied I/O points	31
Number of simultaneous open connections ..	28

O

Optical fiber specifications	29
------------------------------------	----

P

Predefined protocol support function	14
--	----

R

RAS	14
Relay station	14
Remote I/O station	14
Reserved station	14
RJ45 connector	55
RnENCPU	14
RnENCPU (CPU part)	14
RnENCPU (network part)	14
Routing	14

S

Safety CPU	14
Sending/receiving data storage memory	28
Station number and connection position ..	42,44,48
Submaster operating station	15
Submaster station	15
Subnet mask	15

T

Transient transmission	15
Transient transmission group number	15
Transmission method	28
Transmission specifications	28

W

Weight	31
Wiring products.	55,56,58,60



REVISIONS

*The manual number is given on the bottom left of the back cover.

Revision date	*Manual number	Description
June 2014	SH(NA)-081256ENG-A	First edition
July 2014	SH(NA)-081256ENG-B	Error correction
November 2014	SH(NA)-081256ENG-C	■Added function CC-Link IE Controller Network function of the RJ71EN71 ■Added or modified parts TERMS, Section 1.1, 2.2, 3.2, 5.2, 5.4, 6.2
February 2015	SH(NA)-081256ENG-D	■Added models R08PCPU, R16PCPU, R32PCPU, R120PCPU ■Added functions Automatic detection of connected device of the CC-Link IE Field Network-equipped master/local module Network map update in the CC-Link IE Controller Network diagnostics Network map update in the CC-Link IE Field Network diagnostics ■Added or modified parts RELEVANT MANUALS, Section 3.3, 5.2, 5.3, 7.1
August 2015	SH(NA)-081256ENG-E	■Added models R04ENCPU, R08ENCPU, R08SFCPU, R16ENCPU, R16SFCPU, R32ENCPU, R32SFCPU, R120ENCPU, R120SFCPU ■Added functions Safety communication function of the RJ71GF11-T2 High-speed remote net mode setting of communication mode of the CC-Link IE Field Network-equipped master/local module Improvement of the CC-Link IE Field Network diagnostics Automatic detection of connected device, communication setting reflection, and sensor parameter read/write of the CPU module ■Added or modified parts TERMS, Section 1.2, 2.1, 2.2, 2.3, 3.1, 3.2, 3.3, 5.2, 5.3, 6.1, 7.1, 7.3

Japanese manual number: SH-081252-E

This manual confers no industrial property rights of any other kind, nor does it confer any patent licenses. Mitsubishi Electric Corporation cannot be held responsible for any problems involving industrial property rights which may occur as a result of using the contents noted in this manual.

© 2014 MITSUBISHI ELECTRIC CORPORATION

WARRANTY

Please confirm the following product warranty details before using this product.

1. Gratis Warranty Term and Gratis Warranty Range

If any faults or defects (hereinafter "Failure") found to be the responsibility of Mitsubishi occurs during use of the product within the gratis warranty term, the product shall be repaired at no cost via the sales representative or Mitsubishi Service Company.

However, if repairs are required onsite at domestic or overseas location, expenses to send an engineer will be solely at the customer's discretion. Mitsubishi shall not be held responsible for any re-commissioning, maintenance, or testing on-site that involves replacement of the failed module.

[Gratis Warranty Term]

The gratis warranty term of the product shall be for one year after the date of purchase or delivery to a designated place. Note that after manufacture and shipment from Mitsubishi, the maximum distribution period shall be six (6) months, and the longest gratis warranty term after manufacturing shall be eighteen (18) months. The gratis warranty term of repair parts shall not exceed the gratis warranty term before repairs.

[Gratis Warranty Range]

- (1) The range shall be limited to normal use within the usage state, usage methods and usage environment, etc., which follow the conditions and precautions, etc., given in the instruction manual, user's manual and caution labels on the product.
- (2) Even within the gratis warranty term, repairs shall be charged for in the following cases.
 1. Failure occurring from inappropriate storage or handling, carelessness or negligence by the user. Failure caused by the user's hardware or software design.
 2. Failure caused by unapproved modifications, etc., to the product by the user.
 3. When the Mitsubishi product is assembled into a user's device, Failure that could have been avoided if functions or structures, judged as necessary in the legal safety measures the user's device is subject to or as necessary by industry standards, had been provided.
 4. Failure that could have been avoided if consumable parts (battery, backlight, fuse, etc.) designated in the instruction manual had been correctly serviced or replaced.
 5. Failure caused by external irresistible forces such as fires or abnormal voltages, and Failure caused by force majeure such as earthquakes, lightning, wind and water damage.
 6. Failure caused by reasons unpredictable by scientific technology standards at time of shipment from Mitsubishi.
 7. Any other failure found not to be the responsibility of Mitsubishi or that admitted not to be so by the user.

2. Onerous repair term after discontinuation of production

- (1) Mitsubishi shall accept onerous product repairs for seven (7) years after production of the product is discontinued. Discontinuation of production shall be notified with Mitsubishi Technical Bulletins, etc.

- (2) Product supply (including repair parts) is not available after production is discontinued.

3. Overseas service

Overseas, repairs shall be accepted by Mitsubishi's local overseas FA Center. Note that the repair conditions at each FA Center may differ.

4. Exclusion of loss in opportunity and secondary loss from warranty liability

Regardless of the gratis warranty term, Mitsubishi shall not be liable for compensation of damages caused by any cause found not to be the responsibility of Mitsubishi, loss in opportunity, lost profits incurred to the user by Failures of Mitsubishi products, special damages and secondary damages whether foreseeable or not, compensation for accidents, and compensation for damages to products other than Mitsubishi products, replacement by the user, maintenance of on-site equipment, start-up test run and other tasks.

5. Changes in product specifications

The specifications given in the catalogs, manuals or technical documents are subject to change without prior notice.

TRADEMARKS

Microsoft, Windows, Windows Vista, Windows NT, Windows XP, Windows Server, Visio, Excel, PowerPoint, Visual Basic, Visual C++, and Access are either registered trademarks or trademarks of Microsoft Corporation in the United States, Japan, and other countries.

Intel, Pentium, and Celeron are either registered trademarks or trademarks of Intel Corporation in the United States and other countries.

Ethernet is a trademark of Xerox Corp.

The SD and SDHC logos are either registered trademarks or trademarks of SD-3C, LLC.

All other company names and product names used in this manual are either trademarks or registered trademarks of their respective companies.



SH(NA)-081256ENG-E(1508)MEE

MODEL: R-ETHER/CCIE-U-IN-E

MODEL CODE: 13JX09

mitsubishi electric corporation

HEAD OFFICE : TOKYO BUILDING, 2-7-3 MARUNOUCHI, CHIYODA-KU, TOKYO 100-8310, JAPAN
NAGOYA WORKS : 1-14 , YADA-MINAMI 5-CHOME , HIGASHI-KU, NAGOYA , JAPAN

When exported from Japan, this manual does not require application to the
Ministry of Economy, Trade and Industry for service transaction permission.

Specifications subject to change without notice.